

MARINA COAST WATER DISTRICT
2015 URBAN WATER MANAGEMENT PLAN
APPENDICES



Prepared by

Schaaf & Wheeler
CONSULTING CIVIL ENGINEERS

June 2016

THIS PAGE INTENTIONALLY LEFT BLANK

Appendix A: Resolution Adopting the 2010 Urban Water Management Plan

June 6, 2016

Resolution No. 2016-33
Resolution of the Board of Directors
Marina Coast Water District
Approving and Adopting the District's 2015 Urban Water Management Plan

RESOLVED by the Board of Directors ("Directors") of the Marina Coast Water District ("District"), at a regular meeting duly called and held on June 6, 2016, at 211 Hillcrest Avenue, Marina, California as follows:

WHEREAS, the California Legislature enacted Assembly Bill 797 (Water Code Section 10610 et seq, known as the Urban Water Management Plan Act) during the 1983-84 Regular session, and as amended subsequently, which mandates that every supplier providing water for municipal purposes to more than 3,000 customers or supplying more than 3,000 acre-feet of water annually, prepare an Urban Water Management Plan (UWMP), the primary objective of which is to plan for conservation and efficient use of water; and,

WHEREAS, the District is an urban supplier of water providing water to more than 3,000 customers; and,

WHEREAS, the Plan must be adopted, after a public review and hearing, and must be filed with the California Department of Water Resources within thirty days of adoption; and,

WHEREAS, pursuant to Water Code §10642 the District mailed notices to affected cities and to Monterey County Water Resources Agency in February 2016, solicited input from affected land use jurisdictions in which the District serves water, prepared and circulated a draft 2015 UWMP in May 2016, publicly noticed and conducted a public hearing on the draft 2015 UWMP on June 6, 2016; and,

WHEREAS, pursuant to Water Code §10632, the UWMP must also contain a Water Shortage Contingency Plan, which the Board of Directors has adopted by separate resolution; and,

WHEREAS, copies of the adopted 2015 UWMP will be transmitted to land use jurisdictions in which the District serves water as well as the Monterey County Water Resources Agency, and the plan shall be made available on the District's website.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby:

1. Approves and adopts the 2015 Urban Water Management Plan, and,
2. Authorizes and directs the General Manager to file the 2015 Urban Water Management Plan with the California Department of Water Resources within 30 days after this date.

PASSED AND ADOPTED on June 6, 2016, by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Lee, Shriner, Moore, Gustafson

Noes: Directors None

Absent: Directors None

Abstained: Directors None


Howard Gustafson, President

ATTEST:


Keith Van Der Maaten, Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2016-33 adopted June 6, 2016.


Keith Van Der Maaten, Secretary

Appendix B: References

Agency for Toxic Substances and Disease Registry Division of Health Assessment and Consultation. Public Health Assessment Fort Ord Marina, Monterey County, California. September 24, 1996.

Association of Monterey Bay Area Governments, 2014 Regional Growth Forecast, June 11, 2014

Brown & Caldwell, State of the Salinas River Groundwater Basin, January 2015.

Byron Buck & Associates, Marina Coast Water District 2005 Urban Water Management Plan, December 2005.

California American Water Company, Coastal Water Project, Final Environmental Impact Report, prepared for the California Public Utilities Commission, October 2009

California Department of Finance website, www.dof.ca.gov, population estimate tables:

Report E-1 Population Estimates for Cities, Counties and the State, January 1, 2014 and 2015

Report E-4 Population Estimates for Cities, Counties and the State, 2011-2015, with 2010 Benchmark

California Department of Water Resources:

20x2020 Water Conservation Plan, February 2010.

California Irrigation Management Information System (CIMIS) website

2015 Urban Water Management Plan, Guidebook for Urban Water Suppliers, March 2016.

Methodologies for Calculating Baseline and Compliance Urban Per Capita Water Use, October 1, 2010.

Model Water Efficient Landscape Ordinance, September 10, 2009

Water Audit Manual, February 2016

California Urban Water Conservation Council.

BMP Costs and Savings Study. 2003.

Memorandum of Understanding Regarding Urban Water Conservation in California, As Amended June 9, 2010

Carollo Engineers, Marina Water Systems Master Plan, February 2007.

City of Marina:

2000 General Plan, Adopted October 21, 2000, Amended through December 2006.

Final Housing Element 2008-2014, certified September 1, 2009

City of Seaside:

2009-2014 Housing Element, adopted August 2010

Redevelopment Agency of the City of Seaside, Implementation Plan, 2007 – 2012, Seaside-Fort Ord Redevelopment Project Area, January 17, 2008

County of Monterey, 2010 Monterey County General Plan, October 26, 2010

Denise Duffy & Associates in association with RBF Consulting. Draft Environmental Impact Report Regional Urban Water Augmentation Project. June 2004.

Denise Duffy & Associates in association with RBF Consulting. Final Environmental Impact Report Regional Urban Water Augmentation Project. September, 2004, with amendments in 2006, 2007 and 2016.

Denise Duff & Associates, et. al. Final Draft Groundwater Inventory and Status Report. March 18, 2004.

Fort Ord Reuse Authority:

Draft Capital Improvement Program, FY 2016/17 through FY 2021/2022, April 13, 2015, including annual development projection update for 2016/17

Fort Ord Reuse Plan, 1996.

Reuse Plan EIR, 1997.

Assignment of Easements on the Former Fort Ord and Ord Military Community, County of Monterey, and Quitclaim Deed for Water and Wastewater Systems, between Fort Ord Reuse Authority (Grantor) and Marina Coast Water District (Grantee), October 24, 2001

Geoscience Support Services, Inc

Monterey Peninsula Water Supply Project, Groundwater Modeling and Analysis, prepared for California American Water, April 2015

Monterey Peninsula Water Supply Project, Hydrogeologic Investigation, Technical Memorandum (TM-1) Summary of Results - Exploratory Boreholes, prepared for California American Water, July 2014

Monterey Peninsula Water Supply Project, Test Slant Well Long Term Pumping Monitoring Reports, prepared for California American Water, May 2015 thru May 2016

Monterey Peninsula Water Supply Project, Test Slant Well Long Term Pumping Monthly Monitoring Reports, prepared for California American Water, May 2015 thru May 2016

Technical Memorandum - Monterey Peninsula Water Supply Project, Baseline Water And Total Dissolved Solids Levels Test Slant Well Area, Submitted To The Hydrogeologic Working Group, prepared for California American Water, April 2015

GRC Redevelopment Consultants, Implementation Plan 2007-2012 for the Seaside – Fort Ord Redevelopment Project Area, Prepared for the Redevelopment Agency of the City of Seaside, January 17, 2008.

Keyser Marston Associates, Inc., Implementation Plan for the Fort Ord Redevelopment Project Area, Prepared for the Redevelopment Agency of Monterey County, March 2007

LAFCO of Monterey County, Municipal Services Review for the Monterey Peninsula, 2006

Mactec Engineering and Consulting Inc. Former Fort Ord Environmental Cleanup. Fortordcleanup.com. 2005.

Marina Coast Water District:

2015 Consumer Confidence Report for Central Marina and Ord Community, April 2016

Comprehensive Annual Financial Report for the Fiscal Year Ended June 30, 2015, approved November 13, 2015.

Marina Coast Water District Eastern Distribution System, Construction of MCWD Well 34, Summary of Operations, prepared by Martin B. Feeney, Consulting Hydrogeologist, July 2011

Water Supply Assessment and Written Verification of Supply for the Proposed Cypress Knolls Residential Project, prepared with Byron Buck & Associates, March 22, 2006.

Water Supply Assessment and Written Verification of Supply for the Proposed Resort at Del Rey Oaks, prepared with Byron Buck & Associates, December 2007.

Water Supply Assessment and Written Verification of Supply for the Proposed East Garrison Specific Plan Development, prepared with Byron Buck & Associates, June 3, 2004.

Water Supply Assessment and Written Verification of Supply for the City of Seaside Main Gate Specific Plan, prepared with Byron Buck & Associates, October 9, 2007.

Water Supply Assessment and Written Verification of Supply for the Proposed Marina Station Project, prepared with Byron Buck & Associates, January 4, 2006.

Water Supply Assessment and Written Verification of Supply for the Marina Heights Specific Plan, prepared with Byron Buck & Associates, December 15, 2003.

Water Supply Assessment and Written Verification of Supply for the Monterey Down Specific Plan, prepared with Schaaf & Wheeler, November 13, 2012.

Water Supply Assessment and Written Verification of Supply for the Proposed University Villages Specific Plan Development and Marina Community Partners Project, prepared with Byron Buck & Associates, January 26, 2005.

Water Supply Assessment for the Monterey-Salinas Transit Whispering Oaks Business Park Project, prepared with Carollo Engineers, November 2010.

Well Construction and Testing Summary, MCWD Watkins Gate Well, prepared by Luhdorff and Scalmanini, December 2011.

Quarterly Water Consumption Report, period ending: December 31, 2015.

Monterey County Water Resources Agency:

2012 Ground Water Summary Report, October 2013.

2013 Ground Water Summary Report, October 2014.

2014 Ground Water Summary Report, October 2015.

Agreement between the United States of America and the Monterey County Water Resources Agency concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404, September 21, 1993.

Annexation Agreement and Groundwater Mitigation Framework for Marina Area Lands (1996). Document recorded in the Office of the Monterey County Recorder on August 7, 1996, at Reel 3404 Page 749.

Environmental Impact Report/Environmental Impact Statement for the Salinas Valley Water Project. June 2001.

Final Report, Hydrogeologic Investigation of the Salinas Valley Basin in the Vicinity of Fort Ord and Marina, Salinas Valley, California, prepared by Harding ESE, April 2001

Salinas Valley Integrated Regional Water Management Functionally Equivalent Plan, prepared by RMC Water and Environment, May 2006

Salinas Valley Water Project Engineer's Report, prepared by RMC Water and Environment, January 2003

Monterey Regional Water Pollution Control Agency

Consolidated Final Environmental Impact Report for the Pure Water Monterey Groundwater Replenishment Project, prepared by Denise Duffy & Associates, adopted October 2015

Pure Water Delivery and Supply Agreement between MRWPCA and MCWD, April 2016

RBF Consulting. Water Conservation Feasibility Study Draft. September 2003.

RBF Consulting. Regional Urban Recycled Water Distribution Project. 2003.

RMC Water and Environment, MCWD Recycled Water Project Basis of Design Report, 2006

Schaaf & Wheeler, Marina Coast Water District 2010 Urban Water Management Plan, June 2011.

WRIME. Deep Aquifer Investigative Study. May, 2003.

United States Census Bureau, American FactFinder website, www.census.gov

2010 Decennial Census Redistricting Data, Table GCT-PL2: California Population and Housing Occupancy Status - County - Census Tract

2000 Decennial Census Summary File 1 (SF1)

Table 4, Annual Estimates of the Resident Population for Incorporated Places in California: April 1, 2000 to July 1, 2009 (SUB-EST2009-04-06)

Appendix C: Land Use Forecast and Water Demand Projections by Jurisdiction

The following tables present the water demand projects for the Marina Coast Water District, based upon the development and redevelopment projections provided by the various jurisdictions. Water demands are estimated as a function of the size (acreage/square footage) or number of units of a development, depending on the type of land use, and a water demand unit factor that corresponds to that use. For each type of land use, Demand = Size x Unit Factor.

- Existing demands are estimated from MCWD's 2012 water usage records for each jurisdictional area. 2012 was used as the basis because it was an average water usage year.
- For developments that have approved Specific Plans, the water demand factors and total water demand estimates have been taken from the respective Water Supply Assessments (WSAs) for these Specific Plan areas.
- For in-fill development under approved General Plans or Master Plans (e.g., the City of Marina, CSUMB), MCWD's standard water demand factors have been used with the in-fill land use projections provided by the jurisdiction.
- For the Ord Community, the initial development forecast was based upon the Fort Ord Reuse Authority's latest annual growth forecast, which is developed for CIP planning. The projected developments, generally by square footage or units, are then multiplied by the appropriate unit demand factors.
- For areas not reflected in the Fort Ord Reuse Authority growth forecast (Central Marina, the Army and State Parks), the initial projections reflected those in the 2010 UWMP.

Based upon the housing projections in the water demand tables, population projections were then developed. In-fill development was assumed to have the same number of persons per dwelling unit as the existing area. For new development, if the specific plan, the water supply assessment or the associated Environmental Impact Report projected a number of persons per housing unit, that factor was used. If a persons-per-dwelling-unit estimate did not exist, the new development was assumed to have the same occupancy as the city average.

Tables:

C1: 2015 Water Demand Projections by Jurisdiction

C2: 2010 Water Demand Projections by Jurisdiction

C3: Water Demand Projection Details

C4: Population Growth Projections by Jurisdiction

C5: Population Growth Projection Details

C6: Projected Demands by Source, with Planned Recycled Water Use

Marina Coast Water District, 2015 Urban Water Management Plan

Table C1: 2015 Draft Water Demand by Jurisdiction (AFY)

	Jurisdiction	2012*	2015**	2020	2025	2030	2035	Notes	Allocation
Ord	U.S. Army	620	633	663	825	825	825		1,577
	CSUMB	404	404	442	632	755	779		1,035
	Del Rey Oaks	0	0	186	551	551	551		243
	City of Monterey	0	0	0	130	130	130		65
	County of Monterey	8	52	377	539	539	539		720
	UCMBEST	3	3	94	299	515	515	3	230
	City of Seaside	657	657	997	1,852	2,447	2,876	1	1,012
	State Parks and Rec.	0	0	12	18	20	25		45
	Marina Ord Comm.	264	285	901	1,572	1,702	1,704	2	1,625
	Assumed Line Loss	395	348	348	348	348	348		348
	Marina	Armstrong Ranch	0	0	0	680	680	680	
Cemex		0	0	0	0	0	500		500
Marina Central		1,823	1,823	2,184	2,491	2,606	2,725		3,020
Subtotal - Ord		2,351	2,382	4,021	6,766	7,833	8,293	4	6,900
Subtotal - Marina		1,823	1,823	2,184	3,171	3,286	3,905		4,440
Total		4,174	4,204	6,205	9,937	11,119	12,197		11,340

*Actual demands from calendar year 2012 used to represent a non-drought year.

** Projected demands. Actual use was lower due to mandatory drought restrictions.

1 Seaside includes Seaside Resort Golf Course (250 AFY temp use).

2. Allocation includes 1325 AFY groundwater and 300 AFY existing pilot desalination plant

3. MBEST commented that they may develop up to 230 AFY as soon as the market allows it.

4. Allocation includes 6600 AFY groundwater and 300 AFY existing pilot desalination plant.

Table C2: 2010 UWMP Water Demands by Jurisdiction (AFY)

	Jurisdiction	2010	2015	2020	2025	2030	Allocation
Ord	U.S. Army	752	792	838	997	997	1,577
	CSUMB	403	441	631	754	778	1,035
	Del Rey Oaks	0	326	527	527	527	243
	City of Monterey	0	0	92	92	92	65
	County of Monterey	4	627	1,087	1,087	1,087	710
	UCMBEST	2	93	276	474	474	230
	City of Seaside	792	1,130	1,351	1,664	2,093	1,012
	State Parks and Rec.	0	12	18	20	25	45
	Marina Ord Comm.	281	812	1,537	1,738	1,739	1,625
	Marina Sphere	10	10	10	10	10	10
	FORA Strategic Res.	0	0	0	0	0	-230
	Assumed Line Loss	348	348	348	348	348	578
	Marina	Armstrong Ranch	0	0	550	680	680
Cemex		0	0	0	0	500	500
Marina Central		1,962	2,324	2,630	2,746	2,864	3,020
Subtotal - Ord		2,592	4,591	6,715	7,712	8,172	6,900
Subtotal - Marina		1,962	2,324	3,181	3,426	4,044	4,440
Total		4,554	6,915	9,896	11,137	12,216	11,340

5. Marina Sphere merged in Monterey County totals.

6. FORA Strategic Reserve allocated out to jurisdictions in 2007.

This page is intentionally blank.

Marina Coast Water District, 2015 Urban Water Management Plan
 Table C3: Water Demand Projection Details

Marina Ord	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
Marina Heights																							
Townhome	MAR	Dwelling Units			-	-	12	13	13	13	13	13	13	12									
Cluster Market/Bridge	MAR	Dwelling Units		4	5	47	19	19	19	19	19	19	19	18									
Market A	MAR	Dwelling Units		10	15	105	29	29	29	29	29	29	29	33									
Market B	MAR	Dwelling Units		6	10	85	34	34	34	34	34	34	34	33									
Estates	MAR	Dwelling Units		-	-	-	-	13	12	12	12	12	12	12	-								
Landscaping (Turf)	MAR	Acres		0.1	0.1	0.7	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3									
Landscaping (Non-Turf)	MAR	Acres					0.5	0.2	0.2	0.2	0.1	0.1	0.1	0.1									
Cypress Knolls																							
SF Home / Townhome	MAR	Dwelling Units								255	200		141										
Apartments	MAR	Dwelling Units								85			31										
Assisted Living	MAR	Dwelling Units											60										
Open Space	MAR	Acres								28.57													
Parklands	MAR	Acres								2.17													
Right of Way	MAR	Acres								27.79			5.51										
Dunes on Monterey Bay																							
Alley (small lot)	MAR	Dwelling Units		20	24	48	54	59	37														
Carriage	MAR	Dwelling Units		10	21	6	12	30	47														
Standard	MAR	Dwelling Units	23	10	12	20	44	6															
Standard (small lot)	MAR	Dwelling Units		20	15	25	48	23															
Duets	MAR	Dwelling Units			34	38	78	98	40	60	4												
Townhome (live-work)	MAR	Dwelling Units			16	52	50	21															
Townhome (mixed use)	MAR	Dwelling Units			4	8	8	4															
Apartments (completed)	MAR	Dwelling Units	108																				
Landscaping (MCP)	MAR	Acres	1	1	3.00	5.00	5.00	4.20															
Landscaping (other)	MAR	Acres		1	1.00	4.00	2.10																
Promontory																							
	MAR	Dwelling Units		176																			
TAMC TOD																							
	MAR	Dwelling Units					100	100															
Existing/Replacement Residential																							
Patton Park (complete)	MAR	Dwelling Units																					
Shelter Outreach Plus (complete)	MAR	Dwelling Units																					
Interim Housing (complete)	MAR	Dwelling Units																					
Non Residential																							
SVMHS Development	MAR	Square Feet			10,000	15,000	15,000	16,000															
TAMC TOD (office/public facilities)	MAR	Square Feet					20,000	20,000															
Airport Economic Development Area	MAR	Square Feet					30,357	30,357	30,357	60,714	60,714	66,786	66,786	66,786	66,786	66,786							
Cypress Knolls Community Center	MAR	Square Feet								16,525													
Cypress Knolls Support Services	MAR	Square Feet								6,300													
TAMC TOD (retail)	MAR	Square Feet					37,500	37,500															
Marina Airport Hotel/Golf	MAR	Rooms																					
Marina High School	MAR	Square Feet							15,000	10,000													
Imjin Office Park	MAR	Square Feet		9,000	12,000																		
Monterey Peninsula College	MAR	Square Feet																					
Institute of Canine Studies	MAR	Square Feet					24,000		4,100		5,400		4,800		9,700		11,300				12,470		
UV - Planning Area A	MAR	Square Feet			20,000	16,000																	
UV - Planning Area J	MAR	Square Feet						3,000	55,000	8,000	17,000												
UV - Planning Area B1	MAR	Square Feet		25,000					114,000	15,000	10,000	35,000	10,000										
UV - Planning Area V	MAR	Square Feet								12,000	5,000	2,000	5,500										
UV - Planning Area OP (1-5)	MAR	Square Feet		150,000							300,000	253,000	82,000	170,000	95,000								
UV - Planning Area T	MAR	Rooms		108																			
UV - Planning Area Z	MAR	Square Feet											8,500	5,000	5,000	1,500							

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Marina Heights					
Townhome	Residential (8-15 units / acre)	102	Dwelling Units	0.25	
Cluster Market/Bridge	Residential (8-15 units / acre)	188	Dwelling Units	0.25	
Market A	SF Residential (5-8 units / acre)	337	Dwelling Units	0.33	
Market B	SF Residential (5-8 units / acre)	338	Dwelling Units	0.33	
Estates	SF Residential (< 5 units / acre)	85	Dwelling Units	0.5	
Landscaping (Turf)	Landscape (turf)	3.0	Acres	2.5	
Landscaping (Non-Turf)	Landscape (non-turf)	1.5	Acres	1.5	1
Cypress Knolls					
SF Home / Townhome	SF Residential (5-8 units / acre)	596	Dwelling Units	0.1319	1
Apartments	Multi family (> 15 units / acre)	116	Dwelling Units	0.1507	1
Assisted Living	Multi family (> 15 units / acre)	60	Dwelling Units	0.1672	1
Open Space	Landscape (non-turf)	28.57	Acres	0.5849	1
Parklands	Landscape (turf)	2.17	Acres	1.1244	1
Right of Way	Landscape (non-turf)	33.3	Acres	0.4586	1
Dunes on Monterey Bay					
Alley (small lot)	Residential (8-15 units / acre)	242	Dwelling Units	0.16491736	1
Carriage	Residential (8-15 units / acre)	126	Dwelling Units	0.25706349	1
Standard	SF Residential (5-8 units / acre)	115	Dwelling Units	0.29869565	1
Standard (small lot)	Residential (8-15 units / acre)	131	Dwelling Units	0.23877863	1
Duets	SF Residential (5-8 units / acre)	352	Dwelling Units	0.12392045	1
Townhome (live-work)	Residential (8-15 units / acre)	139	Dwelling Units	0.12791367	1
Townhome (mixed use)	Residential (8-15 units / acre)	24	Dwelling Units	0.16375	1
Apartments (completed)	Multi family (> 15 units / acre)	108	Dwelling Units	0.12185185	1
Landscaping (MCP)	Landscape (non-turf)	19.2	Acres	1.22916667	1
Landscaping (other)	Landscape (non-turf)	8.1	Acres	1.11111111	1
Promontory					
	Multi family (> 15 units / acre)	176	Dwelling Units	0.07477273	1
TAMC TOD					
	Multi family (> 15 units / acre)	200	Dwelling Units	0.25	
Existing/Replacement Residential					
Patton Park (complete)	Residential (8-15 units / acre)		Dwelling Units	0.25	
Shelter Outreach Plus (complete)	Residential (8-15 units / acre)		Dwelling Units	0.25	
Interim Housing (complete)	Residential (8-15 units / acre)		Dwelling Units	0.25	
Non Residential					
SVMHS Development	Office / R&D	56000	Square Feet	0.000135	
TAMC TOD (office/public facilities)	Office / R&D	40000	Square Feet	0.000135	
Airport Economic Development Area	Light Industrial	546429	Square Feet	0.00015	
Cypress Knolls Community Center	Various	16525	Square Feet	0.001	1
Cypress Knolls Support Services	Office / R&D	6300	Square Feet	0.001	1
TAMC TOD	Retail	75000	Square Feet	0.00021	
Marina Airport Hotel/Golf	Hotel, Motel and Timeshares		Rooms	0.17	1
Marina High School	Schools (K-12)	25000	Square Feet	0.0003	
Imjin Office Park	Office / R&D	21000	Square Feet	0.000135	
Monterey Peninsula College	Higher Education		Square Feet	0.0003	
Institute of Canine Studies	Office / R&D	71770	Square Feet	0.000135	
UV - Planning Area A	Various	36000	Square Feet	0.00298361	1
UV - Planning Area J	Various	83000	Square Feet	0.00040458	1
UV - Planning Area B1	Various	209000	Square Feet	0.00037813	1
UV - Planning Area V	Various	24500	Square Feet	0.00067102	1
UV - Planning Area OP (1-5)	Various	105000	Square Feet	0.00020227	1
UV - Planning Area T	Various	108	Rooms	0.28703704	1
UV - Planning Area Z	Various	20000	Square Feet	0.000683	1

Jurisdiction	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	6.25	16.25	3.00	0.00
	0.00	18.75	23.75	4.50	0.00
	0.00	52.47	47.85	10.89	0.00
	0.00	44.55	56.10	10.89	0.00
	0.00	6.50	30.00	6.00	0.00
	0.00	3.00	3.75	0.75	0.00
	0.00	1.05	1.05	0.15	0.00
Marina Ord Comm.	0.00	132.57	178.75	36.18	0.00
	0.00	0.00	78.62	0.00	0.00
	0.00	0.00	17.48	0.00	0.00
	0.00	0.00	10.03	0.00	0.00
	0.00	0.00	16.71	0.00	0.00
	0.00	0.00	2.44	0.00	0.00
	0.00	0.00	15.27	0.00	0.00
Marina Ord Comm.	0.00	0.00	140.55	0.00	0.00
	0.00	33.81	6.10	0.00	0.00
	0.00	20.31	12.08	0.00	0.00
	6.87	27.48	0.00	0.00	0.00
	0.00	31.28	0.00	0.00	0.00
	0.00	30.73	12.89	0.00	0.00
	0.00	17.78	0.00	0.00	0.00
	0.00	3.93	0.00	0.00	0.00
	13.16	0.00	0.00	0.00	0.00
	1.23	22.37	0.00	0.00	0.00
	0.00	9.00	0.00	0.00	0.00
Marina Ord Comm.	21.26	196.69	31.07	0.00	0.00
Marina Ord Comm.	0.00	13.16	0.00	0.00	0.00
Marina Ord Comm.	0.00	50.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	7.56	0.00	0.00	0.00
Marina Ord Comm.	0.00	5.40	0.00	0.00	0.00
Marina Ord Comm.	0.00	9.11	42.80	30.05	0.00
Marina Ord Comm.	0.00	0.00	9.22	0.00	0.00
Marina Ord Comm.	0.00	0.00	6.31	0.00	0.00
Marina Ord Comm.	0.00	15.75	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	7.50	0.00	0.00
Marina Ord Comm.	0.00	2.84	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	3.24	1.93	2.84	1.68
Marina Ord Comm.	0.00	107.41	0.00	0.00	0.00
Marina Ord Comm.	0.00	1.21	32.37	0.00	0.00
Marina Ord Comm.	0.00	9.45	69.58	0.00	0.00
Marina Ord Comm.	0.00	0.00	16.44	0.00	0.00
Marina Ord Comm.	0.00	30.34	128.44	53.60	0.00
Marina Ord Comm.	0.00	31.00	0.00	0.00	0.00
Marina Ord Comm.	0.00	0.00	5.81	7.85	0.00

Cumulative Demand (AFY)					
2015	2020	2025	2030	2035	
0.00	6.25	22.50	25.50	25.50	
0.00	18.75	42.50	47.00	47.00	
0.00	52.47	100.32	111.21	111.21	
0.00	44.55	100.65	111.54	111.54	
0.00	6.50	36.50	42.50	42.50	
0.00	3.00	6.75	7.50	7.50	
0.00	1.05	2.10	2.25	2.25	
0.00	132.57	311.32	347.50	347.50	
0.00	0.00	78.62	78.62	78.62	
0.00	0.00	17.48	17.48	17.48	
0.00	0.00	10.03	10.03	10.03	
0.00	0.00	16.71	16.71	16.71	
0.00	0.00	2.44	2.44	2.44	
0.00	0.00	15.27	15.27	15.27	
0.00	0.00	140.55	140.55	140.55	
0.00	33.81	39.91	39.91	39.91	
0.00	20.31	32.39	32.39	32.39	
6.87	34.35	34.35	34.35	34.35	
0.00	31.28	31.28	31.28	31.28	
0.00	30.73	43.62	43.62	43.62	
0.00	17.78	17.78	17.78	17.78	
0.00	3.93	3.93	3.93	3.93	
13.16	13.16	13.16	13.16	13.16	
1.23	23.60	23.60	23.60	23.60	
0.00	9.00	9.00	9.00	9.00	
21.26	217.95	249.02	249.02	249.02	
0.00	13.16	13.16	13.16	13.16	
0.00	50.00	50.00	50.00	50.00	
0.00	0.00	0.00	0.00	0.00	
0.00	0.00	0.00	0.00	0.00	
0.00	0.00	0.00	0.00	0.00	
0.00	7.56	7.56	7.56	7.56	
0.00	5.40	5.40	5.40	5.40	
0.00	9.11	51.91	81.96	81.96	
0.00	0.00	9.22	9.22	9.22	
0.00	0.00	6.31	6.31	6.31	
0.00	15.75	15.75	15.75	15.75	
0.00	0.00	0.00	0.00	0.00	
0.00	0.00	7.50	7.50	7.50	
0.00	2.84	2.84	2.84	2.84	
0.00	0.00	0.00	0.00	0.00	
0.00	0.00	0.00	0.00	0.00	
0.00	3.24	5.17	8.01	9.69	
0.00	107.41	107.41	107.41	107.41	
0.00	1.21	33.58	33.58	33.58	
0.00	9.45	79.03	79.03	79.03	
0.00	0.00	16.44	16.44	16.44	
0.00	30.34	158.78	212.38	212.38	
0.00	31.00	31.00	31.00	31.00	
0.00	0.00	5.81	13.66	13.66	

Armstrong Ranch	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
Marina Station																							
Single Family Homes (15,000)	MAR	Dwelling Units								23	87	37											
Single Family Homes (6,500)	MAR	Dwelling Units								100	250	220	99										
Apartments	MAR	Dwelling Units								100	250	220	78										
Irrigated parkland	MAR	Acres								6.0	6.5												
Open Space (turf)	MAR	Acres								4.3													
Non Residential																							
Marina Station																							
Mixed Use Retail	MAR	Square Feet									15,000	30,000	15,000										
Office Uses	MAR	Square Feet									40,000	60,000	43,808										
Light Industrial	MAR	Square Feet										300,000	351,624										
Landscape (15% of indoor consumption)	MAR	Square Feet																					
System Loss (5%)	MAR	Square Feet																					

CEMEX	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
Non Residential																							
CEMEX (formerly RMC Lonestar)	MAR	Square Feet																	666667	666667	666667	666667	666667

Marina Central	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
In-Fill Development MF	MAR	Dwelling Units						182					167										
In-Fill Development SF	MAR	Dwelling Units						9					24										
Downtown Specific Plan	MAR	Dwelling Units		80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80
Non Residential																							
Hotel / Motel	MAR	Rooms						400															
Retail and Restaurants	MAR	Square Feet						46000					46000										
Other Commercial	MAR	Square Feet						60000															
Institutional	MAR	Square Feet						5000					5000										
Schools	MAR	Square Feet						77760					110500										
Landscape (turf)	MAR	Acres						8					16						1.2				
Downtown Specific Plan - Office	MAR	Square Feet		4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200	4200
Downtown Specific Plan - Retail / Commercial	MAR	Square Feet		8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470	8470

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Marina Station					
Single Family Homes (15,000)	SF Residential (< 5 units / acre)	147	Dwelling Units	0.5	
Single Family Homes (6,500)	SF Residential (5-8 units / acre)	669	Dwelling Units	0.33	
Apartments	Multi family (> 15 units / acre)	648	Dwelling Units	0.25	
Irrigated parkland	Landscape (turf)	12.5	Acres	2.5	
Open Space (turf)	Landscape (turf)	4.3	Acres	2.5	
Non Residential					
Marina Station					
Mixed Use Retail	Retail	60000	Square Feet	0.00021	
Office Uses	Office / R&D	143808	Square Feet	0.000135	
Light Industrial	Light Industrial	651624	Square Feet	0.00015	
Landscape (15% of indoor consumption)	Landscape (non-turf)		Square Feet	2.1	1
System Loss (5%)			Square Feet		1

Land Use Type	Land Use	Total	Units	Multiplier	Notes
Non Residential					
RMC Lonestar (added to FORA table)	Light Industrial	3333333.3	Square Feet	0.00015	

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
In-Fill Development MF	Multi family (> 15 units / acre)	349	Dwelling Units	0.25	6
In-Fill Development SF	SF Residential (5-8 units / acre)	33	Dwelling Units	0.33	6
Downtown Specific Plan	Multi family (> 15 units / acre)	1600	Dwelling Units	0.25	9
Non Residential					
Hotel / Motel	Hotel, Motel and Timeshares	400	Rooms	0.17	
Retail and Restaurants	Restaurant	92000	Square Feet	0.00145	
Other Commercial	Other Commercial	60000	Square Feet	0.0003	
Institutional	Institutional	10000	Square Feet	0.0003	
Schools	Schools (K-12)	188260	Square Feet	0.0003	
Landscape (turf)	Landscape (turf)	25.2	Acres	2.5	
Downtown Specific Plan - Office	Office / R&D	84000	Square Feet	0.000135	9
Downtown Specific Plan - Retail / Commercial	Other Commercial	169400	Square Feet	0.0003	9

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	0.00	73.50	0.00	0.00
	0.00	0.00	220.77	0.00	0.00
	0.00	0.00	162.00	0.00	0.00
	0.00	0.00	31.25	0.00	0.00
	0.00	0.00	10.75	0.00	0.00
Armstrong Ranch	0.00	0.00	498.27	0.00	0.00

Armstrong Ranch	0.00	0.00	12.60	0.00	0.00
Armstrong Ranch	0.00	0.00	19.41	0.00	0.00
Armstrong Ranch	0.00	0.00	97.74	0.00	0.00
Armstrong Ranch	0.00	0.00	19.46	0.00	0.00
Armstrong Ranch	0.00	0.00	32.37	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	0.00	73.50	73.50	73.50
	0.00	0.00	220.77	220.77	220.77
	0.00	0.00	162.00	162.00	162.00
	0.00	0.00	31.25	31.25	31.25
	0.00	0.00	10.75	10.75	10.75
Armstrong Ranch	0.00	0.00	498.27	498.27	498.27

	0.00	0.00	12.60	12.60	12.60
	0.00	0.00	19.41	19.41	19.41
	0.00	0.00	97.74	97.74	97.74
	0.00	0.00	19.46	19.46	19.46
	0.00	0.00	32.37	32.37	32.37

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
CEMEX	0.00	0.00	0.00	0.00	500.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
CEMEX	0.00	0.00	0.00	0.00	500.00

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
Marina Central	0.00	45.50	41.75	0.00	0.00
Marina Central	0.00	2.97	7.92	0.00	0.00
Marina Central	0.00	100.00	100.00	100.00	100.00

Marina Central	0.00	68.00	0.00	0.00	0.00
Marina Central	0.00	66.70	66.70	0.00	0.00
Marina Central	0.00	18.00	0.00	0.00	0.00
Marina Central	0.00	1.50	1.50	0.00	0.00
Marina Central	0.00	23.33	33.15	0.00	0.00
Marina Central	0.00	20.00	40.00	0.00	3.00
Marina Central	0.00	2.84	2.84	2.84	2.84
Marina Central	0.00	12.71	12.71	12.71	12.71

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
Marina Central	0.00	45.50	87.25	87.25	87.25
Marina Central	0.00	2.97	10.89	10.89	10.89
Marina Central	0.00	100.00	200.00	300.00	400.00

	0.00	68.00	68.00	68.00	68.00
	0.00	66.70	133.40	133.40	133.40
	0.00	18.00	18.00	18.00	18.00
	0.00	1.50	3.00	3.00	3.00
	0.00	23.33	56.48	56.48	56.48
	0.00	20.00	60.00	60.00	63.00
	0.00	2.84	5.67	8.51	11.34
	0.00	12.71	25.41	38.12	50.82

Monterey County	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
East Garrison I																							
Market Rate	MCO	Dwelling Units	104	149	160	140	120	100	100	100	77												
Affordable	MCO	Dwelling Units	66	-	-	8	43	75	100	105	23												
Monterey Horse Park (see City of Seaside)	MCO	Dwelling Units																					
Non Residential																							
Monterey County Office																							
Horse Park (see City of Seaside)	MCO	Square Feet																					
Whispering Oaks Business Park	MCO	Square Feet																					
Intergarrison Rd Office Park	MCO	Square Feet				127,200	127,200	127,200	127,200	127,000													
East Garrison I Office Development	MCO	Square Feet			14,000	-	10,000	-	11,000														
MST Bus Maint & Opns Facility	MCO	Square Feet																					
Monterey County Light Ind.																							
Horse Park (see City of Seaside)	MCO	Square Feet																					
Whispering Oaks Business Park	MCO	Square Feet																					
MST Bus Maint & Opns Facility	MCO	Square Feet																					
Monterey County Retail																							
Whispering Oaks Business Park	MCO	Square Feet																					
East Garrison I Retail	MCO	Square Feet			20,000	20,000																	
East Garrison I Arts Complex	MCO	Square Feet																					
East Garrison I Public Facilities	MCO	Square Feet																					
Ord Market (existing)	MCO	Square Feet																					
Horse Park (see City of Seaside)	MCO	Square Feet																					
Horse Park Hotel (see City of Seaside)	MCO	Rooms																					
East Garrison Landscaping	MCO	Acres				10.44	4.94																

CSUMB	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
CSUMB Housing	CSU/MAR	Dwelling Units						95	95	95	95	48	48	48	48	48	48	48	48	48			
Non Residential																							
CSUMB Academic and Administrative Buildings	CSUMB	Square Feet						101,852	101,852	101,852	101,852				88,888	88,888	88,888	88,888	88,888				
CSUMB Landscaping	CSUMB	Acres								5.00	10.00	11			7								

UCMBEST	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
UC 8th Street	UC/MCO	Dwelling Units				33	33	33	33	33	33	33	33	33	33								
UC East Campus - SF	UC/MCO	Dwelling Units							67					67	66								
UC East Campus - MF	UC/MCO	Dwelling Units																					
Non Residential																							
UC Eight Street	UC/MCO	Square Feet				19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602								
UC Central South Campus	UC/MAR	Square Feet							16,196	16,196	16,196	16,196	16,196	16,196	16,196	16,196	16,196	16,196					
UC Central South Campus	UC/MAR	Square Feet							7,799	7,799	7,799	7,799	7,799	7,799	7,799	7,799	7,799	7,799					
UC Central North & West Campuses	UC/MAR	Square Feet	-	-	40,000	61,417	61,417	61,417	61,417	67,559	67,559	67,559	67,559	67,559	67,559								
UC Central North & West Campuses	UC/MAR	Square Feet				6,346	6,346	6,346	6,346	6,981	6,981	6,981	6,981	6,981	6,981								
UC Central North & West Campuses	UC/MAR	Square Feet	-	-	20,000	20,408	20,408	20,408	20,408	22,448	22,448	22,448	22,448	22,448	22,448								
UC South Campus	UC/MAR	Square Feet																					
UC East Campus	UC/MCO	Square Feet							26,000					26,000									
UC Eight Street	UC/MCO	Square Feet				19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602	19,602								
UC East Campus	UC/MCO	Rooms																					250
UC Central North & West Campuses	UC/MAR	Rooms		-	-	-	-	-	-	-	-	-	-	150	-								

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
East Garrison					
Market rate	SF Residential (< 5 units / acre)	1050	Dwelling Units	0.3	1
Affordable	SF Residential (5-8 units / acre)	420	Dwelling Units	0.186	1
Monterey Horse Park (see City of Seaside)	SF Residential (5-8 units / acre)		Dwelling Units	0.33	3
Non Residential					
Monterey County Office					
Horse Park (see City of Seaside)	Office / R&D		Square Feet	0.000135	3
Whispering Oaks Business Park	Office / R&D		Square Feet	0.000166	8
Intergarrison Rd Office Park	Office / R&D	635800	Square Feet	0.000135	
East Garrison I Office Development	Office / R&D	35000	Square Feet	0.000135	
MST-Bus Maint & Opns Facility	Office / R&D		Square Feet	0.000124	8
Monterey County Light Ind.					
Horse Park (see City of Seaside)	Light Industrial		Square Feet	0.00015	3
Whispering Oaks Business Park	Light Industrial		Square Feet	0.000166	8
MST-Bus Maint & Opns Facility	Light Industrial		Square Feet	0.000124	8
Monterey County Retail					
Whispering Oaks Business Park	Retail		Square Feet	0.000166	8
East Garrison I Retail	Retail	40000	Square Feet	0.00021	
East Garrison I Arts Complex	Retail		Square Feet	0.0001406	1
East Garrison I Public Facilities	Retail		Square Feet	0.0003	1
Ord Market (existing)	Retail		Square Feet	0.00021	
Horse Park (see City of Seaside)	Retail		Square Feet	0.00021	3
Horse Park Hotel (see City of Seaside)	Hotel, Motel and Timeshares		Rooms	0.17	
East Garrison Landscaping	Landscape (turf)	15.38	Acres	2.5	

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
	31.20	200.70	83.10	0.00	0.00
	12.28	23.44	42.41	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
County of Monterey	43.48	224.14	125.51	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	31.20	231.90	315.00	315.00	315.00
	12.28	35.71	78.12	78.12	78.12
	0.00	0.00	0.00	0.00	0.00
County of Monterey	43.48	267.61	393.12	393.12	393.12

County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	51.52	34.32	0.00	0.00
County of Monterey	0.00	3.24	1.49	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00

	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	51.52	85.83	85.83	85.83
	0.00	3.24	4.73	4.73	4.73
	0.00	0.00	0.00	0.00	0.00

County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00

	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00

County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	8.40	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	0.00	0.00	0.00	0.00
County of Monterey	0.00	38.45	0.00	0.00	0.00

	0.00	0.00	0.00	0.00	0.00
	0.00	8.40	8.40	8.40	8.40
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	38.45	38.45	38.45	38.45

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
CSUMB Housing	Multi family (> 15 units / acre)	764	Dwelling Units	0.25	2
CSUMB Academic and Administrative Bldgs	Office / R&D	851848	Square Feet	0.000135	2
CSUMB Landscaping	Landscape (non-turf)	32.85	Acres	2.1	2

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
CSUMB	0.00	23.75	95.25	60.00	12.00
CSUMB	0.00	13.75	41.25	48.00	12.00
CSUMB	0.00	0.00	53.97	15.02	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	23.75	119.00	179.00	191.00
	0.00	13.75	55.00	103.00	115.00
	0.00	0.00	53.97	68.99	68.99

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
UC 8th Street	Multi family (> 15 units / acre)	330	Dwelling Units	0.25	
UC East Campus - SF	SF Residential (< 5 units / acre)	200	Dwelling Units	0.5	
UC East Campus - MF	Multi family (> 15 units / acre)		Dwelling Units	0.25	
UC Eight Street	Office / R&D	196020	Square Feet	0.000135	
UC Central South Campus	Office / R&D	145764	Square Feet	0.000135	
UC Central South Campus	Other Commercial	70191	Square Feet	0.0003	
UC Central North & West Campuses	Office / R&D	691022	Square Feet	0.000135	
UC Central North & West Campuses	Retail	67270	Square Feet	0.00021	
UC Central North & West Campuses	Light Industrial	236320	Square Feet	0.00015	
UC South Campus	Retail		Square Feet	0.00021	
UC East Campus	Retail	52000	Square Feet	0.00021	
UC Eight Street	Retail	196020	Square Feet	0.00021	
UC East Campus	Hotel, Motel and Timeshares	250	Rooms	0.17	
UC Central North & West Campuses	Hotel, Motel and Timeshares	150	Rooms	0.17	

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
UCMBEST	0.00	24.75	41.25	16.50	0.00
UCMBEST	0.00	0.00	33.50	66.50	0.00
UCMBEST	0.00	0.00	0.00	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	24.75	66.00	82.50	82.50
	0.00	0.00	33.50	100.00	100.00
	0.00	0.00	0.00	0.00	0.00

UCMBEST	0.00	7.94	13.23	5.29	0.00
UCMBEST	0.00	0.00	10.93	8.75	0.00
UCMBEST	0.00	0.00	11.70	9.36	0.00
UCMBEST	0.00	30.27	44.77	18.24	0.00
UCMBEST	0.00	4.00	7.20	2.93	0.00
UCMBEST	0.00	12.18	16.53	6.73	0.00
UCMBEST	0.00	0.00	0.00	0.00	0.00
UCMBEST	0.00	0.00	5.46	5.46	0.00
UCMBEST	0.00	12.35	20.58	8.23	0.00
UCMBEST	0.00	0.00	0.00	42.50	0.00
UCMBEST	0.00	0.00	0.00	25.50	0.00

	0.00	7.94	21.17	26.46	26.46
	0.00	0.00	10.93	19.68	19.68
	0.00	0.00	11.70	21.06	21.06
	0.00	30.27	75.05	93.29	93.29
	0.00	4.00	11.19	14.13	14.13
	0.00	12.18	28.71	35.45	35.45
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	5.46	10.92	10.92
	0.00	12.35	32.93	41.16	41.16
	0.00	0.00	0.00	42.50	42.50
	0.00	0.00	0.00	25.50	25.50

Seaside	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
Residential																							
Seaside Resort Housing	SEA	Dwelling Units		2	2	2	4	6	53	53													
Seaside Housing (Eastside)	SEA	Dwelling Units																	110	110	110	110	110
Seaside Affordable Housing Obligations	SEA	Dwelling Units			36	36																	
Workforce Housing (Army to Build)	SEA	Dwelling Units							26														
Market Rate Housing (Army to Build)	SEA	Dwelling Units							150														
State Parks Housing (Workforce housing)	SEA	Dwelling Units																					
Workforce Housing (Seaside)	SEA	Dwelling Units				29		-	-														
Seaside-Fort Ord Project Area	SEA	Dwelling Units											97	100	100	100	100	100	100	100	100	100	100
Seaside Housing (Eucalyptus)	SEA	Dwelling Units														190	190	190	190	182			
Monterey Downs																							
Affordable Rentals (34 du/ac)	SEA	Dwelling Units								32	32	32	32	32	32	32	32						
Apartments (20 du/ac)	SEA	Dwelling Units								50	50	50	50	50	50	50	50						
Court Yard Homes (9 du/ac)	SEA	Dwelling Units								12	10	10	10	10	10	10	10						
Single Family Homes (9 du/ac)	SEA	Dwelling Units								100	100	100	100	100	100	100	98						
Horse Park staff	SEA	Dwelling Units										12											
Non Residential																							
Main Gate																							
Conference	SEA	Square Feet					27,000																
Spa	SEA	Square Feet						24,000															
Large Format Retail	SEA	Square Feet					87,000																
In-Line Shops	SEA	Square Feet					281,000																
Movie Theater	SEA	Square Feet					51,500																
In-Line Food Service	SEA	Square Feet					10,000																
Restaurants	SEA	Square Feet					61,000																
Landscaping	SEA	Acres						10.41															
Hotel	SEA	Rooms						250															
Seaside Resort																							
Seaside Resort Golf Buildings	SEA	Square Feet		10,000																			
Seaside Resort Golf Clubhouse	SEA	Square Feet						16,300															
Seaside Golf Course Hotel	SEA	Rooms						330															
Seaside Golf Course Timeshares	SEA	Rooms							120	50													
Monterey Downs																							
Training Track and Arena	SEA	Acres										139											
Horse Park	SEA	Acres										111											
Commercial	SEA	Square Feet								5,000	5,000	5,000	5,000	5,000	5,000								
Restaurants	SEA	Square Feet								5,000	5,000	5,000	5,000										
Retail	SEA	Square Feet								10,000	10,000	10,000	10,000	10,000	10,000	10,000	15,000						
Office	SEA	Square Feet								20,000	20,000	20,000	20,000	20,000	20,000	20,000	20,000						
Theater	SEA	Square Feet										35,000											
Hotel	SEA	Rooms										400											
Tennis and Swim Club	SEA	Square Feet										10,848	10,000										
Fire Station	SEA	Square Feet										11,000											
Landscape	SEA	Acres								8	8	8	8	8	8	8	8						
Seaside Office (Monterey Blues)	SEA	Square Feet				60,000																	
Chartwell School (existing)	SEA	Square Feet																					
Monterey College of Law (existing)	SEA	Square Feet																					
Fitch Middle School (existing)	SEA	Square Feet																					
Marshall Elementary School (existing)	SEA	Square Feet																					
International School (former Hayes Elem)(existing)	SEA	Square Feet																					
Veterans' Cemetery	SEA	Square Feet		9,000	7,500			11,200															
Monterey Peninsula Trade & Conf Cntr	SEA	Square Feet							250,000														
Seaside Corp Yard	SEA	Square Feet						25,000	27,200														
Conference Facility	SEA	Square Feet						27,000															
Luxury Auto Mall	SEA	Square Feet																					

Land Use Type	Land Use	Total	Units	Multiplier	Notes	
New Residential						
Seaside Resort Housing	SF Residential (< 5 units / acre)	122	Dwelling Units	0.5	7	
Seaside Housing (Eastside)	SF Residential (5-8 units / acre)	550	Dwelling Units	0.33		
Seaside Affordable Housing Obligations	Residential (8-15 units / acre)	72	Dwelling Units	0.25		
Workforce Housing (Army to Build)	Residential (8-15 units / acre)	26	Dwelling Units	0.25		
Market Rate Housing (Army to Build)	SF Residential (< 5 units / acre)	150	Dwelling Units	0.5		
State Parks Housing (Workforce housing)	SF Residential (5-8 units / acre)		Dwelling Units	0.33		
Workforce Housing (Seaside)	SF Residential (5-8 units / acre)	29	Dwelling Units	0.33		
Seaside-Fort Ord Project Area	Multi family (> 15 units / acre)	1097	Dwelling Units	0.25		
Seaside Housing (Eucalyptus)	SF Residential (5-8 units / acre)	942	Dwelling Units	0.33		
Monterey Downs						
Affordable Rentals (34 du/ac)	Multi family (> 15 units / acre)	256	Dwelling Units	0.25	5	
Apartments (20 du/ac)	Multi family (> 15 units / acre)	400	Dwelling Units	0.25	5	
Court Yard Homes (9 du/ac)	Residential (8-15 units / acre)	82	Dwelling Units	0.25	5	
Single Family Homes (9 du/ac)	Residential (8-15 units / acre)	798	Dwelling Units	0.25	5	
Horse Park staff	Residential (8-15 units / acre)	12	Dwelling Units	0.25	5	
Main Gate Conference	Office / R&D	27000	Square Feet	0.000135	1	
Main Gate Spa	Other Commercial	24000	Square Feet	0.0003		
Main Gate Large Format Retail	Retail	87000	Square Feet	0.00005		
Main Gate In-Line Shops	Retail	281000	Square Feet	0.00005		
Main Gate Movie Theater	Other Commercial	51500	Square Feet	0.0002		
Main Gate In-Line Food Service	Restaurant	10000	Square Feet	0.00247		
Main Gate Restaurants	Restaurant	61000	Square Feet	0.0011		
Main Gate Landscaping	Landscape (turf)	10.41	Acres	2.5		
Main Gate Hotel	Hotel, Motel and Timeshares	250	Rooms	0.17		
Seaside Resort Golf Buildings	Office / R&D	10000	Square Feet	0.000135	5	
Seaside Resort Golf Clubhouse	Restaurant	16300	Square Feet	0.00145		
Seaside Golf Course Hotel	Hotel, Motel and Timeshares	330	Rooms	0.17		
Seaside Golf Course Timeshares	Hotel, Motel and Timeshares	170	Rooms	0.17		
Monterey Downs						
Training Track and Arena	Various	138.7	Acres	0.7859		
Horse Park	Various	110.7	Acres	1.1462		
Commercial	Other Commercial	30000	Square Feet	0.0003		
Restaurants	Restaurant	20000	Square Feet	0.00145		
Retail	Retail	85000	Square Feet	0.00021		
Office	Office / R&D	160000	Square Feet	0.000135		
Theater	Other	35000	Square Feet	0.00004		
Hotel	Hotel, Motel and Timeshares	400	Rooms	0.17		
Tennis and Swim Club	Various	20848	Square Feet	0.000190		
Fire Station	Governmental	11000	Square Feet	0.0003		
Landscape	Landscape (non-turf)	64	Acres	2.1		
Seaside Office (Monterey Blues)	Office / R&D	60000	Square Feet	0.000135	1	
Chartwell School	Schools (K-12)		Square Feet	0.0003		
Monterey College of Law	Institutional		Square Feet	0.0003		
Fitch Middle School	Schools (K-12)		Square Feet	0.0003		
Marshall Elementary School	Schools (K-12)		Square Feet	0.0003		
International School (former Hayes Elem)	Schools (K-12)		Square Feet	0.0003		
Veterans' Cemetery	Various	27700	Square Feet	0.000141		
Monterey Peninsula Trade & Conf Cntr	Office / R&D	250000	Square Feet	0.000135		
Seaside Corp Yard	Various	52200	Square Feet	0.00015709		
Conference Facility	Office / R&D	27000	Square Feet	0.0002		
Luxury Auto Mall	Retail		Square Feet	0.00021		

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
City of Seaside	0.00	8.00	53.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	181.50
City of Seaside	0.00	18.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	6.50	0.00	0.00
City of Seaside	0.00	0.00	75.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	9.57	0.00	0.00	0.00
City of Seaside	0	0.00	24.25	125.00	125.00
City of Seaside	0.00	0.00	0.00	188.10	122.76
City of Seaside	0.00	0.00	32.00	32.00	0.00
City of Seaside	0.00	0.00	50.00	50.00	0.00
City of Seaside	0.00	0.00	10.50	10.00	0.00
City of Seaside	0.00	0.00	100.00	99.50	0.00
City of Seaside	0.00	0.00	3.00	0.00	0.00

City of Seaside	0.00	3.65	0.00	0.00	0.00
City of Seaside	0.00	7.20	0.00	0.00	0.00
City of Seaside	0.00	4.35	0.00	0.00	0.00
City of Seaside	0.00	14.05	0.00	0.00	0.00
City of Seaside	0.00	11.20	0.00	0.00	0.00
City of Seaside	0.00	24.70	0.00	0.00	0.00
City of Seaside	0.00	68.60	0.00	0.00	0.00
City of Seaside	0.00	26.03	0.00	0.00	0.00
City of Seaside	0.00	42.50	0.00	0.00	0.00
City of Seaside	0.00	1.35	0.00	0.00	0.00
City of Seaside	0.00	23.64	0.00	0.00	0.00
City of Seaside	0.00	56.10	0.00	0.00	0.00
City of Seaside	0.00	0.00	28.90	0.00	0.00
City of Seaside	0.00	0.00	109.00	0.00	0.00
City of Seaside	0.00	0.00	126.88	0.00	0.00
City of Seaside	0.00	0.00	6.00	3.00	0.00
City of Seaside	0.00	0.00	29.00	0.00	0.00
City of Seaside	0.00	0.00	8.40	9.45	0.00
City of Seaside	0.00	0.00	10.80	10.80	0.00
City of Seaside	0.00	0.00	1.40	0.00	0.00
City of Seaside	0.00	0.00	68.00	0.00	0.00
City of Seaside	0.00	0.00	3.95	0.00	0.00
City of Seaside	0.00	0.00	3.30	0.00	0.00
City of Seaside	0.00	0.00	67.20	67.20	0.00
City of Seaside	0.00	8.10	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00
City of Seaside	0.00	3.90	0.00	0.00	0.00
City of Seaside	0.00	0.00	33.75	0.00	0.00
City of Seaside	0.00	3.93	4.27	0.00	0.00
City of Seaside	0.00	5.40	0.00	0.00	0.00
City of Seaside	0.00	0.00	0.00	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	8.00	61.00	61.00	61.00
	0.00	0.00	0.00	0.00	181.50
	0.00	18.00	18.00	18.00	18.00
	0.00	0.00	6.50	6.50	6.50
	0.00	0.00	75.00	75.00	75.00
	0.00	0.00	0.00	0.00	0.00
	0.00	9.57	9.57	9.57	9.57
	0.00	0.00	24.25	149.25	274.25
	0.00	0.00	0.00	188.10	310.86
	0.00	0.00	32.00	64.00	64.00
	0.00	0.00	50.00	100.00	100.00
	0.00	0.00	10.50	20.50	20.50
	0.00	0.00	100.00	199.50	199.50
	0.00	0.00	3.00	3.00	3.00

	0.00	3.65	3.65	3.65	3.65
	0.00	7.20	7.20	7.20	7.20
	0.00	4.35	4.35	4.35	4.35
	0.00	14.05	14.05	14.05	14.05
	0.00	11.20	11.20	11.20	11.20
	0.00	24.70	24.70	24.70	24.70
	0.00	68.60	68.60	68.60	68.60
	0.00	26.03	26.03	26.03	26.03
	0.00	42.50	42.50	42.50	42.50
	0.00	1.35	1.35	1.35	1.35
	0.00	23.64	23.64	23.64	23.64
	0.00	56.10	56.10	56.10	56.10
	0.00	0.00	28.90	28.90	28.90
	0.00	0.00	109.00	109.00	109.00
	0.00	0.00	126.88	126.88	126.88
	0.00	0.00	6.00	9.00	9.00
	0.00	0.00	29.00	29.00	29.00
	0.00	0.00	8.40	17.85	17.85
	0.00	0.00	10.80	21.60	21.60
	0.00	0.00	1.40	1.40	1.40
	0.00	0.00	68.00	68.00	68.00
	0.00	0.00	3.95	3.95	3.95
	0.00	0.00	3.30	3.30	3.30
	0.00	0.00	67.20	134.40	134.40
	0.00	8.10	8.10	8.10	8.10
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
	0.00	3.90	3.90	3.90	3.90
	0.00	0.00	33.75	33.75	33.75
	0.00	3.93	8.20	8.20	8.20
	0.00	5.40	5.40	5.40	5.40
	0.00	0.00	0.00	0.00	0.00

Del Rey Oaks	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																							
Del Rey Oaks																							
Golf Villas	DRO	Dwelling Units						37	13														
Patio Homes	DRO	Dwelling Units						32	4														
Condos	DRO	Dwelling Units						40	160	176													
Workforce	DRO	Dwelling Units							70	68													
Townhomes/Senior Casitas	DRO	Dwelling Units						21	40	30													
RV Resort (Manager)	DRO	Dwelling Units																					
Non Residential																							
Del Rey Oaks Office	DRO	Square Feet				100,000	100,000	100,000	100,000														
Del Rey Oaks Retail	DRO	Square Feet				5,000																	
Del Rey Oaks Hotel	DRO	Rooms				104	250	100															
Del Rey Oaks Timeshare	DRO	Rooms				48	48																
Resort Golf Course	DRO	Acres									92												
RV Resort	DRO	Square Feet																					

Monterey City	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
Non Residential																							
Monterey City Office	MRY	Square Feet								721,524													
Industrial -- City Corp. Yard	MRY	Square Feet								100,000													
Industrial -- Public/Private	MRY	Square Feet								116,275													

US Army	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
Residential																							
Doe Park (Stilwell) Single Family	ARMY	Dwelling Units	20		28																		
Doe Park (Stilwell) Duplex	ARMY	Dwelling Units	20		27																		
Non Residential																							
Recreation Center	ARMY	Square Feet							8,340														
VA Medical Clinic (part of Marina - UV Area OP)	ARMY	Square Feet								24,000													
Child Development Center	ARMY	Square Feet																					
Emergency Services Center	ARMY	Square Feet				40,000																	

CA State Parks	Jurisd	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
Non Residential																							
Fort Ord Dunes State Park	SP																						
Fort Ord Dunes State Park	SP	Square feet						75,000				33,333						16667					41667
American Youth Hostel (Seaside)	SP	Units			18					12	2												

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Del Rey Oaks					
Golf Villas	SF Residential (< 5 units / acre)	50	Dwelling Units	0.5	
Patio Homes	SF Residential (< 5 units / acre)	36	Dwelling Units	0.5	
Condos	Multi family (> 15 units / acre)	376	Dwelling Units	0.25	
Workforce	Multi family (> 15 units / acre)	138	Dwelling Units	0.25	
Townhomes/Senior Casitas	SF Residential (5-8 units / acre)	91	Dwelling Units	0.33	
RV Resort (Manager)	Residential (8-15 units / acre)		Dwelling Units	0.25	
Del Rey Oaks Office	Office / R&D	400000	Square Feet	0.000135	
Del Rey Oaks Retail	Retail	5000	Square Feet	0.00021	
Del Rey Oaks Hotel	Hotel, Motel and Timeshares	454	Rooms	0.17	
Del Rey Oaks Timeshare	Hotel, Motel and Timeshares	96	Rooms	0.17	
Resort Golf Course	Landscape (turf)	92.4	Acres	2.16991342	1
RV Resort	Other Commercial		Square Feet	0.0003	1

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	18.50	6.50	0.00	0.00
	0.00	16.00	2.00	0.00	0.00
	0.00	10.00	84.00	0.00	0.00
	0.00	0.00	34.50	0.00	0.00
	0.00	6.93	23.10	0.00	0.00
	0.00	0.00	0.00	0.00	0.00
Del Rey Oaks	0.00	51.43	150.10	0.00	0.00
Del Rey Oaks	0.00	40.50	13.50	0.00	0.00
Del Rey Oaks	-	1.05	0.00	0.00	0.00
Del Rey Oaks	-	77.18	0.00	0.00	0.00
Del Rey Oaks	0.00	16.32	0.00	0.00	0.00
Del Rey Oaks	0.00	0.00	200.50	0.00	0.00
Del Rey Oaks	0.00	0.00	0.00	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	18.50	25.00	25.00	25.00
	0.00	16.00	18.00	18.00	18.00
	0.00	10.00	94.00	94.00	94.00
	0.00	0.00	34.50	34.50	34.50
	0.00	6.93	30.03	30.03	30.03
	0.00	0.00	0.00	0.00	0.00
Del Rey Oaks	0.00	51.43	201.53	201.53	201.53
	0.00	40.50	54.00	54.00	54.00
	0.00	1.05	1.05	1.05	1.05
	0.00	77.18	77.18	77.18	77.18
	0.00	16.32	16.32	16.32	16.32
	0.00	0.00	200.50	200.50	200.50
	0.00	0.00	0.00	0.00	0.00

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Monterey City Office	Office / R&D	721524	Square Feet	0.000135	
Industrial -- City Corp. Yard	Light Industrial	100000	Square Feet	0.00015	
Industrial -- Public/Private	Light Industrial	116275	Square Feet	0.00015	

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
City of Monterey	0.00	0.00	97.41	0.00	0.00
City of Monterey	0.00	0.00	15.00	0.00	0.00
City of Monterey	0.00	0.00	17.44	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	0.00	97.41	97.41	97.41
	0.00	0.00	15.00	15.00	15.00
	0.00	0.00	17.44	17.44	17.44

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Doe Park (Stilwell) Single Family	SF Residential (5-8 units / acre)	28	Dwelling Units	0.33	4
Doe Park (Stilwell) Duplex	Residential (8-15 units / acre)	27	Dwelling Units	0.33	4
Non Residential					
Recreation Center	Institutional	8340	Square Feet	0.0003	
VA Medical Clinic	Institutional		Square Feet	0.00018	1
Child Development Center	Institutional	24000	Square Feet	0.0072	1
Emergency Services Center	Governmental	40000	Square Feet	0.0003	

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
U.S. Army	6.60	9.24	-6.60	0.00	0.00
U.S. Army	6.60	8.91	-6.60	0.00	0.00
U.S. Army	0.00	0.00	2.50	0.00	0.00
U.S. Army	0.00	0.00	0.00	0.00	0.00
U.S. Army	0.00	0.00	172.80	0.00	0.00
U.S. Army	0.00	12.00	0.00	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	6.60	15.84	9.24	9.24	9.24
	6.60	15.51	8.91	8.91	8.91
	0.00	0.00	2.50	2.50	2.50
	0.00	0.00	0.00	0.00	0.00
	0.00	0.00	172.80	172.80	172.80
	0.00	12.00	12.00	12.00	12.00

Land Use Type	Land Use	Total	Units	Multiplier	Notes
New Residential					
Fort Ord Dunes State Park	Governmental			0.0676	
Fort Ord Dunes State Park	Governmental	166667	Square Feet	0.00012	
American Youth Hostel (Seaside)	Hotel, Motel and Timeshares	32	Units	0.17	

	Incremental Demand (AFY)				
	2015	2020	2025	2030	2035
State Parks and Rec.	0.00	0.00	0.00	0.00	0.00
State Parks and Rec.	0.00	9.00	4.00	2.00	5.00
State Parks and Rec.	0.00	3.06	2.38	0.00	0.00

	Cumulative Demand (AFY)				
	2015	2020	2025	2030	2035
	0.00	0.00	0.00	0.00	0.00
	0.00	9.00	13.00	15.00	20.00
	0.00	3.06	5.44	5.44	5.44

NOTES:

- 1 Unique water demand multiplier based on the quantity of units (square feet, acres, dwelling units) and total expected water demand, from Water Supply Assessment.
- 2 Derived from Table 4-1 of the CSUMB Master Plan (December 2007)
- 3 Horse Park projections moved to Monterey Downs Specific Plan (Seaside)
- 4 OMC housing is being renovated and replaced. The entry in 2022 reflects the net removal of 40 DU over the project life.
- 5 Monterey Downs WSA adopted in 2012. Specific Plan is still pending approval.
- 6 Per Marina 2009 Certified Housing Element, Table 3-1
- 7 Projections taken from Seaside-Fort Ord Redevelopment Project Area Implementation Plan 2007-2012
- 8 Whispering Oaks Specific Plan revoked by County, 2012.
- 9 Draft Marina DVSP projects build-out by 2040. Annual values reflect 1/30th of total. 2040 totals will be 2,400 DU; 126,000 SF Office; 254,000 SF Commercial; 1.2 AC Landscape.

Marina Coast Water District 2015 Urban Water Management Plan

Table C4: 2015 Population Growth by Jurisdiction

Jurisdiction		Existing*	2015	2020	2025	2030	2035
Ord	U.S. Army		0	285	165	165	165
	CSUMB		0	285	1,428	2,148	2,292
	Del Rey Oaks		0	340	1,487	1,487	1,487
	City of Monterey		0	0	0	0	0
	County of Monterey		741	1,979	3,015	3,015	3,015
	UCMBEST		0	257	861	1,378	1,378
	City of Seaside		0	351	3,642	8,958	13,224
	State Parks and Rec.		0	0	0	0	0
	Marina Ord Comm.		285	4,551	7,901	8,219	8,219
	Assumed Line Loss						
Marina	Armstrong Ranch		0	0	4,085	4,085	4,085
	RMC Lonestar		0	0	0	0	0
	Marina Central		582	1,649	3,298	4,414	5,530
Subtotal - Ord		13,646	14,672	21,694	32,144	39,015	43,425
Subtotal - Marina		17,121	17,703	18,770	24,504	25,620	26,736
Total		30,767	32,375	40,464	56,648	64,635	70,161

*2012 DOF hybrid population

Note: The existing (current) population is aggregated by service area (Ord and Marina) and not shown by jurisdiction.

This page is intentionally blank.

Marina Coast Water District 2015 Urban Water Management Plan
 Table C5: Population Growth Projection Details

Marina Ord	Jurisd	Land Use	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35
New Residential																								
Marina Heights																								
Townhome	MAR	Residential (8-15 units / acre)	Dwelling Units			0	0	12	13	13	13	13	13	13	12									
Cluster Market/Bridge	MAR	Residential (8-15 units / acre)	Dwelling Units			4	5	47	19	19	19	19	19	19	18									
Market A	MAR	SF Residential (5-8 units / acre)	Dwelling Units			10	15	105	29	29	29	29	29	29	33									
Market B	MAR	SF Residential (5-8 units / acre)	Dwelling Units			6	10	85	34	34	34	34	34	34	33									
Estates	MAR	SF Residential (< 5 units / acre)	Dwelling Units		0	0	0	0	13	12	12	12	12	12	12	0								
Cypress Knolls																								
SF Home / Townhome	MAR	SF Residential (5-8 units / acre)	Dwelling Units								255	200		141										
Apartments	MAR	Multi family (> 15 units / acre)	Dwelling Units								85			31										
Assisted Living	MAR	Multi family (> 15 units / acre)	Dwelling Units											60										
Dunes on Monterey Bay																								
Alley (small lot)	MAR	Residential (8-15 units / acre)	Dwelling Units		20	24	48	54	59	37														
Carriage	MAR	Residential (8-15 units / acre)	Dwelling Units		10	21	6	12	30	47														
Standard	MAR	SF Residential (5-8 units / acre)	Dwelling Units	23	10	12	20	44	6															
Standard (small lot)	MAR	Residential (8-15 units / acre)	Dwelling Units		20	15	25	48	23															
Duets	MAR	SF Residential (5-8 units / acre)	Dwelling Units			34	38	78	98	40	60	4												
Townhome (live-work)	MAR	Residential (8-15 units / acre)	Dwelling Units			16	52	50	21															
Townhome (mixed use)	MAR	Residential (8-15 units / acre)	Dwelling Units			4	8	8	4															
Apartments (completed)	MAR	Multi family (> 15 units / acre)	Dwelling Units	108																				
Promontory																								
TAMC TOD	MAR	Multi family (> 15 units / acre)	Dwelling Units		176																			
Existing/Replacement Residential																								
Patton Park (complete)	MAR	Residential (8-15 units / acre)	Dwelling Units																					
Shelter Outreach Plus (complete)	MAR	Residential (8-15 units / acre)	Dwelling Units																					
Interim Housing (complete)	MAR	Residential (8-15 units / acre)	Dwelling Units																					
Armstrong Ranch																								
New Residential																								
Marina Station																								
Single Family Homes (15,000)	MAR	SF Residential (< 5 units / acre)	Dwelling Units								23	87	37											
Single Family Homes (6,500)	MAR	SF Residential (5-8 units / acre)	Dwelling Units								100	250	220	99										
Apartments	MAR	Multi family (> 15 units / acre)	Dwelling Units								100	250	220	78										
Marina Central																								
New Residential																								
In-Fill Development MF	MAR	Multi family (> 15 units / acre)	Dwelling Units						182					167										
In-Fill Development SF	MAR	SF Residential (5-8 units / acre)	Dwelling Units						9					24										
Downtown Specific Plan	MAR	Multi family (> 15 units / acre)	Dwelling Units		80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80	80

Marina Ord	
New Residential	
Marina Heights	
Townhome	
Cluster Market/Bridge	
Market A	
Market B	
Estates	
Cypress Knolls	
SF Home / Townhome	
Apartments	
Assisted Living	
Dunes on Monterey Bay	
Alley (small lot)	
Carriage	
Standard	
Standard (small lot)	
Duets	
Townhome (live-work)	
Townhome (mixed use)	
Apartments (completed)	
Promontory	
TAMC TOD	
Existing/Replacement Residential	
Patton Park (complete)	
Shelter Outreach Plus (complete)	
Interim Housing (complete)	
Armstrong Ranch	
New Residential	
Marina Station	
Single Family Homes (15,000)	
Single Family Homes (6,500)	
Apartments	
Marina Central	
New Residential	
In-Fill Development MF	
In-Fill Development SF	
Downtown Specific Plan	

Multiplier
Marina Heights
1.5
3.0
3.0
3.0
4.0
Cypress Knolls
1.8
2.4
1.0
Dunes (UV)
2.0
3.0
3.0
3.0
1.5
1.5
1.5
2.0
Existing
2.6
2.6
2.6
Marina Station
2.8
2.8
2.8
Marina Central
2.8
2.8
2.8

Incremental Increase (Persons)					
2015	2020	2025	2030	2035	
0	37.5	97.5	18	0	
0	225	285	54	0	
0	477	435	99	0	
0	405	510	99	0	
0	52	240	48	0	
0	1196.5	1567.5	318	0	
0	0	1072.8	0	0	
0	0	278.4	0	0	
0	0	60	0	0	
0	0	1411.2	0	0	
0	410	74	0	0	
0	237	141	0	0	
69	276	0	0	0	
0	393	0	0	0	
0	372	156	0	0	
0	208.5	0	0	0	
0	36	0	0	0	
216	0	0	0	0	
0	579	0	0	0	
0	558	0	0	0	
285	3069.5	371	0	0	
0	0	0	0	0	
0	0	0	0	0	
0	0	0	0	0	
0	0	0	0	0	
2015	2020	2025	2030	2035	
0	0	410	0	0	
0	0	1867	0	0	
0	0	1808	0	0	
0	0	4085	0	0	
0	508	466	0	0	
0	25	67	0	0	
0	1116	1116	1116	1116	
0	1649	1649	1116	1116	

Cumulative Increase (Persons)					
2015	2020	2025	2030	2035	
0	37.5	135	153	153	
0	225	510	564	564	
0	477	912	1011	1011	
0	405	915	1014	1014	
0	52	292	340	340	
0	1196.5	2764	3082	3082	
0	0	1072.8	1072.8	1072.8	
0	0	278.4	278.4	278.4	
0	0	60	60	60	
0	0	1411.2	1411.2	1411.2	
0	410	484	484	484	
0	237	378	378	378	
69	345	345	345	345	
0	393	393	393	393	
0	372	528	528	528	
0	208.5	208.5	208.5	208.5	
0	36	36	36	36	
216	216	216	216	216	
0	579	579	579	579	
0	558	558	558	558	
285	3354.5	3725.5	3725.5	3725.5	
0	0	0	0	0	
0	0	0	0	0	
0	0	0	0	0	
0	0	0	0	0	
2015	2020	2025	2030	2035	
0	0	410	410	410	
0	0	1867	1867	1867	
0	0	1808	1808	1808	
0	0	4085	4085	4085	
0	508	974	974	974	
0	25	92	92	92	
0	1116	2232	3348	4464	
0	1649	3298	4414	5530	

Incremental Increase (EDU)					
2015	2020	2025	2030	2035	
	25	65	12	0	
	75	95	18	0	
	159	145	33	0	
	135	170	33	0	
	13	60	12	0	
0	407	535	108	0	
	0	596	0	0	
	0	116	0	0	
	0	60	0	0	
0	0	772	0	0	
	205	37	0	0	
	79	47	0	0	
23	92	0	0	0	
	131	0	0	0	
	248	104	0	0	
	139	0	0	0	
	24	0	0	0	
108	0	0	0	0	
	176	0	0	0	
	200	0	0	0	
131	1294	188	0	0	
	0	0	0	0	
	0	0	0	0	
	0	0	0	0	
0	0	0	0	0	
2015	2020	2025	2030	2035	
	0	147	0	0	
	0	669	0	0	
	0	648	0	0	
0	0	1464	0	0	
	182	167	0	0	
	9	24	0	0	
	400	400	400	400	
0	591	591	400	400	

Marina Coast Water District 2015 Urban Water Management Plan
Table C5: Population Growth Projection Details

Monterey County	Jurisd	Land Use	Units	2012-15	2015-16	2016-17	2017-18	2018-19	2019-20	2020-21	2021-22	2022-23	2023-24	2024-25	2025-26	2026-27	2027-28	2028-29	2029-30	2031-31	2031-32	2032-33	2033-34	2034-35	
New Residential																									
East Garrison I																									
Market Rate	MCO	SF Residential (< 5 units / acre)	Dwelling Units	104	149	160	140	120	100	100	100	77													
Affordable	MCO	SF Residential (5-8 units / acre)	Dwelling Units	66	0	0	8	43	75	100	105	23													
Monterey Horse Park (see City of Seaside)	MCO	SF Residential (5-8 units / acre)	Dwelling Units																						
CSUMB																									
New Residential																									
CSUMB Housing	CSU/MAR	Multi family (> 15 units / acre)	Dwelling Units						95	95	95	95	48	48	48	48	48	48	48	48					
UCMBEST																									
New Residential																									
UC 8th Street	UC/MCO	Multi family (> 15 units / acre)	Dwelling Units				33	33	33	33	33	33	33	33	33	33									
UC East Campus - SF	UC/MCO	SF Residential (< 5 units / acre)	Dwelling Units							67					67	66									
UC East Campus - MF	UC/MCO	Multi family (> 15 units / acre)	Dwelling Units																						
Seaside																									
Residential																									
Seaside Resort Housing	SEA	SF Residential (< 5 units / acre)	Dwelling Units		2	2	2	4	6	53	53														
Seaside Housing (Eastside)	SEA	SF Residential (5-8 units / acre)	Dwelling Units																	110	110	110	110	110	
Seaside Affordable Housing Obligations	SEA	Residential (8-15 units / acre)	Dwelling Units			36	36																		
Workforce Housing (Army to Build)	SEA	Residential (8-15 units / acre)	Dwelling Units							26															
Market Rate Housing (Army to Build)	SEA	SF Residential (< 5 units / acre)	Dwelling Units							150															
State Parks Housing (Workforce housing)	SEA	SF Residential (5-8 units / acre)	Dwelling Units																						
Workforce Housing (Seaside)	SEA	SF Residential (5-8 units / acre)	Dwelling Units				29		0	0															
Seaside-Fort Ord Project Area	SEA	Multi family (> 15 units / acre)	Dwelling Units										97	100	100	100	100	100	100	100	100	100	100	100	100
Seaside Housing (Eucalyptus)	SEA	SF Residential (5-8 units / acre)	Dwelling Units														190	190	190	190	182				
Monterey Downs																									
Affordable Rentals (34 du/ac)	SEA	Multi family (> 15 units / acre)	Dwelling Units								32	32	32	32	32	32	32	32	32						
Apartments (20 du/ac)	SEA	Multi family (> 15 units / acre)	Dwelling Units								50	50	50	50	50	50	50	50	50						
Court Yard Homes (9 du/ac)	SEA	Residential (8-15 units / acre)	Dwelling Units								12	10	10	10	10	10	10	10	10						
Single Family Homes (9 du/ac)	SEA	Residential (8-15 units / acre)	Dwelling Units								100	100	100	100	100	100	100	98							
Horse Park staff	SEA	Residential (8-15 units / acre)	Dwelling Units										12												
Del Rey Oaks																									
New Residential																									
Del Rey Oaks																									
Golf Villas	DRO	SF Residential (< 5 units / acre)	Dwelling Units						37	13															
Patio Homes	DRO	SF Residential (< 5 units / acre)	Dwelling Units						32	4															
Condos	DRO	Multi family (> 15 units / acre)	Dwelling Units						40	160	176														
Workforce	DRO	Multi family (> 15 units / acre)	Dwelling Units							70	68														
Townhomes/Senior Casitas	DRO	SF Residential (5-8 units / acre)	Dwelling Units						21	40	30														
RV Resort (Manager)	DRO	Residential (8-15 units / acre)	Dwelling Units																						
US Army																									
Residential																									
Doe Park (Stilwell) Single Family	ARMY	SF Residential (5-8 units / acre)	Dwelling Units	20		28																			
Doe Park (Stilwell) Duplex	ARMY	Residential (8-15 units / acre)	Dwelling Units	20		27																			

Marina Coast Water District 2015 Urban Water Management Plan

Table C6: Projected Demands by Source, with Planned Recycled Use (AFY)

Total Demands by Jurisdiction		2015	2020	2025	2030	2035	SVGB Allocation	RW Allocation
Ord	U.S. Army	633	663	825	825	825	1,577	
	CSUMB	404	442	632	755	779	1,035	87
	Del Rey Oaks	0	186	551	551	551	243	280
	City of Monterey	0	0	130	130	130	65	
	County of Monterey	52	377	539	539	539	710	134
	UCMBEST	3	94	299	515	515	230	60
	City of Seaside	657	997	1,852	2,447	2,876	1,012	453
	State Parks and Rec.	0	12	18	20	25	45	
	Marina Ord Comm.	285	901	1,572	1,702	1,704	1,325	345
	Assumed Line Loss	348	348	348	348	348	348	68
Marina	Armstrong Ranch	0	0	680	680	680	920	
	RMC Lonestar	0	0	0	0	500	500	
	Marina Central	1,823	2,184	2,491	2,606	2,725	3,020	
	Subtotal - Ord	2,382	4,021	6,766	7,833	8,293	6,600	1,427
	Subtotal - Marina	1,823	2,184	3,171	3,286	3,905	4,440	0
Total	4,204	6,205	9,937	11,119	12,197	11,040	1,427	

Recycled Water Demand (1,2)

U.S. Army	0	0	0	0	0
CSUMB	0	0	87	87	87
Del Rey Oaks	0	0	280	280	280
City of Monterey	0	0	0	0	0
County of Monterey	0	0	134	134	134
UCMBEST	0	0	60	60	60
City of Seaside	0	400	453	453	453
State Parks and Rec.	0	0	0	0	0
Marina Ord Comm.	0	200	345	345	345
Assumed Line Loss					
Armstrong Ranch	0	0	0	0	0
RMC Lonestar	0	0	0	0	0
Marina Central	0	0	0	0	0

RW BODR Demands

Phase 1	Phase 2
	38
202	109
338	
47	614
55	
806	140
435	5
	391
52	87

Groundwater Demand (3)

U.S. Army	633	663	825	825	825
CSUMB	404	442	545	668	692
Del Rey Oaks	0	186	243	243	243
City of Monterey	0	0	65	65	65
County of Monterey	52	377	405	405	405
UCMBEST	3	94	230	230	230
City of Seaside	657	597	1,012	1,012	1,012
State Parks and Rec.	0	12	18	20	25
Marina Ord Comm.	285	701	1,227	1,325	1,325
Assumed Line Loss	348	348	348	348	348
Armstrong Ranch	0	0	680	680	680
RMC Lonestar	0	0	0	0	500
Marina Central	1,823	2,184	2,491	2,606	2,725

Remaining GW

752
343
0
0
305
0
0
20
0
0
240
0
295

1,955 total unused

Demand by Source	2015	2020	2025	2030	2035
Groundwater	4,204	5,605	8,089	8,428	9,075
Recycled Water	0	600	1,359	1,359	1,359
Desalinated Water (4)	0	0	489	1,332	1,763

Notes:

- 1 2020 value = maximum of Phase 1 allocation or BODR Phase 1 existing demand
- 2 Assumes only Recycled Phase 1 occurs
- 3 Maximum of projected potable demand or SVGB allocation
- 4 Desalinated demand is total minus groundwater and recycled

This page is intentionally blank.

Appendix D: Notices and Letters to Public Agencies

The following notices and mailings were prepared during the development of this Urban Water Management Plan, and are included in this appendix.

1. Demand Projection Review to Cities, dated October 30, 2015 (sample letter and mailing list)
2. 60-day Notice to Cities and Agencies, dated February 10, 2016 (sample letter and mailing list)
3. Notice of plan availability for review, MCWD Website, www.mcwd.org
4. Newspaper Notices for Public Hearing, dated May 22 and May 29, 2016
5. Transmittal of Draft Plan to Cities and Agencies, dated May 20, 2016 (sample letter, same mailing list as item 2)
6. Transmittal of additional tech memo to Cities and Agencies, dated May 27, 2016 (sample letter, same mailing list as item 2)
7. MCWD Board Agenda and Staff Report for Public Hearing, June 6, 2016 meeting



James R. Schaaf, Ph. D, PE
Kirk R. Wheeler, PE
Peder C. Jorgensen, PE
Charles D. Anderson, PE
Daniel J. Schaaf, PE

3 Quail Run Circle, Suite 101
Salinas, CA 93907
831-883-4848
FAX 831-758-6328

M. Eliza McNulty, PE
Benjamin L. Shick, PE
Leif M. Coponen, PE
Principal Emeritus
David A. Foote, PE

October 30, 2015

Ms. Theresa Symansis
City of Marina, Director of Community Development
209 Cypress Avenue
Marina, CA 93933

Subject: Marina Coast Water District Urban Water Management Plan 2015 Update

Dear Ms. Symansis

Schaaf & Wheeler is preparing the Marina Coast Water District's 2015 Urban Water Management Plan (UWMP). These plans are prepared by water suppliers every five years. Existing and projected water demands are compared to existing and planned water supplies to ensure there is sufficient supply available. A preliminary task in this effort is to coordinate with the District's customer jurisdictions to determine projected population and water demands. The 2015 UWMP will need to account for existing and forecasted water demands by five-year increments through the year 2035.

Water demands are generally a function of the size (acreage/square footage) or number of units of a development, depending on the type of land use, and a water demand unit factor that corresponds to that use. For each type of land use, Demand = Size x Unit Factor. Using this concept, Schaaf & Wheeler has prepared a preliminary estimate of water demands by land use type and by jurisdiction through 2035 as follows:

- Existing demands are estimated from the District's 2014 water usage records for each jurisdictional area. (Potential future water savings through conservation will be accounted for in the UWMP.)
- For developments that have approved Specific Plans, the water demand factors and total water demand estimates have been taken from the respective Water Supply Assessments (WSAs) for these Specific Plan areas.
- For in-fill development under approved General Plans or Master Plans (e.g., the City of Marina, CSUMB), the District's standard water demand factors have been used with the in-fill land use projections provided by the jurisdiction.
- For most future development within the District's planning area, including all planned Fort Ord development through 2022, we have acquired the Fort Ord Reuse Authority's (FORA) latest annual growth forecast, which they use for CIP planning. The projected developments, generally by square footage or units, are then multiplied by the appropriate unit demand factors.

- For areas not reflected in the Fort Ord Reuse Authority growth forecast (Central Marina, the Army and State Parks), the projected developments reflect the projection in the 2010 UWMP.

You will find attached to this letter several tables detailing the estimates of existing and projected water usage. The summary table categorizes demand estimates by jurisdiction. The 2010 demand summary is provided for reference. The more detailed tables for each jurisdiction show the projected development over the next 20-years, categorized by three types of land use: New Residential, Replacement of Existing Residential, and Non-Residential.

Please have the appropriate staff member(s) review the projected development for your jurisdiction, and report any discrepancies to us.

Note that the FORA growth forecast only looks at planned development through the year 2022, while the UWMP must project demands through 2035. If a specific plan area was not fully reflected in the FORA forecast, you will need to add the remainder of that development in the 2023-2035 columns. Please pay careful attention to the projected development in years 2025 and later since those in particular may be underestimated. For the City of Marina, please confirm the development schedule for Cypress Knolls and SVMH in the Ord Community. Also, the Central Marina projection includes the Downtown Vitalization Specific Plan, which was not formally adopted. Those infill projections may need to be reduced.

The 2015 UWMP is projected to be completed in June 2016, pending the California Department of Water Resources release of updated guidance on UWMP preparation. We would appreciate your prompt review of and feedback on the projected water use figures. Even if no discrepancies are noted, please respond within sixty (60) days so that the UWMP preparation can proceed as scheduled.

Feel free to contact either myself or Andrew Racz of our office at 831-883-4848, email asterbenz@swsv.com, for any questions regarding this matter. Thank you for your cooperation.

Sincerely,

Schaaf & Wheeler

Andrew Sterbenz, PE

Project Engineer

Attachments

Urban Water Management Plan – Jurisdictional POC’s

City of Marina	<p>Theresa Symansis City of Marina, Director of Community Development 209 Cypress Avenue Marina, CA 93933 Phone: (831) 884-1289 Fax: (831) 384-0425</p> <p>Alternate POC: Layne Long, City Manager</p>
City of Seaside	<p>Diana Ingersoll, PE City of Seaside, Deputy City Manager 440 Harcourt Ave. Seaside, CA 93955 (831) 899-6736</p> <p>Alternate POC: Tim O’Halloran, PE</p>
City of Del Rey Oaks	<p>Daniel Dawson City of Del Rey Oaks, City Manager 650 Canyon Del Rey Road Del Rey Oaks, CA 93940 Phone: 831-394-8511 Fax: 831-394-6421</p> <p>Alternate POC:</p>
City of Monterey	<p>Kim Cole, Principal Planner City of Monterey, Planning Office 570 Pacific Street Monterey, CA 93940 831.646.3885 Fax: 831.646.3408 Cole@ci.monterey.ca.us Alternate POC: Elizabeth Caraker, Principal Planner</p>
County of Monterey	<p>Michael Novo County of Monterey, Resource Management Agency, Planning Services 168 West Alisal St., 3rd Floor Salinas, CA 93901 Phone (831) 755-5390 Fax (831) 755-5398 novom@co.monterey.ca.us Alternate POC: Melanie Beretti</p>
CSUMB	<p>Kathleen Ventimiglia CSUMB, Director for Campus Planning and Development 100 Campus Center, CSU Monterey Bay Seaside CA 93955-8001</p>

	<p>(831) 582-4304 (831) 582-3729 kventimiglia@csumb.edu Alternate POC: John Marker, Director of Facilities</p>
UCMBEST	<p>Graham Bice Managing Director, UC MBEST Center 3180 Imjin Road, Suite 104 Marina. CA 93933 Phone: 831.582.1020 FAX: 831.582.1021 bice@ucmbest.org</p>
US Army	<p>James Willison Presidio of Monterey, Directorate of Public Works IMWE-POM-PWO Attn: James Willison PO Box 5004 Monterey, CA 93944-5004 Phone 831.242.7916 Fax 831.242.7019</p>
State Parks	<p>Joan Carpenter California State Parks, Monterey District 2211 Garden Road Monterey, CA 93940 phone (831) 649-2836 fax (831) 647-6239 joan.carpenter@parks.ca.gov</p>



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

HOWARD GUSTAFSON
President

THOMAS P. MOORE
Vice President

WILLIAM Y. LEE
JAN SHRINER

February 10, 2016

Mr. Layne Long, City Manager
City of Marina
209 Cypress Avenue
Marina, CA 93933

Dear Mr. Long:

The Marina Coast Water District (MCWD) is preparing an updated Urban Water Management Plan (UWMP) for submittal to the California Department of Water Resources, pursuant to the Urban Water Management Planning Act, as codified in the California Water Code Sections 10610-10656. The last UWMP was adopted in 2011.

The updated plan is currently being drafted. Your planning staff was previously contacted for review and input on the development and water demand projections for the planning period, which runs to the year 2035. Our anticipated schedule for public review and plan adoption is:

March 21, 2016	Publish public review draft of the UWMP
April 18, 2016	Conduct public hearing at the regularly scheduled MCWD Board meeting
April 21, 2016	Comment period closes
May 16, 2018	Adopt final UWMP at the regularly scheduled MCWD Board meeting

We will provide you a copy of the public review draft plan in March. We invite your input and comments on the UWMP. Please provide input to our consultant, Schaaf & Wheeler Consulting Civil Engineers, Attn: Andy Sterbenz, 3 Quail Run Circle, Suite 101, Salinas, CA, 93907. Andy may be contacted by phone at (831) 883-4848, or by e-mail at asterbenz@swsv.com. You may contact me by direct phone at (831) 883-5925, or e-mail mwegley@mcwd.org.

Sincerely,

Michael Wegley, PE
District Engineer

Urban Water Management Plan – POCs for Notices

City of Marina	Mr. Layne Long, City Manager City of Marina 211 Hillcrest Avenue Marina, CA 93933
City of Seaside	Mr. Craig Malin, City Manager City of Seaside 440 Harcourt Ave. Seaside, CA 93955
City of Del Rey Oaks	Mr. Daniel Dawson, City Manager City of Del Rey Oaks 650 Canyon Del Rey Road Del Rey Oaks, CA 93940 Phone: 831-394-8511 Fax: 831-394-6421
City of Monterey	Mr. Michael McCarthy, City Manager City of Monterey 580 Pacific Street Monterey, CA 93940
County of Monterey	Mr. Carl P. Holm, AICP County of Monterey, Director, Resource Management Agency 168 West Alisal St., 3rd Floor Salinas, CA 93901
MCWRA	Mr. David E. Chardavoyne, General Manager Monterey County Water Resources Agency 893 Blanco Circle Salinas, CA 93901
MRWPCA	Mr. Paul Sciuto, General Manager Monterey Regional Water Pollution Control Agency 5 Harris Court, Bldg D Monterey, CA 93940

CSUMB	<p>Ms. Kathleen Ventimiglia CSUMB, Director for Campus Planning and Development 100 Campus Center, Mountain Hall A Seaside CA 93955-8001 (831) 582-4304 (831) 582-3729 kventimiglia@csumb.edu Alternate POC: John Marker, Director of Facilities</p>
UCMBEST	<p>Mr. Graham Bice Managing Director, UC MBEST Center 3180 Imjin Road, Suite 104 Marina. CA 93933 Phone: 831.582.1020 FAX: 831.582.1021 bice@ucmbest.org</p>
US Army	<p>Mr. James Willison Presidio of Monterey, Directorate of Public Works IMWE-POM-PWO Attn: James Willison PO Box 5004 Monterey, CA 93944-5004</p>
State Parks	<p>Ms. Joan Carpenter, District Services Manager California State Parks, Monterey District 2211 Garden Road Monterey, CA 93940</p>
CalAm	<p>Mr. Eric Sabolsice General Manager, Monterey District California American Water 511 Forest Lodge Road, Suite 100 Pacific Grove, CA 93950</p>
MPWMD	<p>Mr. David J Stoldt Monterey Peninsula Water Management District 5 Harris Court, Bldg G Monterey, CA 93940</p>
FORA	<p>Mr. Michael A. Houlemard, Jr. Executive Officer, Fort Ord Reuse Authority 920 Second Ave, Suite A Marina, CA 93933</p>



[Home](#)

[About](#)

[Customer Service](#)

[Engineering](#)


[Conservation](#)

[Landscape Incentives](#)

Water Quality

View the annual [Water Quality Report](#) or [Water Quality Report](#) [one Week Earlier Than Usual.](#) [More Info](#)

Consumer Confidence Report or monthly water quality data read more

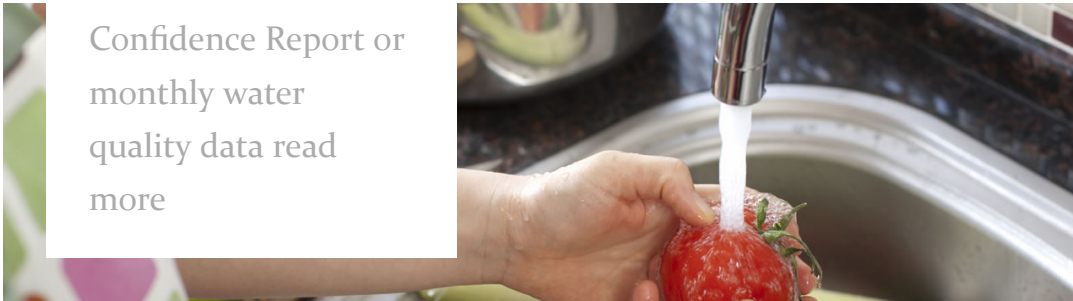

News and Announcements ...

Notice of Public Hearing ... MCWD will conduct a public hearing to receive comments on the Draft 2015 Urban Water Management Plan. 7:00 p.m., Monday, June 6, 2016, Marina Council Chambers, 211 Hillcrest Ave, Marina. [PDF](#)

California BLM Field Office Makes MCWD-built Facility Its New Home ... [Details](#)

Request for Proposals: IT Services ... [Details](#)

Mandatory Water Use Restrictions Continue ... [Details](#)

Of special interest ...

Bill Pay

Pay securely online, or in person or with automatic electronic transfers. [read more](#)

Updates!

Receive updates by email: conservation news, tips, information, and events. [read more](#)

Employment

Job openings and info, salary schedules, and additional information. [read more](#)

Financials

Annual budgets, comprehensive financial reports, rates and fees info, FPPC Form 806. [read more](#)

Public Meetings

Current and archived agendas and minutes. [read more](#)

About MCWD

Marina Coast Water District serves the Monterey Peninsula's fastest growing and most diverse communities — the City of Marina and the Ord Community (the former Fort Ord). MCWD provides high quality water, wastewater and recycled water services through management, conservation, and development of future resources at reasonable costs. [read more](#)

Webmail

Offices

Administration and Customer Service

11 Reservation Road, Marina, CA 93933-2099
Monday through Friday, 8 a.m. to 5:30 p.m.

Engineering and Operations & Maintenance

2840 4th Avenue, Marina, CA 93933
Monday through Friday, 8 a.m. to 5:00 p.m.

Telephone:

(831)384-6131

Quick Links

[Frequently Asked Questions](#)

[Online Bill Pay](#)

[Employment Opportunities](#)

[Public Meetings](#)

[Conservation Resources & Rebates](#)
[Water-Wise Landscaping Information & Incentives](#)

[Water & Wastewater Rates & Fees](#)

[In-School Education Program](#)

Subscribe to [Conservation News & Alerts](#)

NOTICE OF PUBLIC HEARING

THE MARINA COAST WATER DISTRICT will conduct a public hearing to receive comments on the Draft 2015 Urban Water Management Plan. The Urban Water Management Plan addresses water supply and water demands within the District's Marina and Ord Community Service Areas for the next 20-years. The District Board of Directors will conduct the hearing at their regularly scheduled meeting at 7:00 p.m., Monday, June 6, 2016, at the Marina Council Chambers, 211 Hillcrest Ave, Marina, CA 93933. The Draft Plan is available for review at the District Office, or may be viewed on the web at www.mcwd.org. Written comments will be accepted until 5:00 p.m., Friday, June 3, 2016. Submit written comments to MCWD, ATTN: Mike Wegley, 11 Reservation Road, Marina, CA 93933. Email mwegley@mcwd.org, Phone (831)384-6131, Fax (831)384-0197.



Published by The Monterey Herald
P.O. Box 271 • Monterey, California 93942
(831) 726.4382

MARINA COAST WATER DISTRICT
Account No. 2141283
11 RESERVATION RD
MARINA, CA 93933

Legal No. 0005736450
Notice of Public Hearing
Total Cost: \$227.01
Ordered by:

PROOF OF PUBLICATION

STATE OF CALIFORNIA
County of Monterey

I am a citizen of the United States and a resident of the County aforesaid. I am over the age of eighteen years, and not a party to or interested in the above-entitled matter. I am the principal clerk of the printer of The Monterey Herald, a newspaper of general circulation, printed and published daily and Sunday in the City of Monterey, County of Monterey, and which newspaper has been adjudged a newspaper of general circulation by the Superior Court of the County of Monterey, State of California; that the notice, of which the annexed is a printed copy (set in type not smaller than 6 point), has been published in each regular and entire issue of said newspaper and not in any supplement thereof on the following dates, to wit:

05/21/16, 05/22/16

I certify (or declare) under penalty of perjury that the foregoing is true and correct.

Executed on 05/22/2016 at Monterey, California.

Signature

This space is reserved for the County Clerk's Filing Stamp

NOTICE OF PUBLIC HEARING

THE MARINA COAST WATER DISTRICT will conduct a public hearing to receive comments on the Draft 2015 Urban Water Management Plan. The Urban Water Management Plan addresses water supply and water demands within the District's Marina and Ord Community Service Areas for the next 20-years. The District Board of Directors will conduct the hearing at their regularly scheduled meeting at 7:00 p.m., Monday, June 6, 2016, at the Marina Council Chambers, 211 Hillcrest Ave, Marina, CA 93933. The Draft Plan is available for review at the District Office, or may be viewed on the web at www.mcwd.org. Written comments will be accepted until 5:00 p.m., Friday, June 3, 2016. Submit written comments to MCWD, ATTN: Mike Wegley, 11 Reservation Road, Marina, CA 93933. Email mwegley@mcwd.org. Phone (831)384-6131, Fax (831)384-0197.

Publish: May 21, 22, 2016.



Published by The Monterey Herald
P.O. Box 271 • Monterey, California 93942
(831) 726.4382

MARINA COAST WATER DISTRICT
Account No. 2141283
11 RESERVATION RD
MARINA, CA 93933

Legal No. 0005742251

Total Cost: \$116.98
Ordered by:

PROOF OF PUBLICATION

STATE OF CALIFORNIA
County of Monterey

I am a citizen of the United States and a resident of the County aforesaid. I am over the age of eighteen years, and not a party to or interested in the above-entitled matter. I am the principal clerk of the printer of The Monterey Herald, a newspaper of general circulation, printed and published daily and Sunday in the City of Monterey, County of Monterey, and which newspaper has been adjudged a newspaper of general circulation by the Superior Court of the County of Monterey, State of California; that the notice, of which the annexed is a printed copy (set in type not smaller than 6 point), has been published in each regular and entire issue of said newspaper and not in any supplement thereof on the following dates, to wit:

05/29/16

I certify (or declare) under penalty of perjury that the foregoing is true and correct.

Executed on 05/29/2016 at Monterey, California.

Signature

This space is reserved for the County Clerk's Filing Stamp

NOTICE OF PUBLIC HEARING

THE MARINA COAST WATER DISTRICT will conduct a public hearing to receive comments on the Draft 2015 Urban Water Management Plan. The Urban Water Management Plan addresses water supply and water demands within the District's Marina and Ord Community Service Areas for the next 20-years. The District Board of Directors will conduct the hearing at their regularly scheduled meeting at 7:00 p.m., Monday, June 6, 2016, at the Marina Council Chambers, 211 Hillcrest Ave, Marina, CA 93933. The Draft Plan is available for review at the District Office, or may be viewed on the web at www.mcwd.org. Written comments will be accepted until 5:00 p.m., Friday, June 3, 2016. Submit written comments to MCWD, ATTN: Mike Wegley, 11 Reservation Road, Marina, CA 93933. Email mwegley@mcwd.org. Phone (831)384-6131, Fax (831)384-0197.

Publish: May 29, 2016.

Schaaf & Wheeler
CONSULTING CIVIL ENGINEERS

Kirk R. Wheeler, PE
Peder C. Jorgensen, PE
Charles D. Anderson, PE
Daniel J. Schaaf, PE
M. Eliza McNulty, PE

3 Quail Run Circle, Suite 101
Salinas, CA 93907
831-883-4848
FAX 831-758-6328

Benjamin L. Shick, PE
Leif M. Coponen, PE
Principal Emeritus
David A. Foote, PE
James R. Schaaf, Ph. D, PE

May 20, 2016

Mr. Layne Long, City Manager
City of Marina
209 Cypress Avenue
Marina, CA 93933

Subject: Marina Coast Water District 2015 Urban Water Management Plan

Dear Mr. Long:

On behalf of the Marina Coast Water District, we are providing you with the Public Review Draft of the 2015 Urban Water Management Plan. Please review the draft plan and provide any comments in writing to:

Marina Coast Water District
ATTN: District Engineer
11 Reservation Road
Marina, CA 93933

Or by e-mail to mwegley@mcwd.org.

The deadline for written comments is **Friday, June 3, 2016**.

The MCWD Board of Directors will conduct a public hearing to receive comments on the draft urban Water Management Plan at their regularly scheduled meeting on **June 6, 2016**. The meeting will be conducted at the City of Marina Council Chambers, 211 Hillcrest Road, Marina, CA at 7:00 p.m.

If you have any questions, you may contact me at 831-883-4848, or by e-mail asterbenz@swsv.com.

Sincerely,

Schaaf & Wheeler



Andrew Sterbenz, PE

Project Engineer

Attachments

Schaaf & Wheeler
CONSULTING CIVIL ENGINEERS

Kirk R. Wheeler, PE
Peder C. Jorgensen, PE
Charles D. Anderson, PE
Daniel J. Schaaf, PE
M. Eliza McNulty, PE

3 Quail Run Circle, Suite 101
Salinas, CA 93907
831-883-4848
FAX 831-758-6328

Benjamin L. Shick, PE
Leif M. Coponen, PE
Principal Emeritus
David A. Foote, PE
James R. Schaaf, Ph. D, PE

May 27, 2016

Mr. Layne Long, City Manager
City of Marina
211 Hillcrest Ave
Marina, CA 93933

Subject: Marina Coast Water District 2015 Urban Water Management Plan

Dear Mr. Long:

On behalf of the Marina Coast Water District, we provided your office with a copy of the District's Public Review Draft of the 2015 Urban Water Management Plan. We erroneously included the wrong cover letter. The correct letter soliciting review comments is attached.

Also attached, please find Technical Memorandum, North Marina Area Groundwater Data and Conditions, which is part of Appendix E. This report was under revision at the time the Public Review Draft was circulated.

The deadline for written comments is **Friday, June 3, 2016**, as discussed in the attached letter.

The MCWD Board of Directors will conduct a public hearing to receive comments on the draft urban Water Management Plan at their regularly scheduled meeting on **June 6, 2016**. The meeting will be conducted at the City of Marina Council Chambers, 211 Hillcrest Road, Marina, CA at 7:00 p.m.

I apologize for any confusion this may have caused. If you have any questions, you may contact me at 831-883-4848, or by e-mail asterbenz@swsv.com.

Sincerely,

Schaaf & Wheeler



Andrew Sterbenz, PE

Project Engineer

Attachments



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

HOWARD GUSTAFSON
President

THOMAS P. MOORE
Vice President

WILLIAM Y. LEE
JAN SHRINER

Agenda

Regular Board Meeting, Board of Directors Marina Coast Water District

Marina Council Chambers
211 Hillcrest Avenue, Marina, California
Monday, June 6, 2016, 6:30 p.m. PST

This meeting has been noticed according to the Brown Act rules. The Board of Directors meet regularly on the first and third Monday of each month. The meetings normally begin at 6:30 p.m. and are held at the City of Marina Council Chambers at 211 Hillcrest Avenue, Marina, California.

Our Mission: *We provide our customers with high quality water, wastewater collection and conservation services at a reasonable cost, through planning, management and the development of water resources in an environmentally sensitive manner.*

1. Call to Order

2. Roll Call

3. Public Comment on Closed Session Items *Anyone wishing to address the Board on matters appearing on Closed Session may do so at this time. Please limit your comment to four minutes. The public may comment on any other items listed on the agenda at the time they are considered by the Board.*

4. Closed Session

A. Pursuant to Government Code 54956.9

Conference with Legal Counsel – Existing Litigation

1) Ag Land Trust v. Marina Coast Water District, Monterey County Superior Court Case No. M105019; Sixth Appellate District Court of Appeals Case Nos. H038550 and H039559

2) In the Matter of the Application of California-American Water Company (U210W) for Approval of the Monterey Peninsula Water Supply Project and Authorization to Recover All Present and Future Costs in Rates, California Public Utilities Commission No. A.12-04-019 & A.13-05-017 Settlement Agreement

This agenda is subject to revision and may be amended prior to the scheduled meeting. Pursuant to Government Code section 54954.2(a)(1), the agenda for each meeting of the Board shall be posted at the City of Marina Council Chambers. The agenda shall also be posted at the following locations but those locations are not official agenda posting locations for purposes of section 54954.2(a)(1): District offices at 11 Reservation Road, Seaside City Hall, the City of Marina Library, and the City of Seaside Library. A complete Board packet containing all enclosures and staff materials will be available for public review on Wednesday, June 1, 2016. Copies will also be available at the Board meeting. Information about items on this agenda or persons requesting disability related modifications and/or accommodations should contact the Board Clerk 48 hours prior to the meeting at: 831-883-5910.

- 3) Marina Coast Water District v. California Public Utilities Commission, California Supreme Court Case No. S230728, Writ of Review
- 4) California-American Water Company vs Marina Coast Water District; Monterey County Water Resources Agency; and Does 1 through 10, San Francisco Superior Court Case No. CGC-13-528312 (Complaint for Declaratory Relief); First Appellate District Court of Appeals Case No. A145604
- 5) Marina Coast Water District vs. California-American Water Company, Monterey County Water Resources Agency, and Does 1 through 50, San Francisco Superior Court Case No. CGC-15-547125 (Complaint for Breach of Warranties, etc.)
- 6) Marina Coast Water District v, California Coastal Commission (California-American Water Company, Real Party in Interest), Santa Cruz County Superior Court Case No. CV180839 (Petition for Writ of Mandate). Sixth District Court of Appeal Case No. H042742
- 7) Marina Coast Water District v, California State Lands Commission (California-American Water Company, Real Party in Interest), Santa Cruz County Superior Court Case No. CV180895 (Petition for Writ of Mandate)

- B. Pursuant to Government Code 54956.8
 Conference with Real Property Negotiator
 Property: Sewer Infrastructure
 Negotiating parties: Howard Gustafson, Thomas Moore
 Under Negotiation: Price and Terms

7:00 p.m. Reconvene Open Session

5. **Reportable Actions Taken During Closed Session** *The Board will announce any reportable action taken during closed session and the vote or abstention on that action of every director present, and may take additional action in open session as appropriate. Any closed session items not completed may be continued to after the end of all open session items.*
6. **Pledge of Allegiance**
7. **Oral Communications** *Anyone wishing to address the Board on matters not appearing on the Agenda may do so at this time. Please limit your comment to four minutes. The public may comment on any other items listed on the agenda at the time they are considered by the Board.*
8. **Presentations**
 - A. Consider Adoption of Resolution No. 2016-31 in Recognition of James Derbin, Operations and Maintenance Superintendent, and Awarding a Plaque and Gift Certificate for 10 years of Service to the Marina Coast Water District

- B. Consider Adoption of Resolution No. 2016-32 in Recognition of Brian West, Systems Operator II, and Awarding a Plaque and Gift Certificate for 20 Years of Service to the Marina Coast Water District

9. Consent Calendar *Board approval can be taken with a single motion and vote. A Board member or member of the public may request that any item be pulled from the Consent Calendar for separate consideration at this meeting or a subsequent meeting. The public may address the Board on any Consent Calendar item. Please limit your comment to four minutes.*

- A. Receive and File the Check Register for the Month of May 2016
- B. Approve the Draft Minutes of the Regular Board Meeting of May 16, 2016

10. Public Hearing

- A. Receive Public Comment on the Draft 2015 Urban Water Management Plan

11. Action Items *The Board will review and discuss agenda items and take action or direct staff to return to the Board for action at a following meeting. The public may address the Board on these items as each item is reviewed by the Board. Please limit your comment to four minutes.*

- A. Consider Adoption of Resolution No. 2016-33 to Approve and Adopt the District's 2015 Urban Water Management Plan

Action: The Board of Directors will consider approving and adopting the District's 2015 Urban Water Management Plan.

- B. Consider Adoption of Resolution No. 2016-34 to Approve the Marina Coast Water District Budget for FY 2016-2017

Action: The Board of Directors will consider approving the FY 2016-2017 budget.

- C. Consider Adoption of Resolution No. 2016-35 to Approve the District Five-Year Capital Improvement Projects Budget

Action: The Board of Directors will consider approving the District five-year Capital Improvement Projects budget for the Central Marina and Ord Community service areas.

- D. Consider Adoption of Resolution No. 2016-36 to Approve a Professional Services Agreement for Inspection and Construction Support Services for the Dunes-1C Phase 3 Development Project

Action: The Board of Directors will consider approve a Professional Services Agreement for inspection and construction support services for the Dunes-1C Phase 3 development project.

- E. Consider Adoption of Resolution No. 2016-37 to Approve a Professional Services Agreement to Provide Information Technology Support Services to the District for FY 2016-2017

Action: The Board of Directors will consider approving a Professional Services Agreement to provide information technology support services to the District for FY 2016-2017.

- F. Discuss and Consider Adoption of Resolution No. 2016-38 to Approve Revisions to the Board Procedures Manual

Action: The Board of Directors will discuss and consider approving revisions to the Board Procedures Manual.

12. Staff Report

- A. Receive the Developer Account Update as of March 31, 2016
- B. Receive the 1st Quarter 2016 MCWD Water Consumption and Sewer Flow Report

13. Informational Items *Informational items are normally provided in the form of a written report or verbal update and may not require Board action. The public may address the Board on Informational Items as they are considered by the Board. Please limit your comments to four minutes.*

- A. General Manager's Report
- B. Counsel's Report
- C. Committee and Board Liaison Reports
 - 1. Water Conservation Commission
 - 2. Joint City-District Committee
 - 3. Executive Committee
 - 4. Community Outreach Committee
 - 5. Budget and Personnel Committee
 - 6. MRWPCA Board Member Liaison
 - 7. LAFCO Liaison
 - 8. FORA
 - 9. WWOC Report
 - 10. JPIA Liaison
 - 11. Special Districts Association

14. Board Member Requests for Future Agenda Items

15. Director's Comments *Director reports on meetings with other agencies, organizations and individuals on behalf of the District and on official District matters.*

16. Adjournment *Set or Announce Next Meeting(s), date(s), time(s), and location(s):*

*Regular Meeting: Tuesday, July 5, 2016, 6:30 p.m.,
Marina Council Chambers, 211 Hillcrest Avenue, Marina*

Marina Coast Water District
Public Hearing

Agenda Item: 10-A

Meeting Date: June 6, 2016

Prepared By: Andrew Sterbenz
Reviewed by: Michael Wegley

Approved By: Keith Van Der Maaten

Subject: Public Hearing on the Draft 2015 Urban Water Management Plan

Detailed Description: The Board will conduct a public hearing and receive public comments on the District's Draft 2015 Urban Water Management Plan (UWMP). Following the public hearing, the comments received will be considered and a final UWMP will be considered for adoption by the Board.

In June 2011 the Board approved the *2010 Urban Water Management Plan*. The California Urban Water Management Planning Act requires any municipal supplier serving over 3,000 connections or 3,000 acre-feet of water per year to prepare an urban water management plan every five years. The 2015 plan deadline was extended due to changes in the law which required the Department of Water Resources to develop additional procedures and guidelines for completion of UWMPs, which were not completed by DWR until March 2016. The District must now adopt the 2015 UWMP not later than July 1, 2016.

The draft development and water demand projections tables, which form the basis of the plan, were mailed to the land use jurisdictions (LUJs) for review on October 30, 2015, and discussed at the January 13, 2016 Fort Ord Reuse Authority's Administrative Committee meeting. On February 10, 2016, notice of preparation of the proposed *2015 UWMP* was provided to area cities and the county in accordance with the UWMP Act. Additionally, notification was extended to affected area agencies to invite input, review and comments on the UWMP.

Copies of the Draft 2015 UWMP were distributed to all of the land use jurisdictions on May 20, 2016, with a cover letter stating that the deadline for submitting comments was 5:00 p.m. on Friday, June 3, 2016. The required public notice was published in a local newspaper. All timely comments received will be provided to the Board at the Board meeting and will be included in the final 2015 UWMP. Copies of the notices and proofs of publication mentioned above are on file with the District Secretary and will be available for inspection by the Board at the Board meeting. The Draft 2015 UWMP is available at the District's Reservation Road and Ord offices and on the District website.

Material Included for Information/Consideration: The Draft 2015 Urban Water Management Plan was provided for public review on May 23, 2016 and is also available on the District website, www.mcwd.org. Staff errata for the Draft 2015 UWMP is also included.

This page is intentionally blank.

Appendix E: Technical Memoranda

The following technical memoranda were prepared as interim reports during the development of this Urban Water Management Plan, and are included in this appendix.

1. District Population Estimate, dated 5/25/2015
2. FORA Water Augmentation Target, dated 12/23/2015
3. Water Allocations by Jurisdiction, dated 5/17/2016
4. North Marina Area Groundwater Data and Conditions, Hopkins Groundwater Consultants, Inc., May 2016

**Table 1: Extract from California Department of Finance
Report E-4 Population Estimates for Cities, Counties, and State, 2011-2015 with 2010 Benchmark**

COUNTY/CITY	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015
California						
Incorporated Total	30,764,188	30,973,925	31,297,312	31,636,815	31,921,717	32,237,899
Balance Of State Total	6,489,768	6,454,021	6,383,281	6,393,794	6,435,404	6,476,826
State Total	37,253,956	37,427,946	37,680,593	38,030,609	38,357,121	38,714,725
Monterey County						
Carmel-By-The-Sea	3,722	3,722	3,733	3,768	3,747	3,747
Del Rey Oaks	1,624	1,631	1,643	1,658	1,661	1,660
Gonzales	8,187	8,220	8,272	8,349	8,363	8,357
Greenfield	16,330	16,396	16,516	16,839	16,879	16,870
King City	12,874	12,942	13,033	13,158	13,179	13,417
Marina	19,718	19,759	20,005	20,199	20,222	20,872
Monterey	27,810	28,019	28,472	28,419	28,319	28,163
Pacific Grove	15,041	15,108	15,226	15,367	15,394	15,388
Salinas	150,441	150,996	152,461	154,189	154,815	154,720
Sand City	334	335	337	340	342	362
Seaside	33,025	32,808	33,174	33,523	33,456	33,672
Soledad	25,738	26,286	26,247	25,536	24,959	24,540
Balance Of County	100,213	100,746	101,680	102,719	103,438	103,645
Incorporated	314,844	316,222	319,119	321,345	321,336	321,768
County Total	415,057	416,968	420,799	424,064	424,774	425,413

The annual population change estimated by DOF for Marina is shown in Table 2:

Table 2: Estimated Cumulative Population Increases by Year

CITY	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015
Marina	NA	41	287	481	504	1,154

The total MCWD population was determined for the last UWMP based on the 2010 census by summing all of the Census Tracts within the District. The population total in 2010 was 30,480 persons. Subtracting the 19,718 from within the City of Marina, the 2010 population for the remainder of the Ord Community was 10,762 persons. In the 2010 UWMP, the District reported having 7,153 residential connections (sum of single and multi-family accounts). The number of persons per account is calculated by dividing

$$\frac{30,480 \text{ persons}}{7,153 \text{ accounts}} = 4.26 \text{ persons per account}$$

Note that there are numerous multi-family units within the District which have more than one dwelling unit per meter, so the average number of persons per account is larger than the estimated persons per household.

Since 2010, five housing projects have been completed or partially completed:

- University Village Apartments (Marina), 108 units occupied in 2014
- Stilwell Kidney and Lower Stilwell (Seaside), 148 units occupied in 2010-2013
- Manzanita Place Apartments (Monterey County) , 66 units occupied in 2013
- East Garrison (Monterey County), 14 houses in 2013, 108 houses in 2014

The University Village Apartments are included within the City of Marina population projection. The Stilwell developments in Seaside are part of the Army housing upgrades in the Presidio of Monterey Annex. The Army is renovating and/or replacing existing housing units, and then emptying older units for the next phase, thus maintaining a constant number of occupied units. Therefore, the only additional residential units outside of Marina were in Monterey County. The annual increase in accounts is shown in Table 3, and the resulting population increase is shown in Table 4. The District total population is calculated in Table 5.

Table 3: New Residential Accounts Outside the City of Marina (cumulative)

Development	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015
Manzanita Place	NA	0	0	0	66	66
East Garrison	NA	0	0	0	14	108
Total	NA	0	0	0	80	174

Table 4: Population Increases Outside the City of Marina (cumulative)

Development	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015
Manzanita Place	NA	0	0	0	281	281
East Garrison	NA	0	0	0	60	460
Total	NA	0	0	0	341	741

Population estimated as 4.26 persons per residential account

Table 5: MCWD Estimated Population by Year

Area	4/1/2010	1/1/2011	1/1/2012	1/1/2013	1/1/2014	1/1/2015
City of Marina	19,718	19,759	20,005	20,199	20,222	20,872
Existing outside of Marina in 2010	10,762	10,762	10,762	10,762	10,762	10,762
New outside of Marina since 2010	NA	0	0	0	341	741
Total	30,480	30,521	30,767	30,961	31,325	32,375

This page is intentionally blank.

MEMORANDUM

TO: File DATE: 23 DEC 2015
Revised 06 JUN 2016

FROM: Andrew Sterbenz JOB#: MCWD.43.12.020

SUBJECT: FORA Water Augmentation Target

The purpose of this memorandum is to document the required size of the water augmentation mitigation under the Fort Ord Reuse Authority Base Reuse Plan.

The Fort Ord Base Reuse Plan was adopted in 1997. The Fort Ord Reuse Study projected a build-out water demand of 18,262 AFY. The Base Reuse Plan EIR revised that down to 13,500 AFY at buildout, with a Phase 1 (Year 2015) projection of 8,999 AFY. The 2015 projection included 8,712 new residential dwelling units, 4,925,800 SF of new commercial and office space, and 270 acres of new primary and secondary education campuses. The demand estimate assumed a 10% overage to account for system losses. The United States had acquired 6,600 AFY of groundwater pumping rights in the Salinas Valley Groundwater Basin to serve the former Fort Ord. In the Base Reuse Plan EIR, the water augmentation mitigation was estimated to be 2,400 AFY, which is the projected 9,000 AFY demand minus the existing 6,600 AFY supply¹.

In the Base Reuse Plan, the Fort Ord Reuse Authority allocated the 6,600 AFY of existing United States groundwater rights among the land use jurisdictions so they could proceed with entitling redevelopment projects. The initial and current allocations are shown in the table below. The United States retained 1,577 AFY of the 6,600 AFY for use in the Presidio of Monterey Annex, which includes the military housing area and various offices and facilities.

The existing Bayonet/Black Horse Golf Courses on the former Fort Ord use approximately 400 AFY for landscape irrigation. This water was supplied from existing wells in the Seaside Groundwater Basin. The Base Reuse Plan assumed that supply from these wells would continue indefinitely, so this demand was not included in the 2015 demand projection, although the plan identified the need to convert these sites to recycled water once available. In 2005 the Seaside Groundwater Basin was adjudicated, which increased the urgency to convert the system to recycled water.

The Marina Coast Water District's Regional Urban Water Augmentation Project (RUWAP) was approved in 2004. That project was sized to provide 2,400 AFY of new supply to the Ord Community, as a mix of potable and recycled water. The supply target came from the Base Reuse Plan. In the demand analysis, MCWD included Bayonet and Black Horse Golf Courses as potential recycled water use locations. While this inclusion was appropriate given the status of the Seaside Groundwater Basin, the RUWAP target should have been increased by 400 AFY to be consistent with the Base Reuse Plan assumptions.

¹ Base Reuse Plan, Volume 3, Appendix B, page PIFP 2-7
Page E-7

The MCWD 2005 Urban Water Management Plan (UWMP) projected all jurisdictions fully using or exceeding their water allocations by the year 2020, with an overall shortfall of 5,300 AFY in the Ord Community (see attached tables). That projection did not include replacement water supply for Bayonet/Black Horse Golf Courses. The 2010 UWMP update reflected the reduced redevelopment rate following the economic downturn and the projected replacement supply for Bayonet/Black Horse, and shows two jurisdictions (the Army and CSUMB) which are projected to not fully use their allocations by 2030. The projected shortfall in the Ord Community was 1,600 AFY, but accounting for “stranded” allocations, the total becomes 2,400 AFY. The 2030 projection does not include all of the development included in the Base Reuse Plan 2015 projection, most notably the proposed golf courses in Marina and Del Rey Oaks.

FORA has a Water Augmentation item in its CIP as a mitigation for the projected redevelopment. As part of the 2015 UWMP update, a reassessment of the water augmentation target should be conducted to determine if 2,400 AFY is still valid. The FORA mitigation is funded through land sales and development fees, which are considered the developer’s mitigation for project water demands. New development which is in excess of the “mitigated level of redevelopment” will need to develop additional water supplies, or fund MCWD’s development of additional water supplies. MCWD needs to know what the “mitigated level of redevelopment” is so they can plan accordingly.

FORA Water Allocations

Jurisdiction	Original Allocation (1996) Acre-feet/year	Current Allocation (2007) Acre-feet/year
City of Seaside	710	1,012
City of Del Rey Oaks	75	243
City of Monterey	65	65
City of Marina	1,185	1,325
Monterey County	545	710
Army	1,410	1,577
CSUMB	1,055	1,035
UCMBEST	165	230
State Parks	45	45
Marina Sphere Polygon 8a	50	10
Line Loss	530	348
FORA Strategic Reserve	785	0

MEMORANDUM

TO: File DATE: May 18, 2016
FROM: Andrew Sterbenz JOB#: MCWD.43.12.020
SUBJECT: Jurisdictional Water Allocations

The purpose of this memorandum is to summarize the potable water allocations within the Ord Community, both from the Fort Ord Reuse Authority (FORA) to the respective jurisdictions and from the jurisdictions to specific projects.

Groundwater Supply

Potable water supply for the former Fort Ord (MCWD Ord Community service area) comes from the Salinas Valley Groundwater Basin (SVGB), which is managed by the Monterey County Water Resources Agency (MCWRA). MCWRA operates two reservoirs which capture winter runoff and maintain year-round flow in the Salinas River, which recharges the groundwater basin. MCWRA established Zones 2 and 2A as benefit assessment zones to finance the construction and operation of Lakes Nacimiento and San Antonio, respectively. Under the “Agreement between the United States of America and the Monterey County Water Resources Agency concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404”, dated September 21, 1993, the U.S. Army may withdraw up to 6,600 acre-feet per year from the Salinas Valley Groundwater Basin for use on the former Fort Ord, including those portions of the former Fort Ord that overly the Seaside Groundwater Basin. The MCWD Central Marina service area was similarly annexed into Zones 2/2A in 1996.

On October 24, 2001, the United States quitclaimed the water and sewer infrastructure on the former Fort Ord, including the SVGB groundwater allocation, through FORA to the Marina Coast Water District. The U.S. retained 1,729 AFY for use in the Presidio of Monterey Annex (military housing and facilities within the Ord Community) and the Bureau of Land Management. Under agreements between the U.S. Army and FORA (2000), and between MCWD and FORA (1998), the FORA Board allocated the remaining water supply among the land use jurisdictions in the Ord Community. MCWD owns and operates the water system and the underlying groundwater extraction rights, except for the rights reserved to the U.S. Army. MCWD provides water and sewer service to the Presidio of Monterey Annex under direct contract with the U.S. Army.

Allocations to Land Use Jurisdictions

The original and current allocation of potable water supply among the Ord Community Land Use Jurisdictions is shown in Table 1, below. FORA initially allocated supply among the jurisdictions on April 12, 1996, under the Development and Reuse Management Plan, adopted as part of the Base Reuse

Plan. At that time, FORA held out a strategic reserve of 785 AFY. On August 14, 1998, the allocations were adjusted and the strategic reserve reduced to 755 AFY. In 2001, the U.S. Army allocated 38 AFY to Brostram Park in Seaside, reducing the retained total to 1,691 AFY. In 2005, the U.S. Army allocated 114 AFY to Seaside as part of a real estate exchange between the Army and the City, reducing the retained total to 1,577 AFY. As the jurisdictions developed specific plans for the redevelopment of Ord Community, FORA made several “loans” from the strategic reserve to jurisdictions. On January 12, 2007, FORA made these loans permanent.

Table 1. Salinas Valley Groundwater Allocations

Jurisdiction	Original Allocation (1996) Acre-feet/year	Current Allocation (2007) Acre-feet/year
U.S. Army (retained) ₁	1,410	1,577
City of Seaside	710	1,012
City of Del Rey Oaks	75	242.5
City of Monterey	65	65
City of Marina	1,185	1,325
Monterey County	545	710
CSUMB	1,055	1,035
UCMBEST	165	230
State Parks	45	45
County/Marina Sphere (Polygon 8a)	50	10
Line Loss	530	348.5
FORA Strategic Reserve ₂	785	0

Notes:

1. The U.S. Army retained 1,729 AFY of groundwater rights for the POM Annex, but it is accounted for in the original allocation table as 1,410 AFY for POM Annex use, 160 AFY as a portion of the strategic reserve, and 159 AFY (10%) as a portion of the line loss allowance.
2. The original strategic reserve included 160 AFY for the POM Annex, 125 AFY for CSUMB, 230 AFY for Seaside and 270 AFY of unencumbered supply.

The County/Marina Sphere of influence area (included in the table above) is defined as County Planning Area 8a in the Base Reuse Plan. This area is bounded by Imjin Parkway on the north, Inter-Garrison Road on the south, the Marina City Limit on the west (7th Avenue alignment) and the CSUMB property on the east (includes a short portion of Abrams Drive). This is generally the landfill parcel, but it includes the Ord Market (former shoppette) at the corner of Imjin Parkway and Abrams Drive.

The existing Bayonet/Black Horse Golf Courses on the former Fort Ord use approximately 400 AFY for landscape irrigation. This water was supplied from existing wells in the Seaside Groundwater Basin. The Base Reuse Plan assumed that supply from these wells would continue indefinitely, or until it could be replaced with recycled water. In 2005 the Seaside Groundwater Basin was adjudicated, which increased the urgency to convert the system to recycled water.

The assumed line loss of 348.5 AFY represents 5.3% of the total water allocation, which is an ambitious target. Water loss rates around 10% are more typical within municipal water systems.

Sub-Allocations by Land Use Jurisdictions

MCWD maintains a listing of water sub-allocations made by land use jurisdictions to specific projects. When publishing a water supply assessment report, the list is updated for the affected jurisdiction(s) and included in the report. The current sub-allocation table is attached.

Some of the water uses within the Ord Community were on-going at the time of the Base Closure (such as the public schools) or transitioned to new uses without formal allocations (such as the conversion of Preston Park military housing to affordable public housing). The values for existing uses that do not have formal allocations reflect the peak demand years.

Two jurisdictions, the City of Del Rey Oaks and the City of Monterey, have not yet formally approved development in the Ord Community, and therefore have not made any sub-allocations. Several other jurisdictions (CSUMB, UCMBEST, U.S. Army and State Parks) retain all of their property under single ownership, and have not needed to sub-allocate water supply to internal projects. In 2007, State Parks allocated 5.5 AFY for the American Youth Hostel project in Seaside. In 2014, the U.S. Army allocated 5 AFY to the California Central Coast Veterans Cemetery Project in Seaside, with an additional 10 afy for the first two years for landscape establishment. These project allocations are reflected in the summary table.

In the City of Marina, sub-allocations have been made for three specific plan areas: Marina Heights, University Villages (now called Dunes on Monterey Bay) and Cypress Knolls. Project-specific allocations have also been made for the Monterey Peninsula College 12th Street Campus, the Rock Rose Gardens housing project, and the Promontory apartments. The table also includes several projects which are subsets of Specific Plan allocations.

In the City of Seaside, sub-allocations have been made to two specific plan areas: Seaside Highlands and Seaside Main Gate. Project-specific allocations have also been made for the Monterey College of Law, Monterey Peninsula College, Chartwell School and the American Youth Hostel. The water allocations for Sun Bay Apartments and Bay View Mobile Home Park were established through the MOA between the USA and FORA, as amended in 2001. The Water Supply Assessment for the Seaside Main Gate Project identified a demand range from 207 to 213 AFY, but the City allocation was only for the retail portion of that project. A Water Supply Assessment has been prepared for the Monterey Downs Specific Plan area, which includes portions of Seaside and unincorporated Monterey County. That specific plan has not yet been adopted by the City.

Also within Seaside, the Bayonet/Blackhorse Golf Courses were originally irrigated from a well in the Seaside Groundwater Basin. In 2010, MCWD and Seaside entered into a land purchase agreement. Under that agreement, MCWD is providing 2,500 acre-feet of SVGB supply to irrigate the golf course, which allows Seaside to reduce their groundwater use from the Seaside Groundwater Basin. This is a term agreement and not a permanent allocation, so it is listed in summary table without an allocation value.

In Monterey County, sub-allocation was made for the East Garrison Specific Plan area, and project-specific allocations were made for Monterey Peninsula College and for the Ord Market. The Ord Market is within the Marina Sphere sub-area.

Attachments

Table 2, Sub-Allocations by Jurisdiction

Table 3.11-2, Allocation of Existing Potable Water Supply by Jurisdiction, from the FORA Development and Resource Management Plan

References

Agreement between the United States of America and the Monterey County Water Resources Agency concerning Annexation of Fort Ord into Zones 2 and 2A of the Monterey County Water Resources Agency, Agreement No. A-06404, September 21, 1993.

Fort Ord Reuse Authority, Development and Resource Management Plan portion of the Fort Ord Base Reuse Plan, 1997

Fort Ord Reuse Authority, Board Agenda Packet for January 12, 2007, item 8b: Resolution of the Authority Board changing the 150 AFY loans granted to Del Rey Oaks, Seaside, Marina, and Monterey County in October 1998 to permanent additions to their water allocations

Memorandum of Agreement Between the United States of America, Acting By and Through the Secretary of The Army, United States Department of the Army and the Fort Ord Reuse Authority for the Sale of Portions of the Former Fort Ord, Located in Monterey County, California, June 20, 2000

Annexation Agreement and Groundwater Mitigation Framework for Marina Area Lands, 1996

Assignment of Easements on Former Fort Ord and Ord Military Community, County of Monterey, and Quitclaim Deed for Water and Wastewater Systems, between Fort Ord reuse Authority (Grantor) and Marina Coast Water District (Grantee), October 24, 2001

Table 2. Water Sub-Allocations by Jurisdiction

Ord Community Land Use Jurisdiction	SVGB Allocation (AFY)	Suballocations To	Suballocation Amount (AFY)	Resolution No.	Date	Notes:
U.S. Army	1,577					
		Existing POM Annex	686			maximum annual use, DPW has not allocated by facility
		Veterans Cemetery	5	USA	2014	15 AFY for 2 years, 5 AFY permanent
CSUMB	1,035	None				Campus has not allocated by facility.
Del Rey Oaks	242.5	None				
City of Monterey	65	None				
County of Monterey	710		522.5			
		East Garrison 1	470	05-268	10/4/2005	
		MPC	52.5	02-XX	12/10/2002	
		Whispering Oaks	0			Allocated 93 AFY, later revoked with the specific plan.
County/Marina Sphere	10		5			Reuse Plan polygon 8a (landfill parcel, shoppette)
		Ord Market	5		3/27/2008	
UCMBEST	230					
		None				
City of Seaside	1,012		786.6			
		Sunbay Apts (Thorson)	120.0	USA	10/23/2001	Amendment 1 to Agreement dated 6/20/2000 between USA and FORA
		Bay View Park (Brostram)	84.8	USA	10/23/2001	Amendment 1 to Agreement dated 6/20/2000 between USA and FORA
		Seaside Highlands	168.5	02-07	2002	43.1 AFY to be replaced with RW when available
		Seaside Resort	161.4	05-44	2005	
		Monterey College of Law	2.8	04-20	3/18/2004	
		Monterey Peninsula College	9.7	09-36	7/16/2009	
		MPUSD	81.0	USA		existing at time of base closure
		Chartwell School	6.4	05-26	5/19/2005	
		Other	3.0			existing at time of base closure
		Main Gate	149	08-XX	5/15/2008	WSA totalled 207 AFY. City allocated retail portion only.
		State Parks transfer for AYH	-5.5	07-XX	11/15/2007	Agreement to transfer supply for this project
		Amer. Youth Hostile	5.5	07-XX	11/15/2007	Agreement to supply AYH with transferred supply
		Bayonet/Blackhorse Golf (temp)		temp		Agreed on 4/1/10: 2500 AF in exchange for 17 ac parcel, max 500 AF/Yr
		Monterey Downs				Not yet approved, WSA estimated 852.5 AFY
State Parks and Rec.	45					
		Seaside for Amer. Youth Hostel	5.5		11/15/2007	AYH parcel goes to Seaside along with 5.5 AFY supply
City of Marina	1,325		1319.8			
		Existing use	233.1			Preston Park, Abrams Park, Airport, Veterans Housing, etc.
		Marina Heights	292.4	2004-41	3/3/2004	
		University Villages	593.0	2005-129	5/31/2005	renamed Dunes on Monterey Bay
		Cypress Knolls	156.1	2006-289	11/8/2006	
		MPC - 12th St Campus	7.0	2007-xx	2/6/2007	
		Imjin Office Park	0.0			IS-MND projected 11.76 AFY. No formal allocation made
		CHOMP Wellness Center	0.0			21 AFY, Subset of University Villages
		Rock Rose Gardens	4.9	PC2011-07	6/9/2011	Planning commission, existing demand formalized as allocation
		Promontory Apartments	33.3	2013-86	7/2/2013	
Assumed Line Loss	348.5					
Total GW:	6,600					

SVGB = Salinas Valley Groundwater Basin
 AFY = acre-feet/year
 XX = Resolution # not included in meeting minutes
 RW = Recycled Water

TABLE 3.11-2
Allocation of Existing Potable Water Supply
By Jurisdiction
(Based on FORA's April 12, 1996 Resolution)

JURISDICTION	TOTAL WATER ALLOCATION (AFY)	NOTES
City of Seaside	710	
County/City of Del Rey Oaks	75	Plus reclaimed water for golf course
County/City of Monterey	65	
City of Marina	1,185	
Monterey County	545	
ARMY	1,410	
CSUMB	1,055	Plus reclaimed water for irrigation
UCMBEST	165	Plus reclaimed water for irrigation
County/State Parks and Recreation	45	
County/Marina Sphere Polygon 8a	50	
<hr/>		
SUBTOTAL	5,295 AFY	
Line Loss (10%)	530	
FORA Strategic Receive	785	Encumbered Reserve: Army – 160 AFY1 CSUMB – 125 AFY1 Seaside – 230 AFY2 Unencumbered – 270 AFY
<hr/>		
TOTAL	6,600 AFY	

ENCUMBRANCES TO FORA'S STRATEGIC RESERVE

1. 160 AFY at the POM Annex and 125 AFY at CSUMB polygon 10 are available upon metering of existing dwelling units.
2. 230 AFY loaned to Seaside is available to Seaside for golf course irrigation until reclaimed replacement water is provided.

TECHNICAL MEMORANDUM

To: Mr. Keith Van Der Maaten
General Manager, Marina Coast Water District

From: Curtis J. Hopkins
Principal Hydrogeologist, Hopkins Groundwater Consultants, Inc.

Date: May 26, 2016

Subject: North Marina Area Groundwater Data and Conditions


I. Introduction

Hopkins Groundwater Consultants, Inc. (Hopkins) has reviewed groundwater data provided by the California-American Water Company's (Cal-Am's) test slant well project for the Monterey Peninsula Water Supply Project (MPWSP) as requested by Marina Coast Water District (MCWD). This memorandum provides a summary of groundwater data and the conditions that are inferred from these data in the North Marina Area of the 180-400 Foot Aquifer Subbasin¹ within the Salinas Valley Groundwater Basin (SVGB). The North Marina Area is delineated for reference in Figure 1 – Groundwater Basin Boundary Map which shows its location within the SVGB. As shown, the North Marina Area is located between the northern boundary of the Marina Area and the Salinas River. This area of the basin has been largely undeveloped and historically contained very few wells to provide groundwater data.

The geology in the North Marina Area differs from the geology north of the Salinas River in the main portion of the 180-400 Foot Aquifer Subbasin and has been described in detail by studies conducted for the MPWSP. An interpretation of subsurface deposits within this specific coastal area is provided in Plate 1 – Cross-Section A-A', which is a portion of a subsurface profile constructed by Geoscience Support Services, Inc. from borehole data collected in the area (Geoscience, 2014). The approximate location of Cross-Section A-A' is shown in Figure 1. As shown and as described by previous study (Geoscience, 2014 and 2015, KJC, 2004), the terrace deposits that comprise the 180-Foot Equivalent Aquifer (180-FTE) in the North Marina Area grade into the alluvial deposits that comprise the 180-Foot Aquifer in the main portion of the basin around the present location of the Salinas River.

¹ / For purposes of the memorandum, the North Marina Area is defined as that portion of the 180/400 Foot Aquifer Subbasin located south of the Salinas River and north of the Salinas Valley Marina Area.

Figure 1 – Groundwater Basin Boundary Map

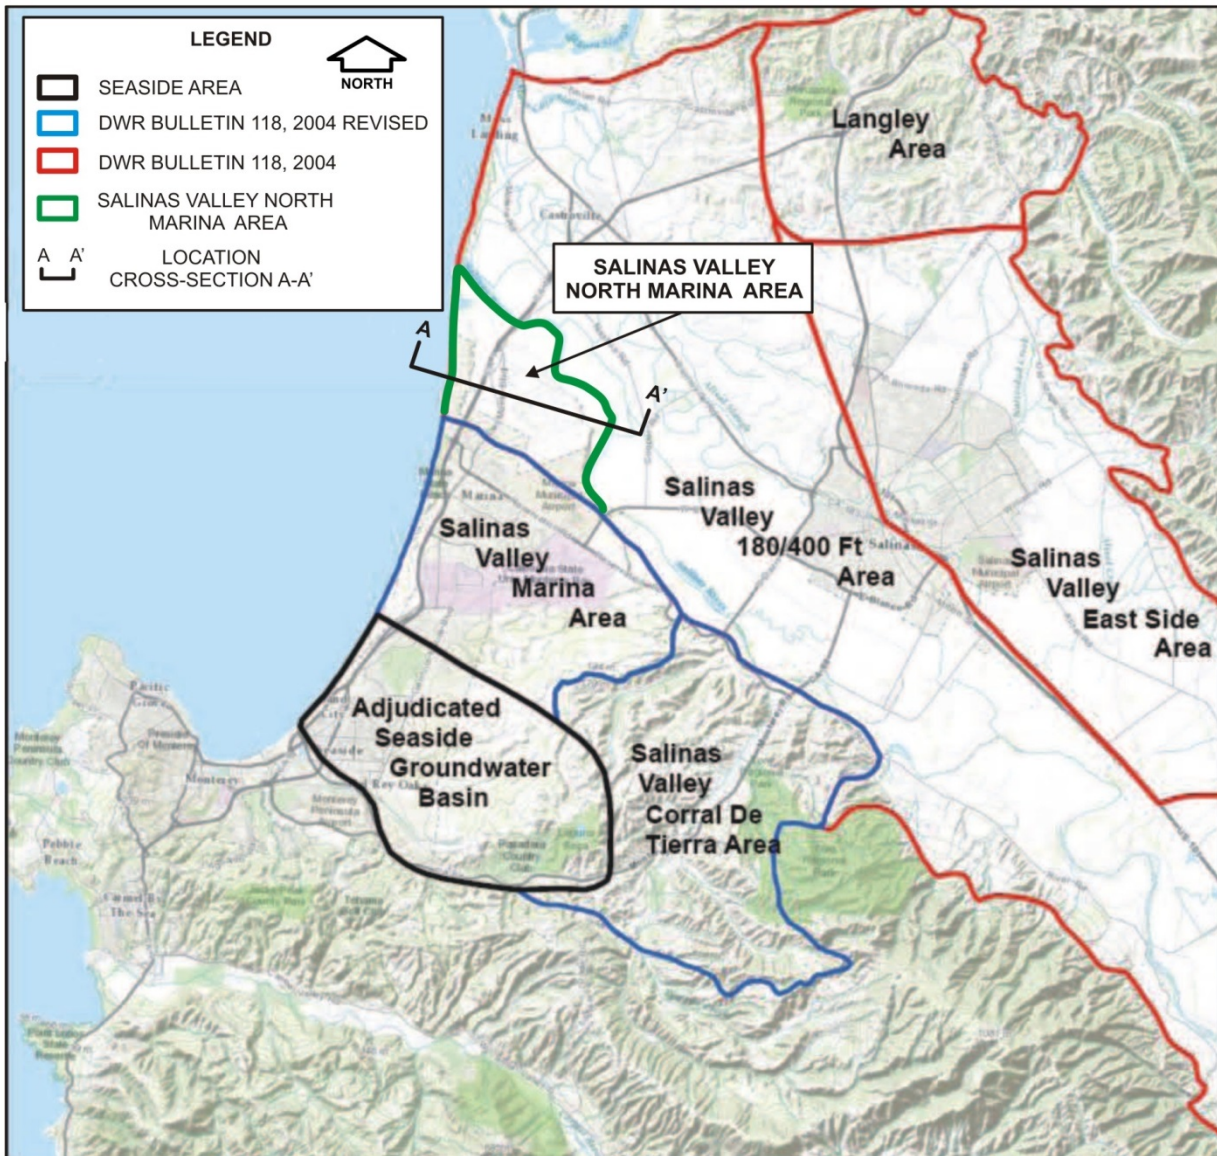


II. Coastal Groundwater Elevations

Recent investigation for the MPWSP includes the installation of a test slant well and multiple monitoring wells in and around the CEMEX property where the MPWSP intake wells are proposed to be located. The monitoring well network is being used to generate background water level and water quality data within the North Marina Area of the 180-400 Foot Aquifer Subbasin. The location of the monitoring facilities is shown on Plate 2 – Well Location Map. The construction details of these wells are included for reference as Attachment A – Well Construction Information.

Routine monitoring of the well network is presented in weekly summary reports that are posted on the Cal-Am website. Water level data are graphically presented as hydrographs which show daily changes and seasonal trends. A set of hydrographs provided by the MPWSP test slant well long term pumping test Monitoring Report No. 55 are included as Attachment B – MPWSP Water Level Data. We must note that while we have over a year of data, the climatic conditions prior to initiation of testing have been extremely dry. For comparison of the groundwater conditions across the area prior to resumption of pumping, data from May 2, 2016 were used to construct Figure 2 – Groundwater Elevation From MPWSP Monitoring Wells. As shown, the water level elevations vary significantly between the shallow Dune Sand Aquifer (indicated by the MW-S Wells), the 180-FTE Aquifer (indicated by the MW-M Wells), and the 400-Foot Aquifer (indicated by the MW-D Wells).


Figure 2 – Groundwater Elevation From MPWSP Monitoring Wells

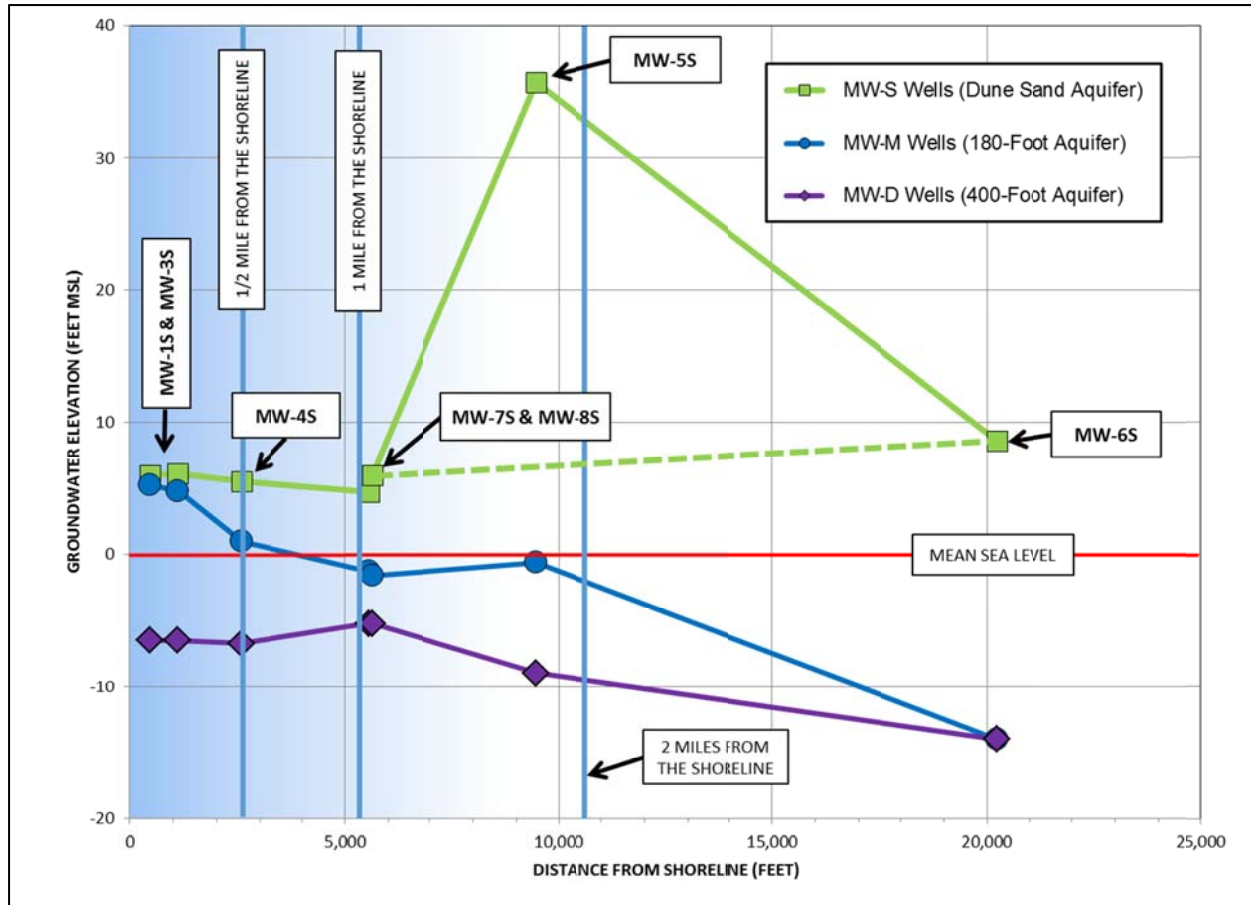

The Dune Sand Aquifer has water levels that are notably above sea level and maintain a protective head against seawater intrusion (Geoscience, 2013). The coastal groundwater mounding at MW-1 and MW-3 is believed to be maintained by the CEMEX dredge pond operation that is discharged on the landward side of the coastal dunes as well as process water


that is discharged to percolation ponds. Figure 3 – CEMEX Salt Water Discharge Locations shows the surface water features that have influenced the groundwater levels and quality at this location along the coast for decades. The maintenance of these features undoubtedly increases the amount of ocean water present in the vicinity of the test slant well.

Figure 3 – CEMEX Salt Water Discharge Locations

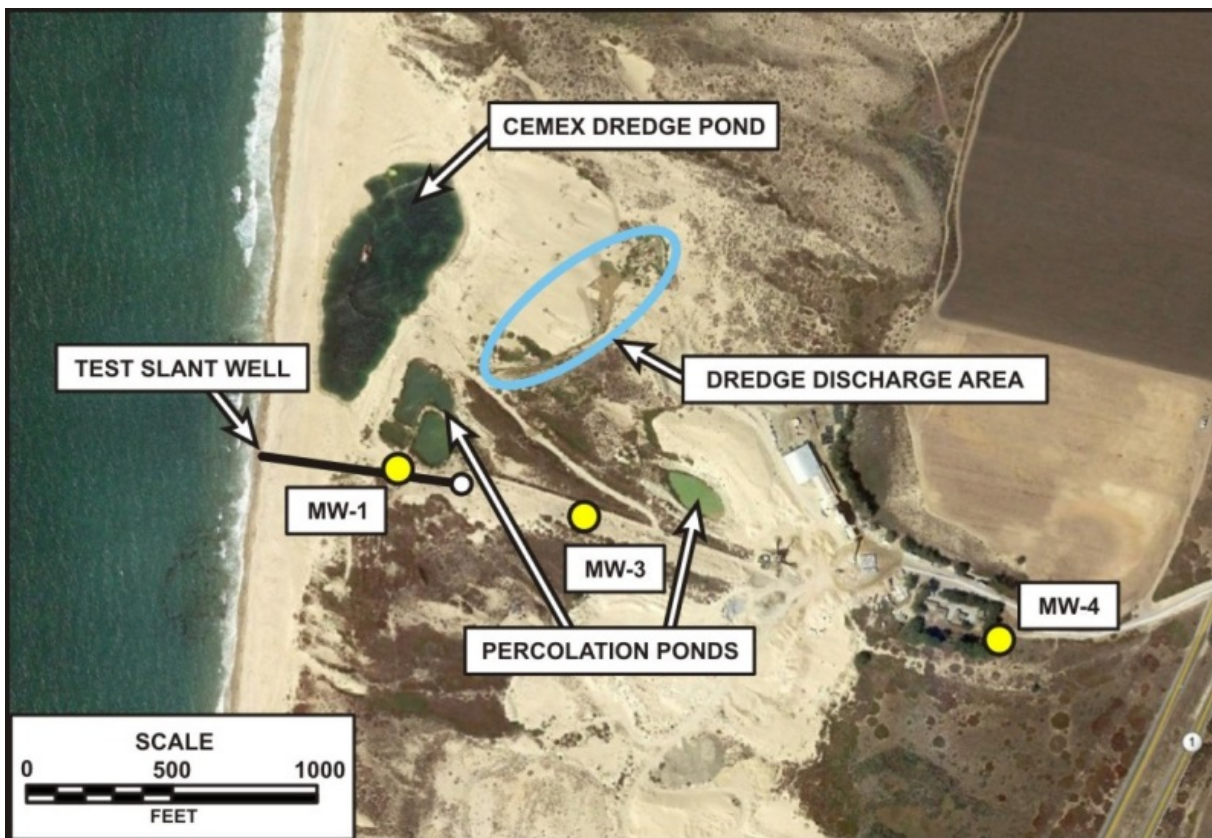

These data also show the perched groundwater condition in the vicinity of MW-5 where the groundwater elevation is 36 feet above mean sea level (msl). The groundwater perched above the Salinas Valley Aquitard equivalent flows toward the coast and results in downward recharge where the aquitard layer thins (or ends) and provides fresh water recharge into the coastal unconfined Dune Sand Aquifer and the underlying 180-Foot Aquifer in the vicinity of MW-7 and MW-8. Figure 4 – Conceptual Drawing of the Hydrogeology in the North Marina Area illustrates the subsurface conditions indicated by these available data.


Figure 4 – Conceptual Drawing of the Hydrogeology in the North Marina Area

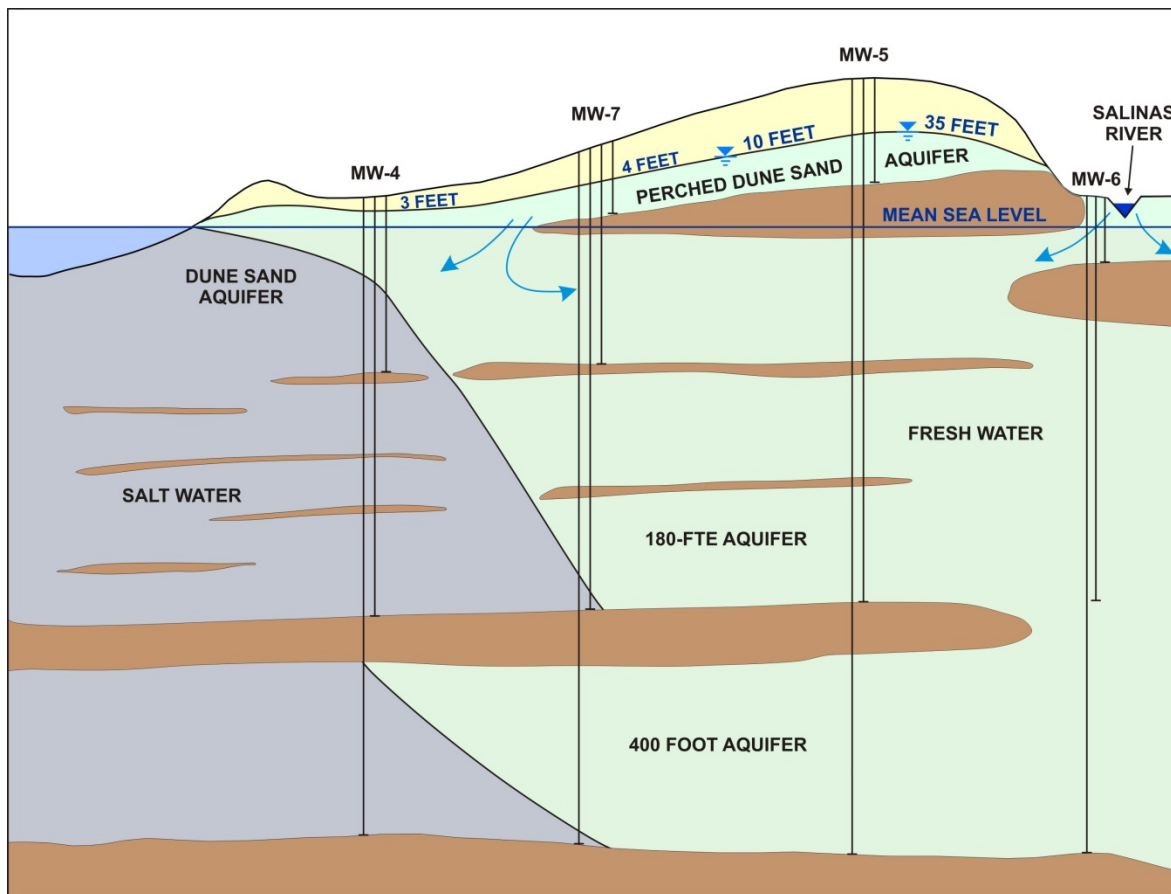

Years of reduced pumping has resulted in beneficial groundwater conditions that are apparently slowing the movement of seawater and providing a freshwater source that is replenishing the aquifers. Notably, the fact that the Dune Sand and 180-Foot Aquifers at Monitoring Well MW-7 are no longer contaminated by high concentrations of seawater can likely be explained by the changing hydrogeological conditions resulting from the efforts of MCWD (e.g., Annexation Agreement, etc.) and others to reduce pumping in the coastal area. As a result, recharge from rainfall into the Dune Sand Aquifer creates a mound of freshwater that flows toward the Salinas River and the ocean.

We further note this protective condition is not isolated in a small area. This coastal condition was previously documented as part of the Fort Ord cleanup effort located southeast of the CEMEX site. The study named the aquitard layer the “Fort Ord-Salinas Valley Aquitard” (FO-SVA). Figure 5 - Perched Dune Sand Aquifer Schematic from Fort Ord Groundwater Monitoring Program shows a drawing of this condition, which was modified to illustrate groundwater flow directions (Ahtna, 2014).

Figure 5 – Perched Dune Sand Aquifer Schematic from Fort Ord Groundwater Monitoring Program

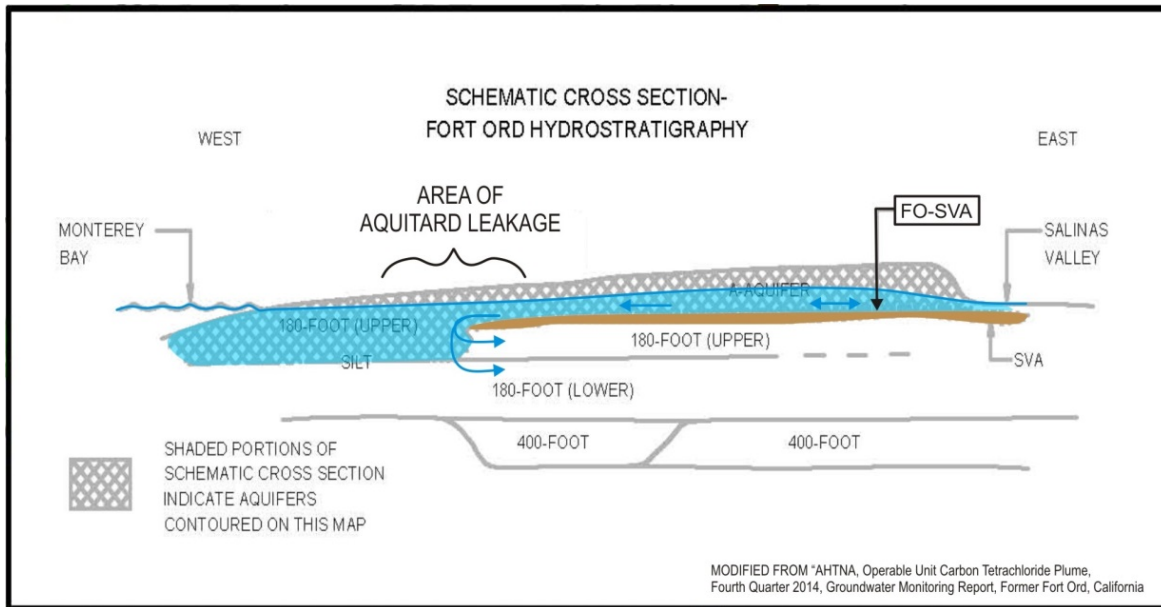

This is a very significant development. Given that the groundwater found with a 36-foot elevation in the Dune Sand Aquifer at the location of MW-5S (and a 6-foot elevation at MW-7S), the Dune Sand Aquifer effectively provides a protective layer preventing seawater intrusion from moving into the Basin at a shallow depth and percolating downward into the underlying aquifers. Instead of allowing a shallow pathway for ocean water, the Dune Sand Aquifer having a potable fresh water quality based on its TDS concentration, appears to be slowly recharging the lower aquifers (i.e., the 180-Foot Aquifer and perhaps 400-Foot Aquifer), which has significantly reduced their TDS levels in this coastal area. This unique condition in the Marina Subarea is believed to provide recharge all along the coast in an area that effectively forms a linear recharge barrier within a mile of the shoreline. The extent of the Fort Ord-Salinas Valley Aquitard was estimated in a 2001 study conducted as part of the Fort Ord cleanup program (Harding ESE, 2001).

Monitoring data indicate that the elevation of the water levels in Monitoring Wells MW-7M and MW-8M are presently lower than the levels in both MW-4M and MW-5M. While the groundwater elevation is near mean sea level, the gradient indicated by the higher level at MW-5M shows that groundwater flows toward the coast up to MW-7 and MW-8 under these conditions. The significance is that after several years of drought conditions, the groundwater gradient between MW-4M (roughly ½ mile from the coast) and MW-5M (almost 2 miles from the coast) is relatively flat in the 180-FTE Aquifer. A significant decline in the groundwater level is observed to occur between MW-5M and MW-6M (see Figure 2). Further study would be required to understand if the mounding indicated in the 400-Foot Aquifer at MW-7 and MW-8 were from vertical recharge from the 180-FTE in this area along the coast.

III. Groundwater Quality Data

Water quality data developed as part of the test slant well project are summarized in the tables included in Attachment C – Laboratory Water Quality Test Results. The first table shown in Attachment C provides the only data published for wells other than the test slant well and MW-4 (Geoscience, 2015a). This table includes laboratory results for wells including MW-1, MW-3, MW-4, MW-5, and the test slant well. The second table in Attachment C is a compilation of laboratory data received by MCWD in October 2015 in response to a data request in the California Public Utilities Commission proceedings. This table includes data for monitoring wells MW-6, MW-7, MW-8, and MW-9 that to our knowledge, have not be published in any of the MPWSP documents.

The significance of these data is that they indicate beneficial conditions have developed (or have always existed) in the North Marina Area of the 180-400 Foot Aquifer Subbasin and may be contrary to information published by the Monterey County Water Resources Agency (MCWRA). The recent investigation that is being conducted in and around the North Marina Area as part of the MPWSP has discovered an occurrence of freshwater within the shallow Dune Sand Aquifer and the underlying 180-Foot Aquifer within the area delineated as seawater intruded by the MCWRA. As previously shown, water level data from wells in the shallow dune sand aquifer appear to show protective water levels that are sufficiently above sea level to prevent seawater intrusion in the shallower sediments. This condition, combined with the lack of pumping in the 180-Foot Aquifer in the North Marina Area, appears to have slowed seawater intrusion in this portion of the coastline. Water quality test results for total dissolved solids and chloride concentrations in these two uppermost aquifer zones are shown on Figures 6 and 7 – Average Total Dissolved Solids Concentrations in Groundwater and Average Chloride Concentrations in Groundwater, respectively.

These data suggest a change of groundwater conditions in this coastal section of the aquifer or alternatively, they may reveal the groundwater conditions that existed in an area largely lacking historical data. While the freshwater in this area contains salts and nutrients that are derived from overlying land uses that include agriculture, landfill, and wastewater treatment plant and composting facilities, the chemical character is not sodium chloride, which is indicative of seawater intrusion. Figure 8 and 9 – Stiff Diagrams of Dune Sand Aquifer Groundwater and 180-Foot Aquifer Groundwater, respectively show that the chemical character of groundwater in these new wells is predominantly calcium chloride and calcium bicarbonate. Additionally, elevated concentrations of nitrate are present in monitoring wells MW-5S, MW-7S and MW-8S and range from 115 mg/l to 237 mg/l. The concentration of nitrate decreases with depth at all of these sites, and is the highest at MW-5, which is closest to the landfill and the wastewater treatment facilities. Future use of this area for a direct potable groundwater supply may be unlikely; however, existing conditions do show abatement of seawater intrusion in the shallower aquifer zones in this coastal portion of the Salinas Valley Groundwater Basin. This condition may support the future beneficial uses of the 180-Foot Aquifer zone potentially including aquifer storage and recovery of highly purified recycled water for indirect potable reuse.

**Figure 6 – Average Total Dissolved Solids
 Concentrations in Groundwater**

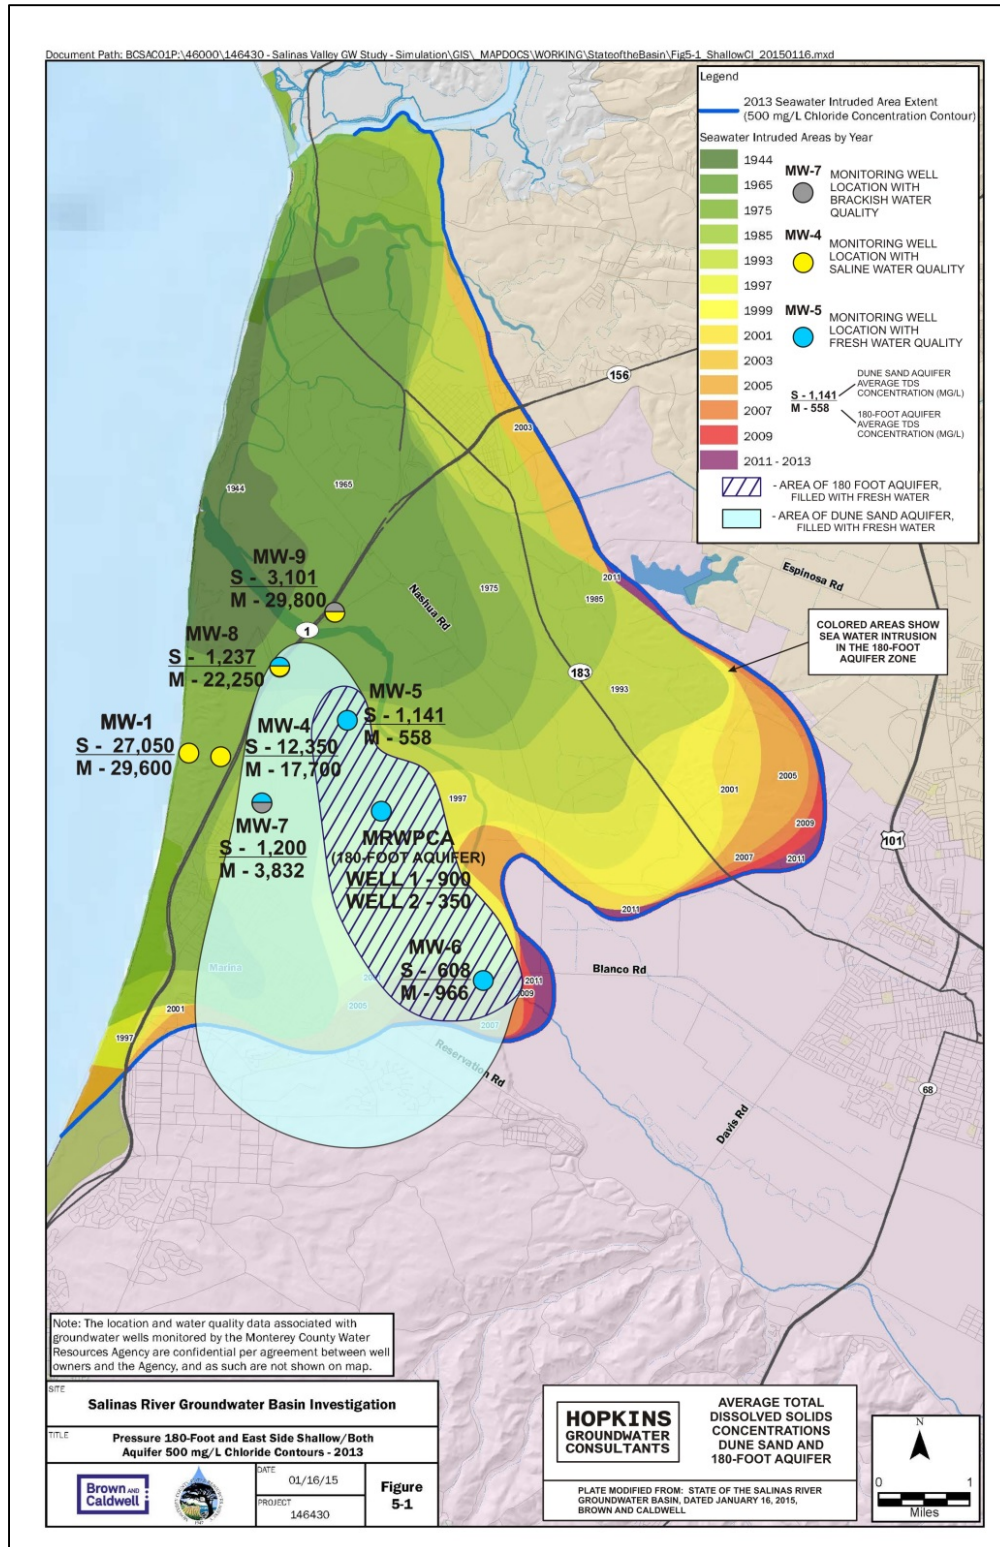


Figure 7 – Average Chloride Concentrations in Groundwater

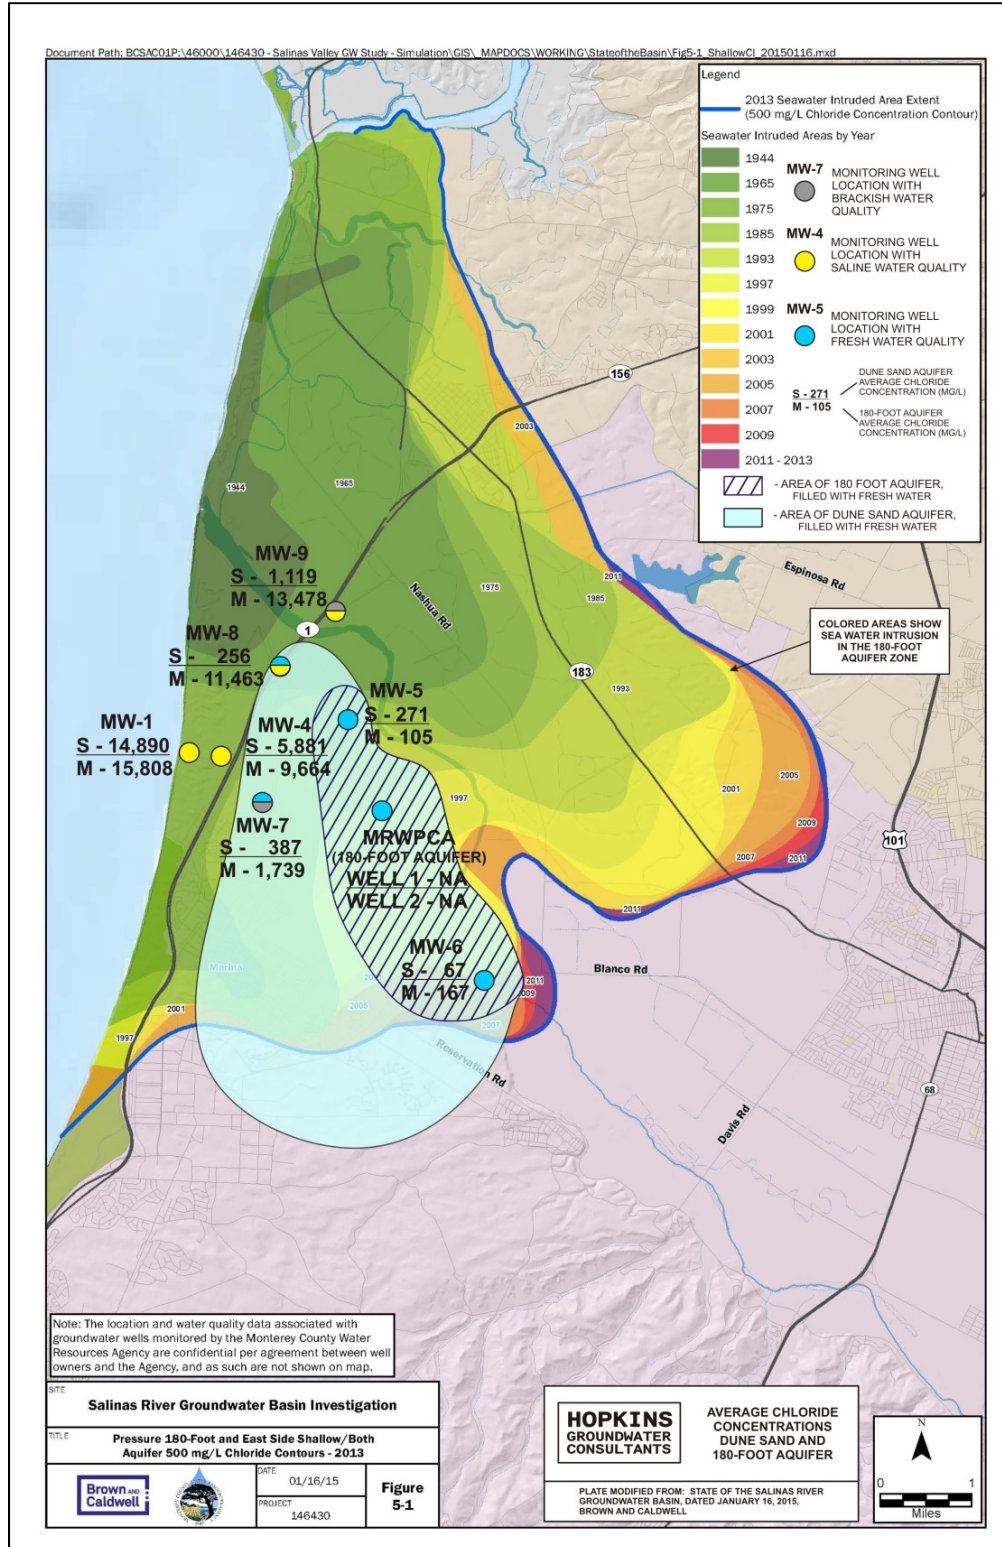


Figure 8 – Stiff Diagrams of Dune Sand Aquifer Groundwater


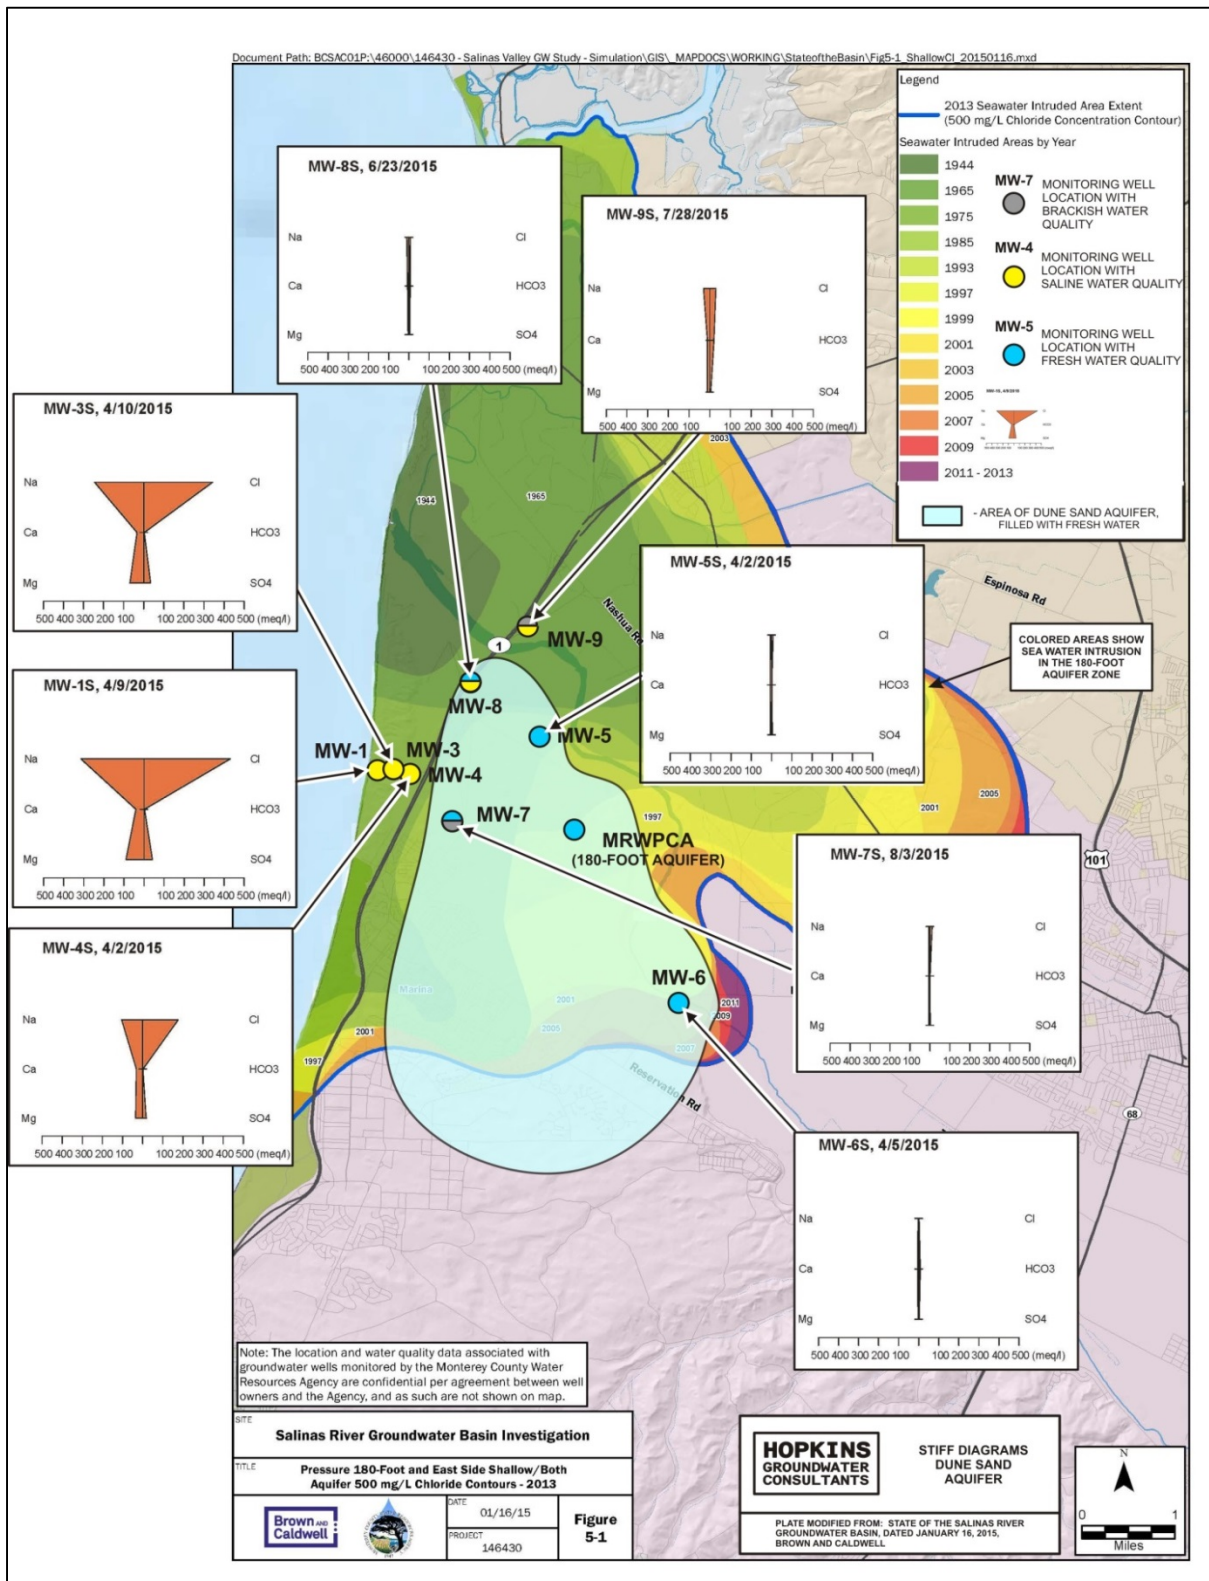


Figure 9 – Stiff Diagrams of 180-Foot Aquifer Groundwater

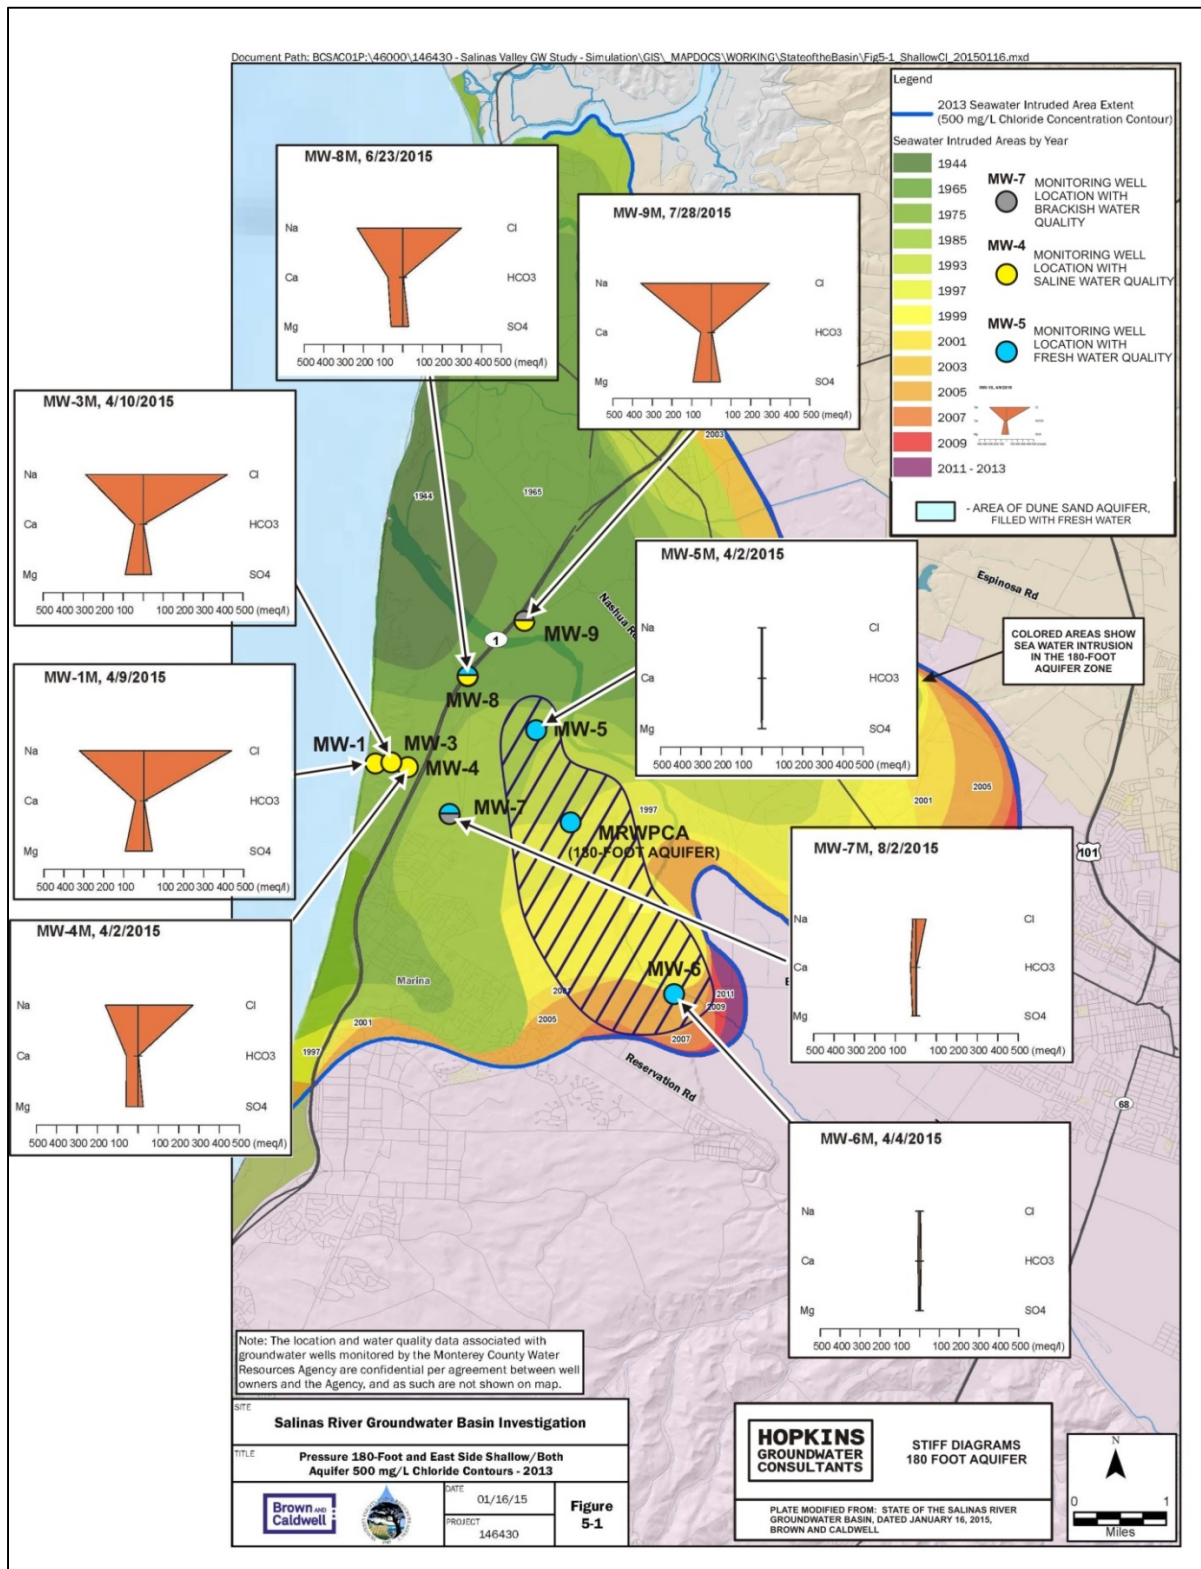


These data indicate a unique condition exists in the North Marina Subarea south of the Salinas River that provides a significant degree of protection against seawater intrusion in the shallower aquifers under the present and recent past hydrologic conditions. Figure 10 – Percent Groundwater with Distance From the Shoreline shows the rudimentary calculation of groundwater percentage versus ocean water percentage using the same equation applied to the test slant well discharge. The percentage of fresh groundwater in well water samples was calculated using the following equation:

$$GWP = [1 - (WSS - GWS / OWS - GWS)] \times 100$$

Where: GWP = Percent Groundwater
 WSS = Well Sample Salinity (mg/l)
 GWS = Groundwater Salinity (420 mg/l)
 OWS = Ocean Water Salinity (33,500 mg/l)

Figure 10 – Percent Groundwater with Distance From the Shoreline

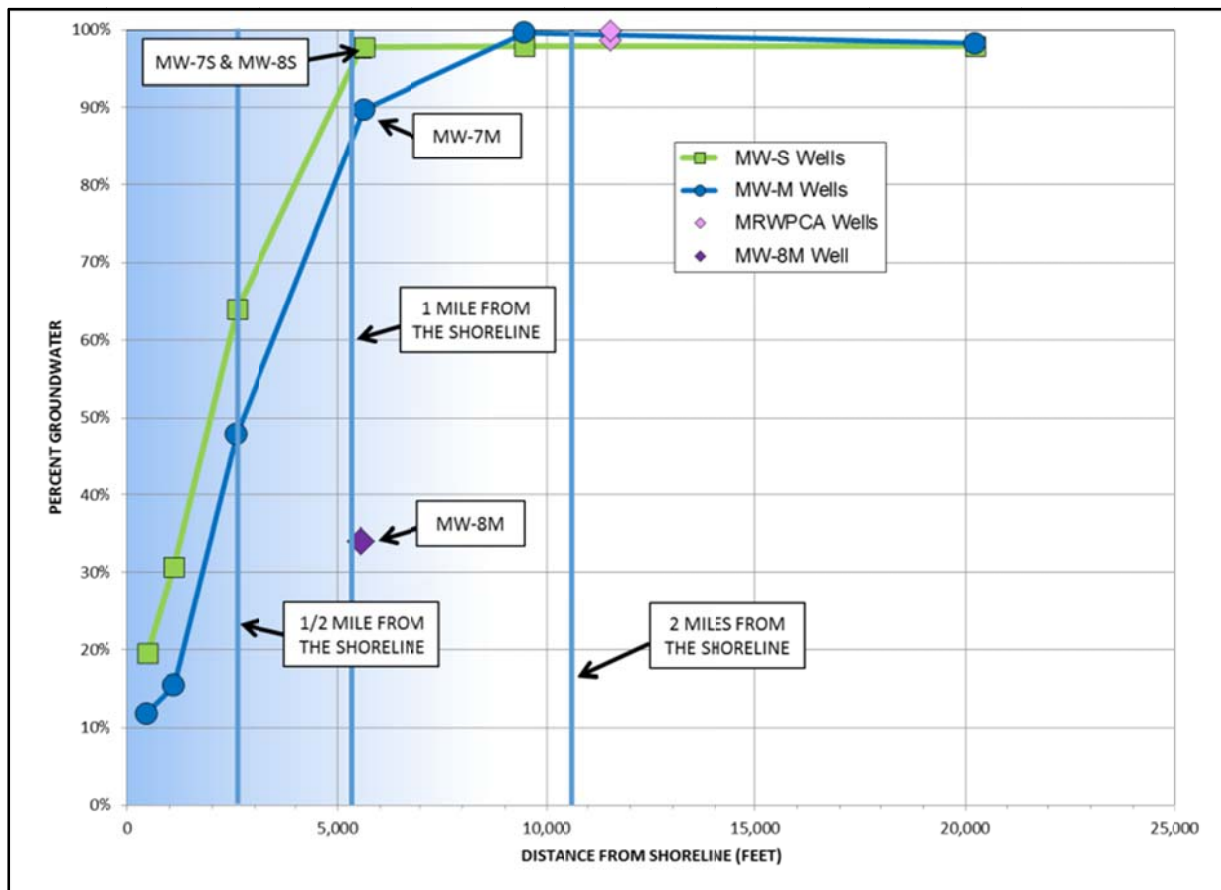

Water quality data for this analysis were provided by the laboratory test results summarized in Attachment C. These available data show that the percentage of ocean water decreases significantly within a short distance from the coastline in the North Marina Area and the salinity of groundwater that is comparable to seawater is not up to 8 miles inland in the 180-Foot Aquifer as assumed by previous study. Calculation of percent ocean water using this method cannot differentiate between salts from overlying land uses and salt from ocean water. This calculation assumes that all salt in groundwater with a TDS above a concentration of 420 mg/l is from ocean water.

As shown in Figure 10, monitoring wells MW-5M and MW-6M along with the Monterey Regional Water Pollution Control Agency (MRWPCA) Wells are located in the 180-Foot Aquifer and the average TDS concentration for samples from these wells ranges from approximately 454 to 966 milligrams per liter (mg/l) and is also considered fresh water (See Figure 4 and Attachment C). However, the TDS concentration for MW-7M (3,832 mg/l) and MW-8M (22,250 mg/l) show that closer to the coast and closer to the main portion of the Basin north of the river, seawater has impacted the underlying 180-Foot Aquifer as shown in Figure 9 and 10.

We trust this review of available data provides a better understanding of what the MPWSP test slant well monitoring program has discovered. It is clear that without the new monitoring wells, this type of understanding about groundwater conditions in the North Marina Area could not have been provided from available data.

Sincerely,

HOPKINS GROUNDWATER CONSULTANTS, INC.



Curtis J. Hopkins

Principal Hydrogeologist

Certified Engineering Geologist, EG1800

Certified Hydrogeologist, HG114

Attachments: Plate 1 – Cross-Section A-A'

Plate 2 – Well Location Map

Attachment A – Well Construction Information


Attachment B – MPWSP Water Level Data

Attachment C – Laboratory Water Quality Test Results

References

- Ahtna Environmental Inc. (Ahtna, 2015), *Operable Unit Carbon Tetrachloride Plume Fourth Quarter 2014 Groundwater Monitoring Report, Former Fort Ord, California*, Prepared for Department of the Army, U.S. Army Corps of Engineers, Dated February.
- Brown and Caldwell (B&C, 2015), *State of the Salinas River Groundwater Basin*, Prepared for Monterey County Resource Management Agency, dated January 16.
- Geoscience Support Services, Inc. (Geoscience, 2013), *Technical Memorandum, Protective Elevations to Control Sea Water Intrusion in the Salinas Valley*, Prepared for Monterey County Water Resources Agency, Dated November 19.
- Geoscience Support Services, Inc. (Geoscience, 2014), *Monterey Peninsula Water Supply Project, Hydrogeologic Investigation, Technical Memorandum (TM1) Summary of Results – Exploratory Boreholes*, Prepared for California American Water, RBF Consulting, Dated July 8.
- Geoscience Support Services, Inc. (Geoscience, 2015), *Monterey Peninsula Water Supply Project, Groundwater Modeling and Analysis, Draft*, Prepared for California American Water and Environmental Science Associates, Dated April 17.
- Geoscience Support Services, Inc. (Geoscience, 2015a), *Technical Memorandum, Monterey Peninsula Water Supply Project, Baseline Water and Total Dissolved Solids Levels, Test Slant Well Area*, Submitted to the Hydrogeologic Working Group, Dated April 20.
- Geoscience Support Services, Inc. (Geoscience, 2016), *Monterey Peninsula Water Supply Project, Test Slant Well Long Term Pumping Monitoring Report No. 55, 11-May-16 – 18-May-16, Coastal Development Permit #A-3-MrA-14-0050 and Amendment No. #A-3-MrA-14-0050-A1*, Prepared for California American Water, Dated May 24.
- Harding ESE (2001), *Final Report Hydrogeologic Investigation of the Salinas Valley Basin in the Vicinity of Fort Ord and Marina, Salinas Valley, California*, Dated April.
- Kennedy-Jenks Consultants (KJC, 2004), *Hydrostratigraphic Analysis of the Northern Salinas Valley*, Prepared for Monterey County Water Resources Agency, Dated May 14.
- Monterey County Water Resources Agency (MCWRA, 2014), *Historic Seawater Intrusion Map, Pressure 180-Foot Aquifer – 500 mg/L Chloride Areas and Pressure 400-Foot Aquifer*, Dated December 16.
- Regional Water Quality Control Board, Central Coast Region, State Water Resources Control Board, California Environmental Protection Agency, (RWQCB, 2011), *Water Quality Control Plan for the Central Coastal Basin*, Dated June.

PLATES

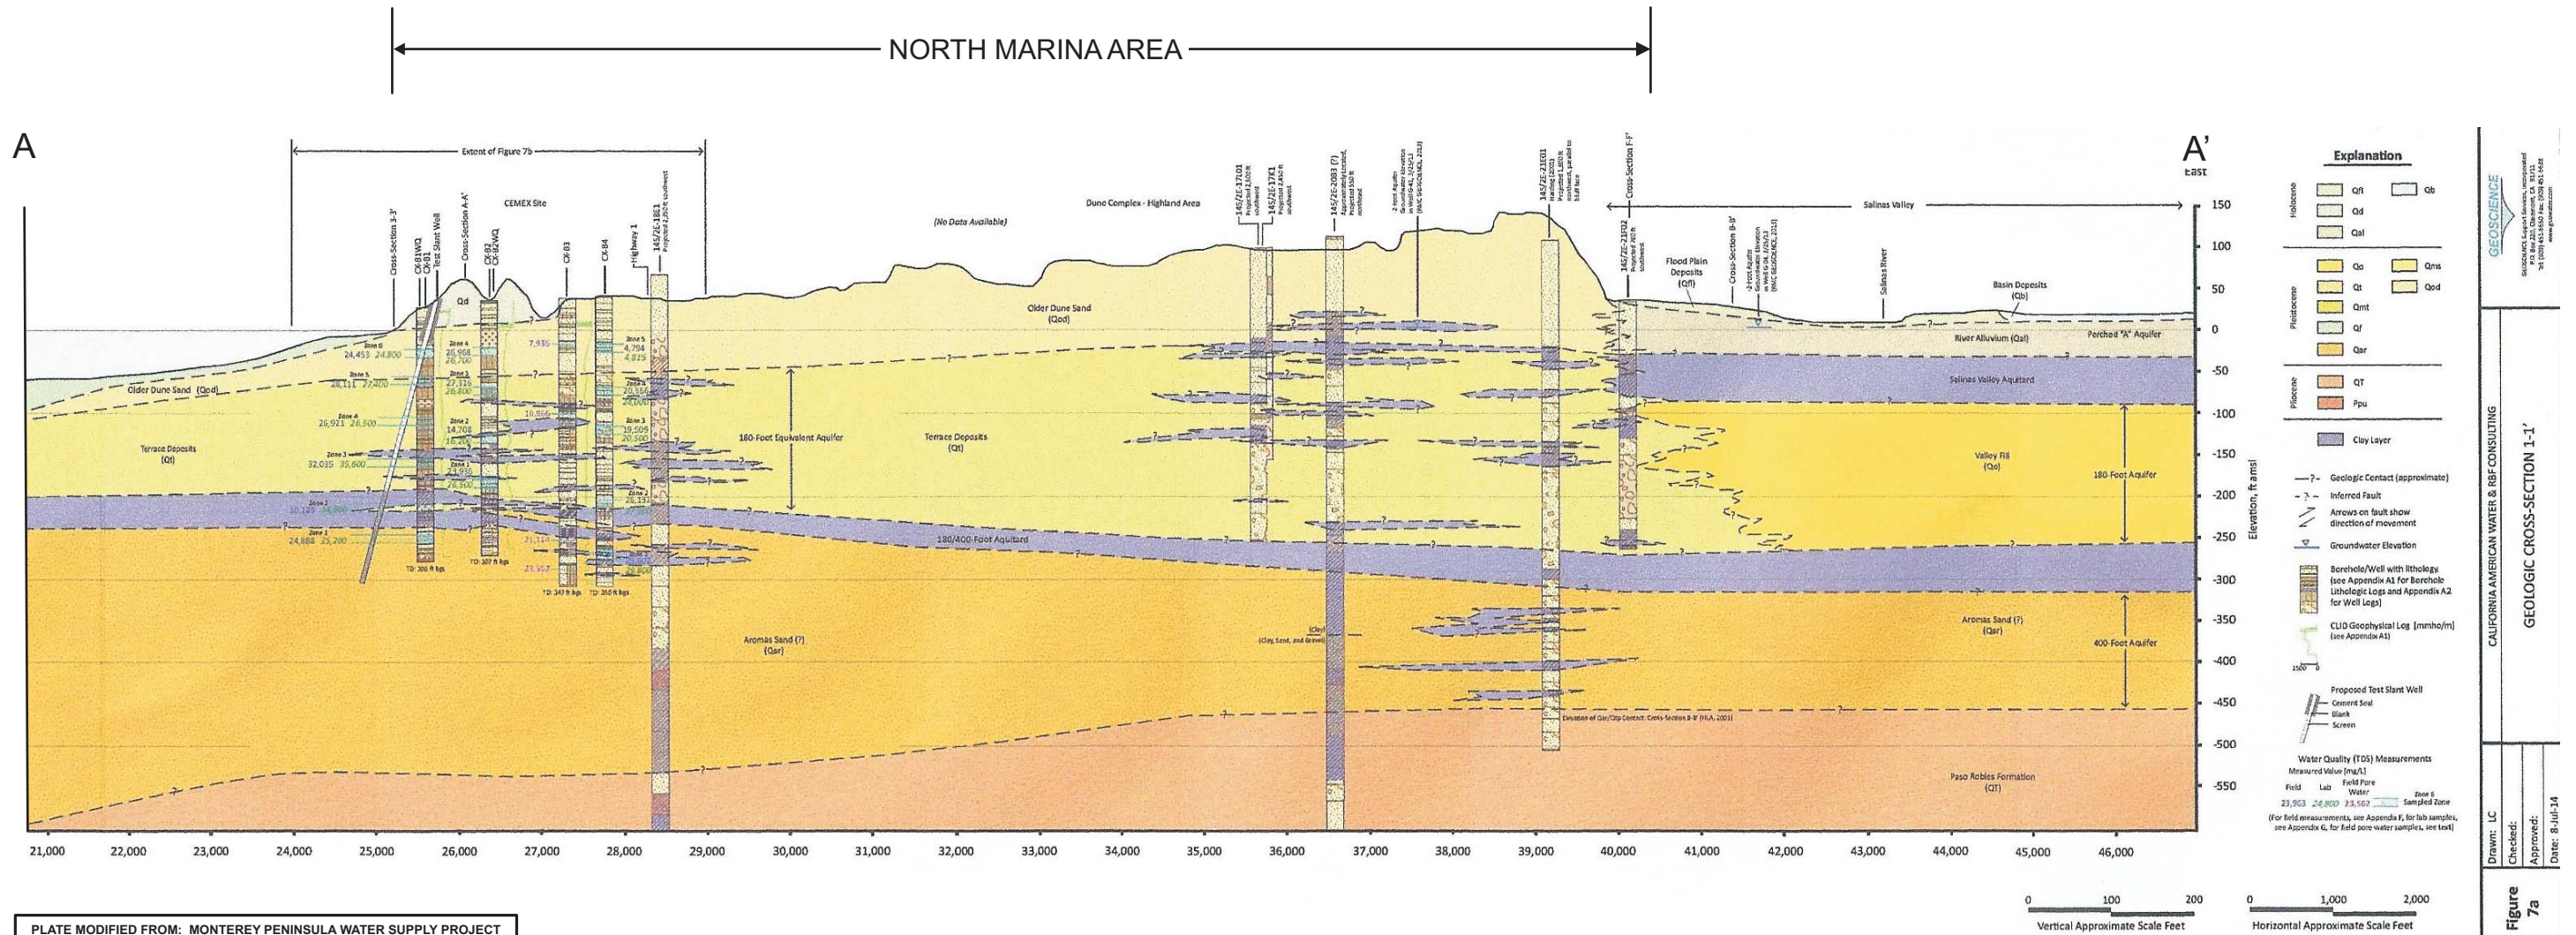

CROSS-SECTION A-A'
Technical Memorandum
Marina Coast Water District
Marina, California

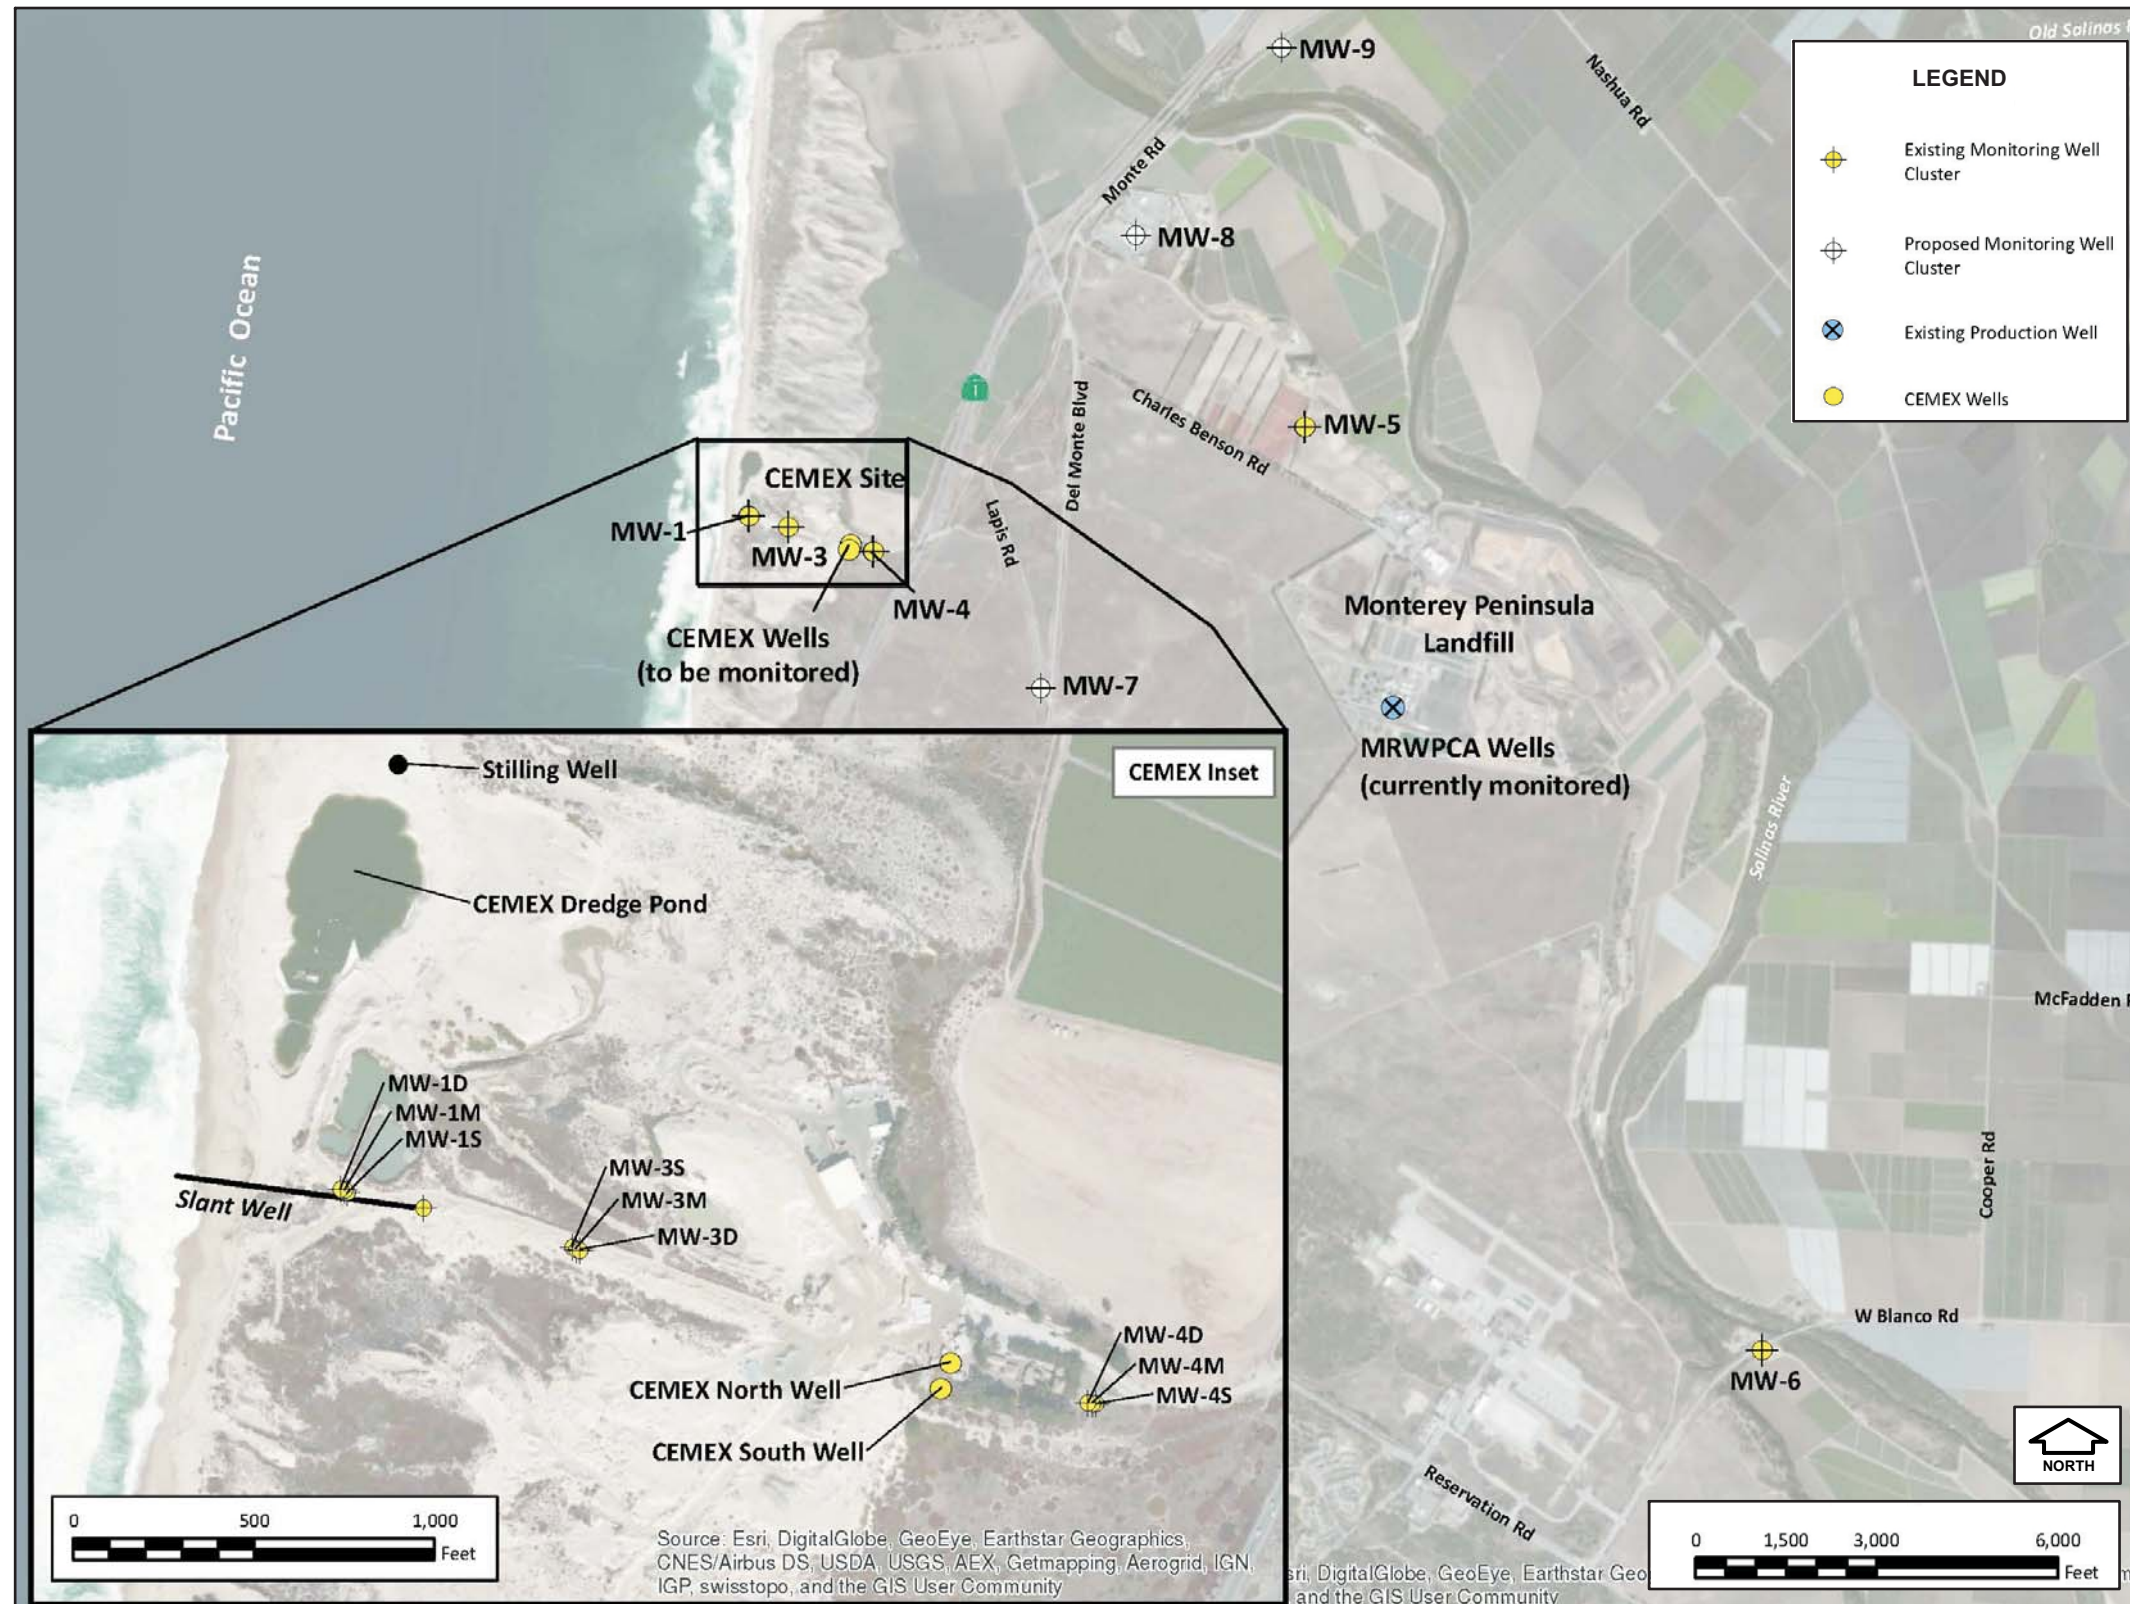


PLATE MODIFIED FROM: MONTEREY PENINSULA WATER SUPPLY PROJECT
 TEST SLANT WELL LONG TERM PUMPING MONITORING REPORT NO. 55
 DATED MAY 24, 2016, GEOSCIENCE SUPPLY SERVICES, INC.

WELL LOCATION MAP
Technical Memorandum
 Marina Coast Water District
 Marina, California

**ATTACHMENT A
WELL CONSTRUCTION INFORMATION**

Table 1: Well Information Table

State Plane Coordinates													
Well Name	Cluster	Reference Point (RP)	Northing	Easting	RP Elevation ft NAVD88	RP Height (ft above GS)	Distance of RP from Slant Well Head (ft)	Top of Screen Interval (ft below GS)	Bottom of Screen Interval (ft below GS)	Transducer Installed Depth (ft below RP)	Survey Date	Data Logging Start Date	Data Collected
MW-1S	MW-1	Top of ABS Transducer Mount	2,154,745.35	5,739,355.82	30.51 ¹	2.65 ¹	211	55	95	76	26-Mar-15	19-Feb-15	Level, Conductivity
MW-1M	MW-1	Top of ABS Transducer Mount	2,154,751.93	5,739,347.94	29.86	2.48	220	115	225	182	26-Mar-15	19-Feb-15	Level, Conductivity
MW-1D	MW-1	Top of ABS Transducer Mount	2,154,753.60	5,739,337.98	29.68 ¹	2.65 ¹	230	277	327	309	26-Mar-15	19-Feb-15	Level, Conductivity
MW-3S	MW-3	Top of ABS Transducer Mount	2,154,599.85	5,739,977.02	37.16	2.66	428	50	90	76	26-Mar-15	4-Mar-15	Level, Conductivity
MW-3M	MW-3	Top of ABS Transducer Mount	2,154,592.96	5,739,988.54	37.35	2.73	441	105	215	182	26-Mar-15	4-Mar-15	Level, Conductivity
MW-3D	MW-3	Top of ABS Transducer Mount	2,154,589.81	5,739,998.68	36.93	2.74	451	285	330	321	26-Mar-15	4-Mar-15	Level, Conductivity
MW-4S	MW-4	Top of ABS Transducer Mount	2,154,170.90	5,741,427.62	41.96	2.26	1,940	60	100	66	26-Mar-15	9-Mar-15	Level, Conductivity
MW-4M	MW-4	Top of ABS Transducer Mount	2,154,172.79	5,741,416.78	41.99	2.15	1,929	130	260	208	26-Mar-15	9-Mar-15	Level, Conductivity
MW-4D	MW-4	Top of ABS Transducer Mount	2,154,174.30	5,741,406.08	41.95	2.15	1,918	290	330	317	26-Mar-15	20-Feb-15	Level, Conductivity
MW-5S	MW-5	Top of ABS Transducer Mount	2,156,239.19	5,748,566.86	80.25 ¹	2.20 ¹	9,135	43	83	71	26-Mar-15	10-Mar-15	Level, Conductivity
MW-5M	MW-5	Top of ABS Transducer Mount	2,156,230.38	5,748,564.26	80.48 ¹	2.31 ¹	9,131	100	310	171	26-Mar-15	10-Mar-15	Level, Conductivity
MW-5D	MW-5	Top of ABS Transducer Mount	2,156,220.77	5,748,560.95	80.06	1.97	9,126	395	435	417	26-Mar-15	19-Feb-15	Level, Conductivity
MW-6S	MW-6	Top of ABS Transducer Mount	2,141,142.87	5,756,164.01	35.89	2.45 ¹	21,436	30	60	61	1-Oct-15	22-Apr-15	Level, Conductivity
MW-6M	MW-6	Top of ABS Transducer Mount	2,141,138.40	5,756,154.35	35.68	2.44 ¹	21,431	150	210	103	1-Oct-15	22-Apr-15	Level, Conductivity
MW-6D	MW-6	Top of ABS Transducer Mount	2,141,133.06	5,756,144.94	35.82	2.42 ¹	21,427	255	325	201	1-Oct-15	22-Apr-15	Level, Conductivity
MW-7S	MW-7	Top of ABS Transducer Mount	2,152,099.25	5,744,148.10	50.64	2.06	5,274	60	80	72	1-Oct-15	13-Aug-15	Level, Conductivity
MW-7M	MW-7	Top of ABS Transducer Mount	2,152,110.46	5,744,146.08	50.29	2.09	5,266	130	220	187	1-Oct-15	13-Aug-15	Level, Conductivity
MW-7D	MW-7	Top of ABS Transducer Mount	2,152,120.50	5,744,144.38	50.24	2.24	5,260	295	345	322	1-Oct-15	13-Aug-15	Level, Conductivity
MW-8S	MW-8	Top of ABS Transducer Mount	2,159,440.33	5,744,871.52	19.96	2.14 ³	7,116	40	80	-	1-Oct-15	30-May-15	Hand Level
MW-8M	MW-8	Top of ABS Transducer Mount	2,159,430.86	5,744,866.05	19.99	2.17 ²	7,106	125	215	181	1-Oct-15	30-May-15	Level, Conductivity
MW-8D	MW-8	Top of ABS Transducer Mount	2,159,421.47	5,744,861.04	20.08	2.10 ³	7,096	300	350	-	1-Oct-15	30-May-15	Hand Level
MW-9S	MW-9	Top of ABS Transducer Mount	2,162,010.77	5,747,345.03	18.42	2.16 ³	10,677	30	110	-	1-Oct-15	1-Jul-15	Hand Level
MW-9M	MW-9	Top of ABS Transducer Mount	2,162,016.58	5,747,353.64	18.32	2.13 ²	10,687	145	225	182	1-Oct-15	29-Jun-15	Level, Conductivity
MW-9D	MW-9	Top of ABS Transducer Mount	2,162,022.89	5,747,362.25	18.32	2.15 ³	10,697	353	393	-	1-Oct-15	26-Jun-15	Hand Level
Well No. 1 ⁴	MRWPCA	Well Cover	2,151,622.14	5,750,015.59	114 ft amsl (GS)	1.60	10,898	260	340	299	-	19-Feb-15	Level, Conductivity
Well No. 2 ⁴	MRWPCA	Well Cover	2,151,550.18	5,749,987.41	115 ft amsl (GS)	1.65	10,892	260	340	319	-	19-Feb-15	Level, Conductivity
CEMEX Dredge Pond	CEMEX	Top of ABS Transducer Mount	2,155,912.41	5,739,497.26	14.14	8.92 [*]	1,212	-	-	-	26-Mar-15	8-Mar-15	Level, Conductivity
Test Slant Well	CEMEX	Near Ground Surface	2,154,702.56	5,739,561.92	30.86	0	0	46 ^{**}	231 ^{**}	305MD	26-Mar-15	1-Apr-15	Level, Conductivity
CEMEX North Well	CEMEX	Well Cover	2,154,284.48	5,741,032.07	39.20	0.25	1,529	244	481	150	1-Oct-15	1-Apr-15	Level, Conductivity
CEMEX South Well ⁴	CEMEX	Ground Surface	2,154,213.90	5,740,998.57	31 ft amsl (GS)	0	1,518	400	506	-	-	-	-

Horizontal Datum: NAD83 State Plane Zone 4
 Vertical Datum: NAVD88
¹ RP/elevation change on May 17, 2015 - New caps
² RP/elevation change on July 17, 2015 - New caps
³ RP/elevation change on September 24, 2015 - New caps
⁴ Estimated - not surveyed.
 MD: Measured Depth - lineal feet along the angle of the slant well
 GS: Ground Surface - approximate ground surface elevation based on Google Earth
 * RP height above pond water level 5.22 ft NAVD88 (8-11 am 26-Mar-15)
 ** Top of 18 in. screen = 140 ft x Sin(19) = 46 ft TVD, Bottom of 14 in. screen = 710 x Sin(19) = 231 ft TVD

**ATTACHMENT B
MPWSP WATER LEVEL DATA**

Groundwater Elevation in MPWSP MW-1

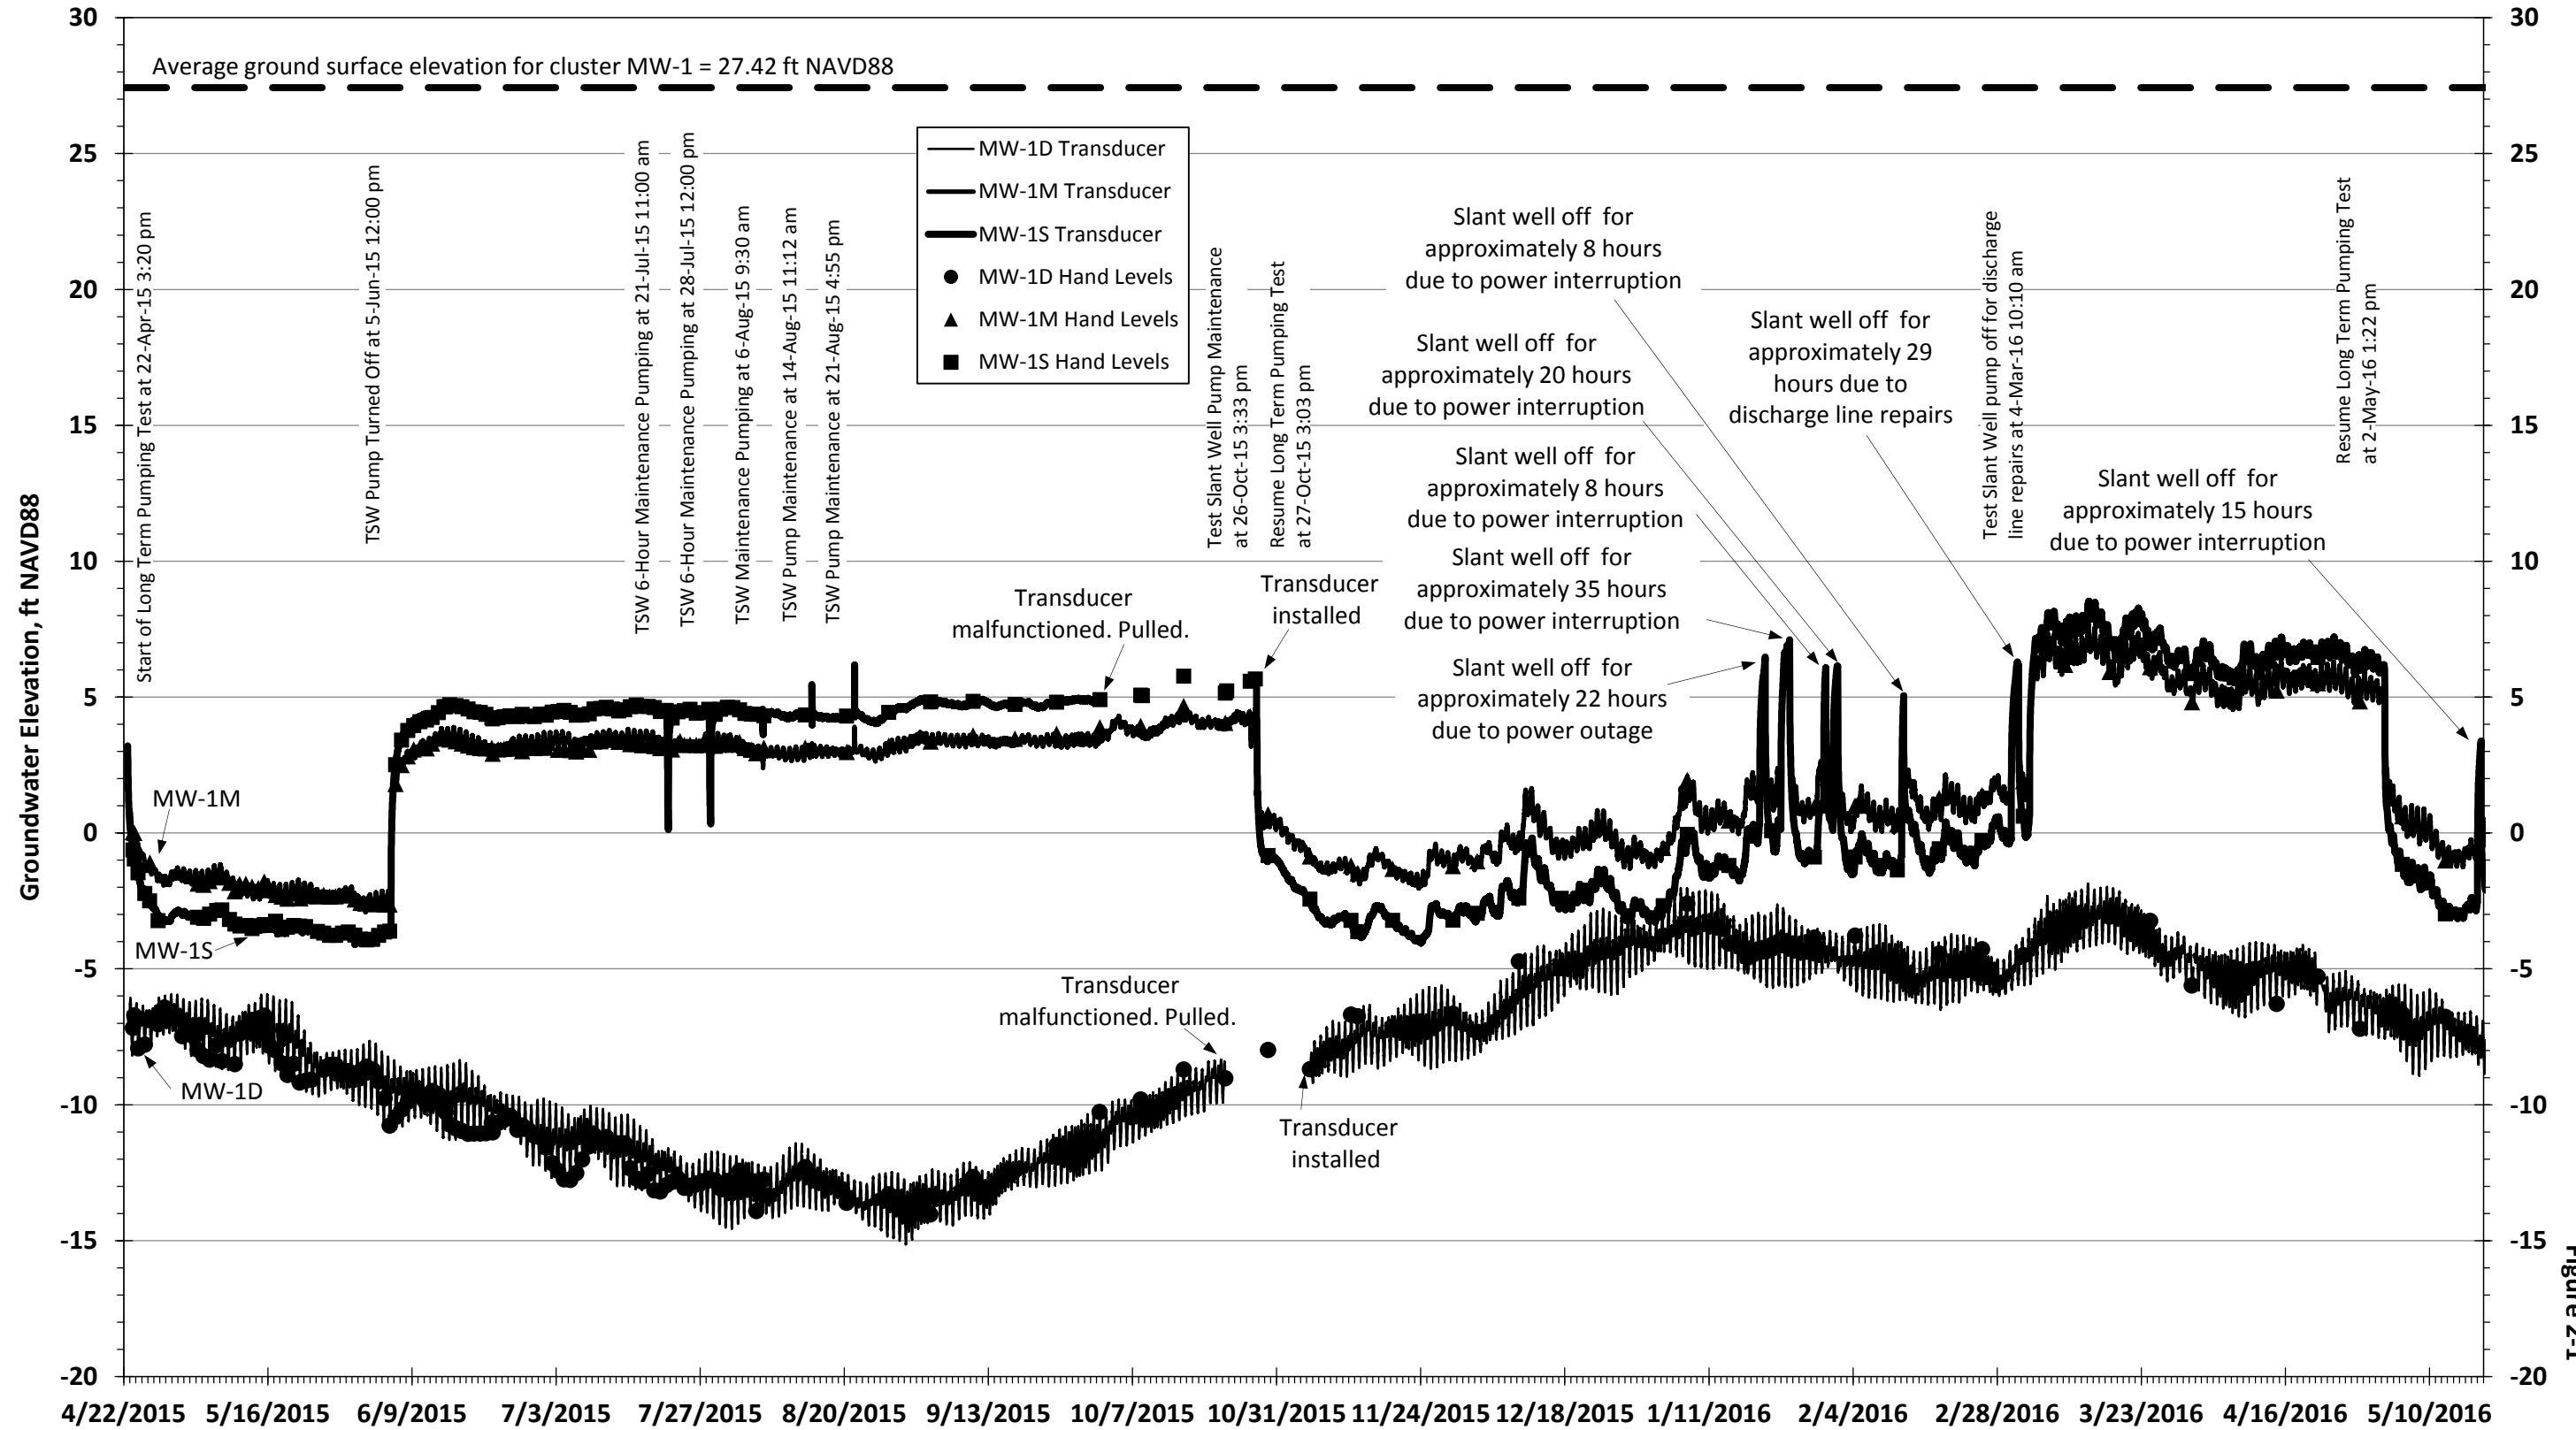


Figure 2-1

Groundwater Elevation in MPWSP MW-3

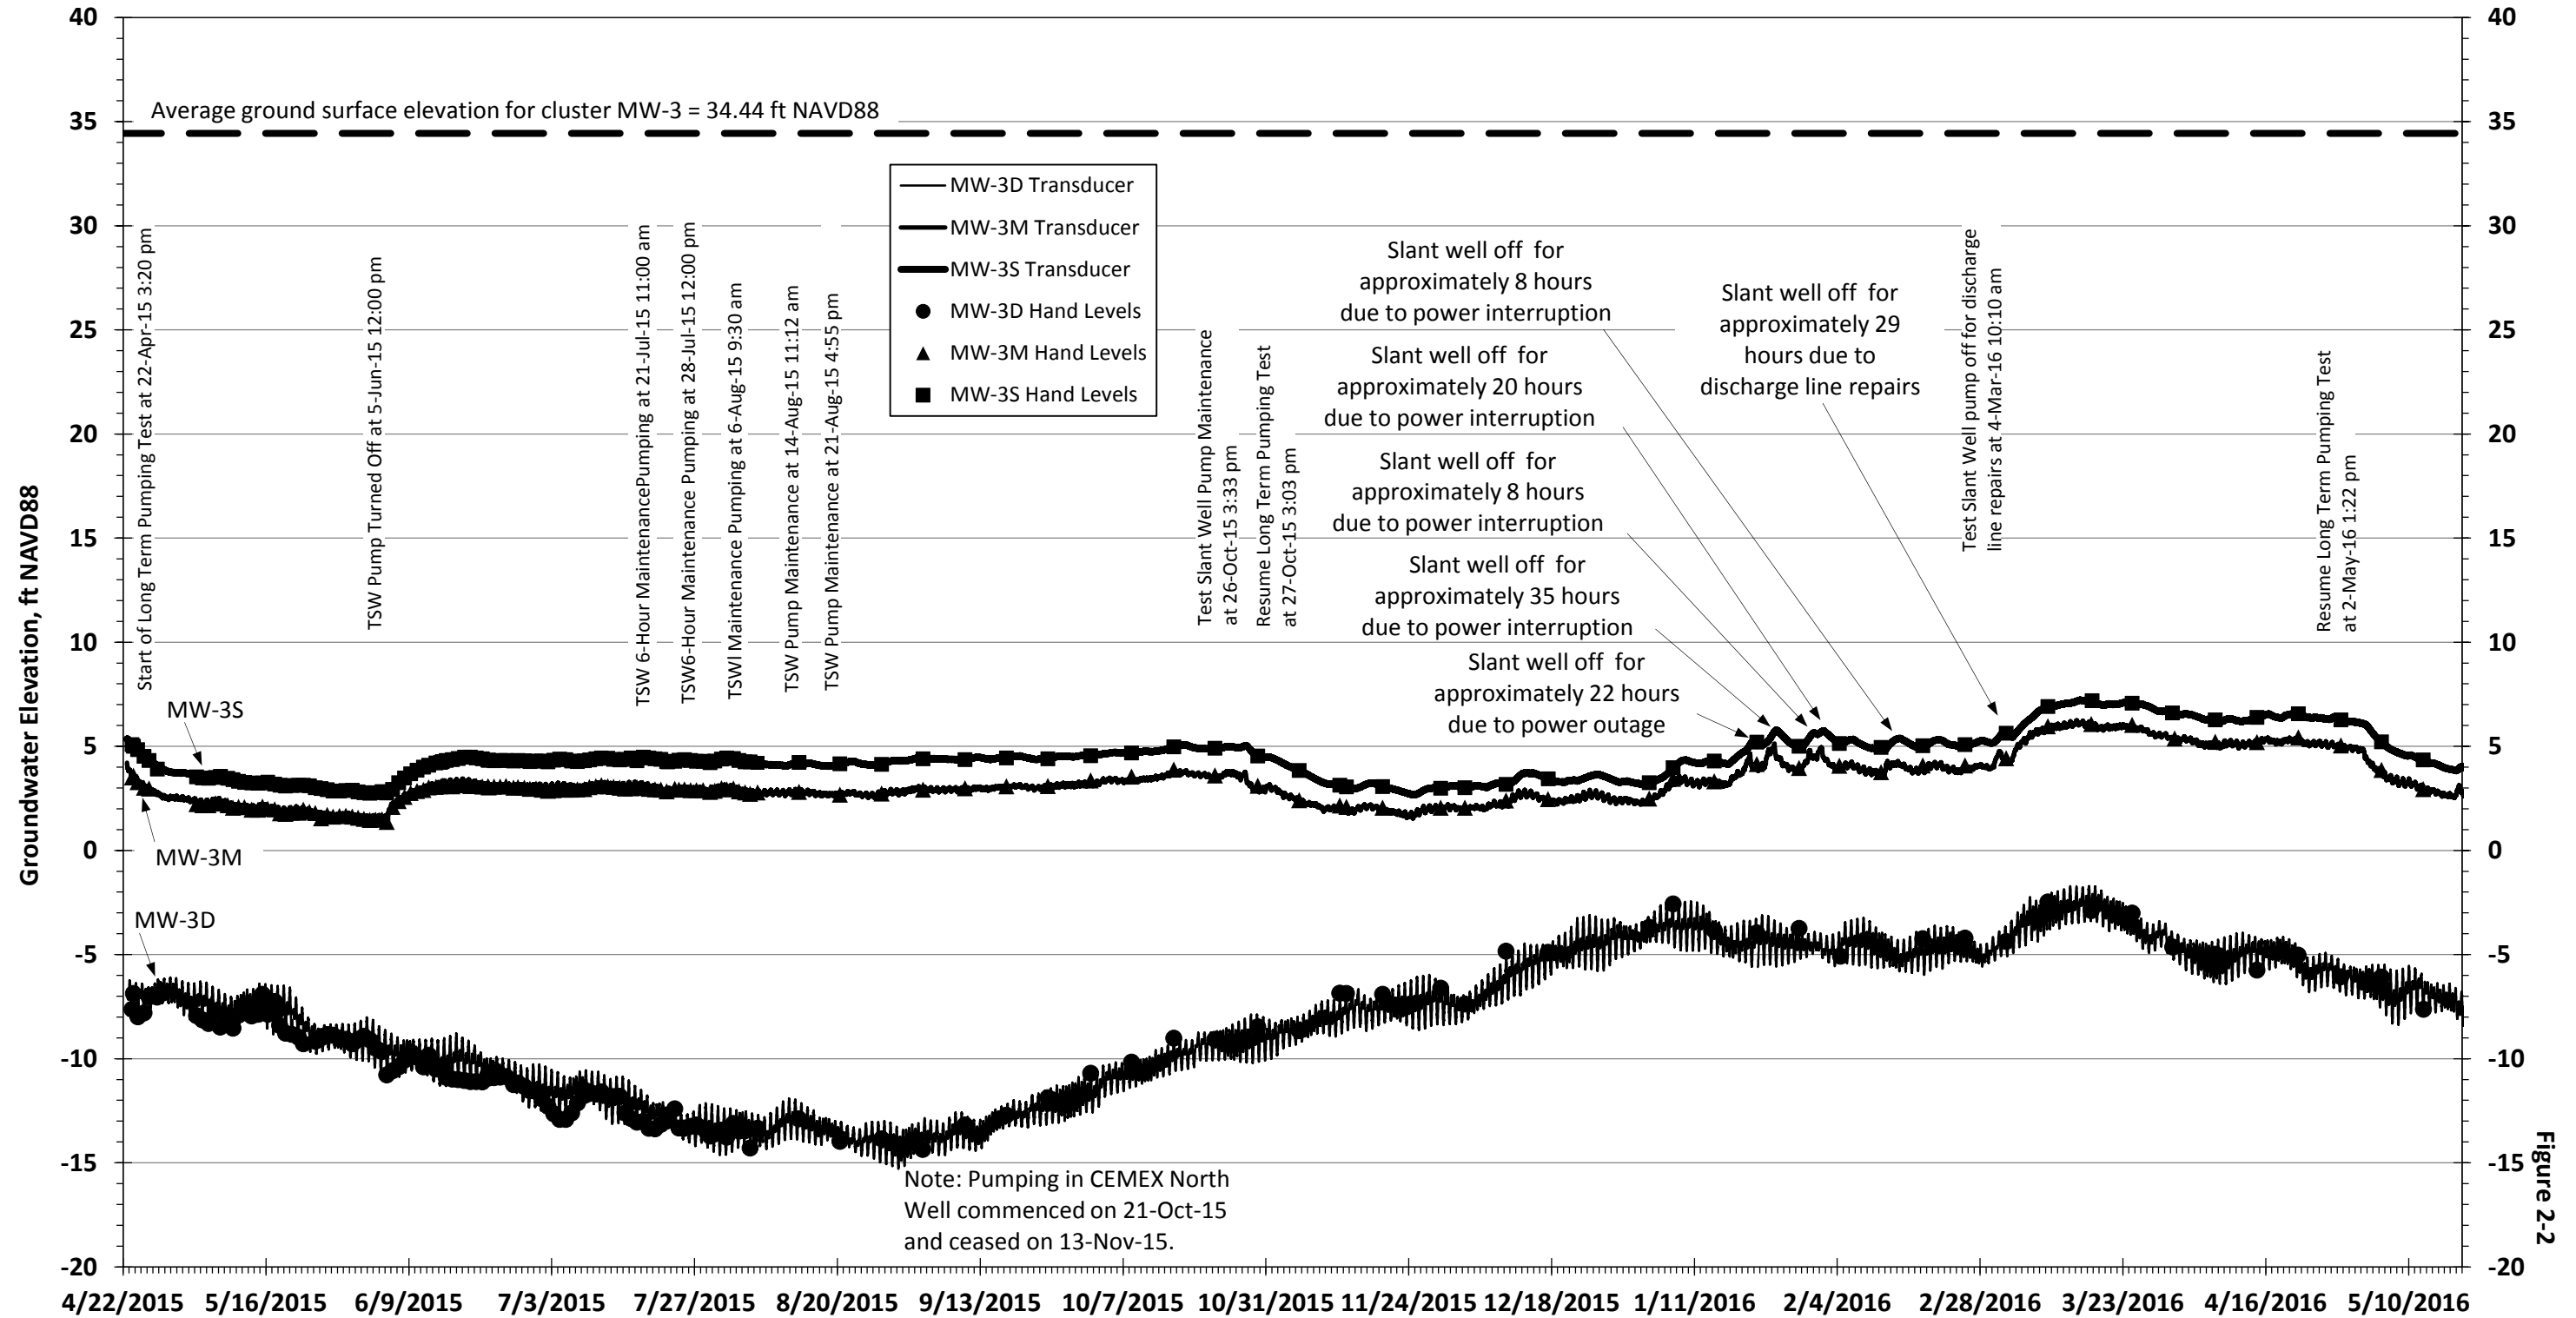


Figure 2-2

Groundwater Elevation in MPWSP MW-4

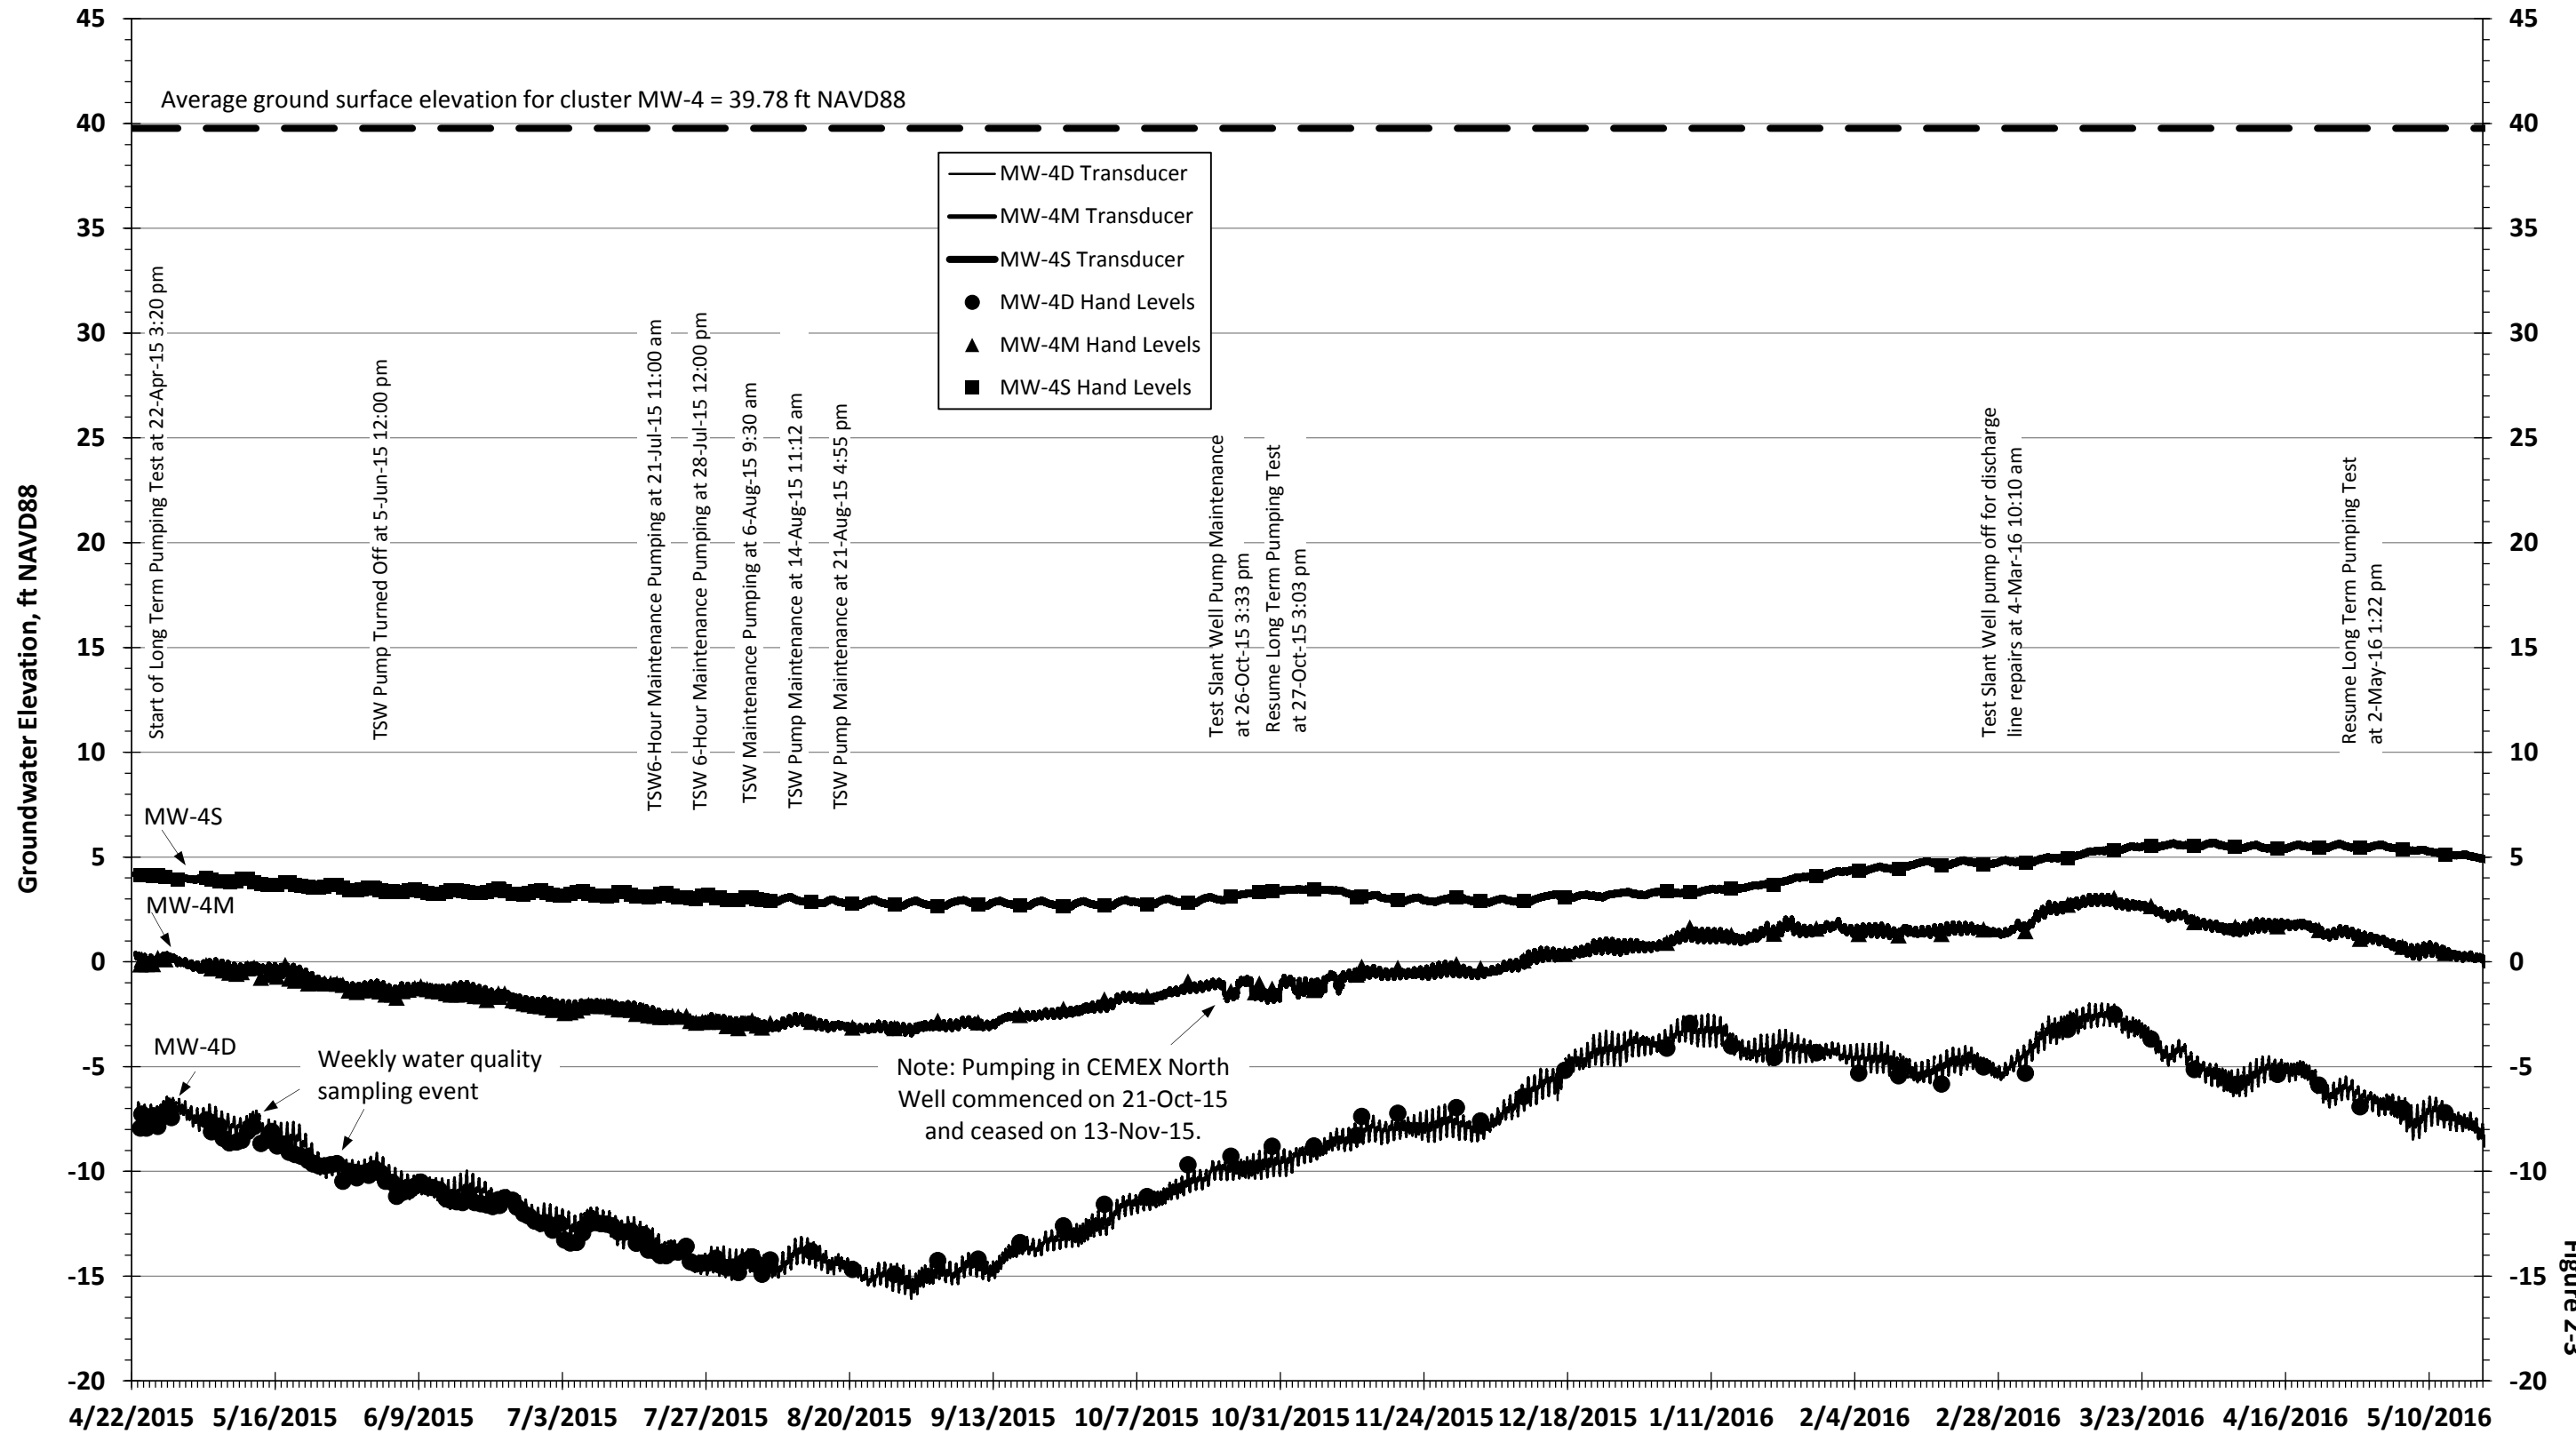


Figure 2-3

Groundwater Elevation in MPWSP MW-5

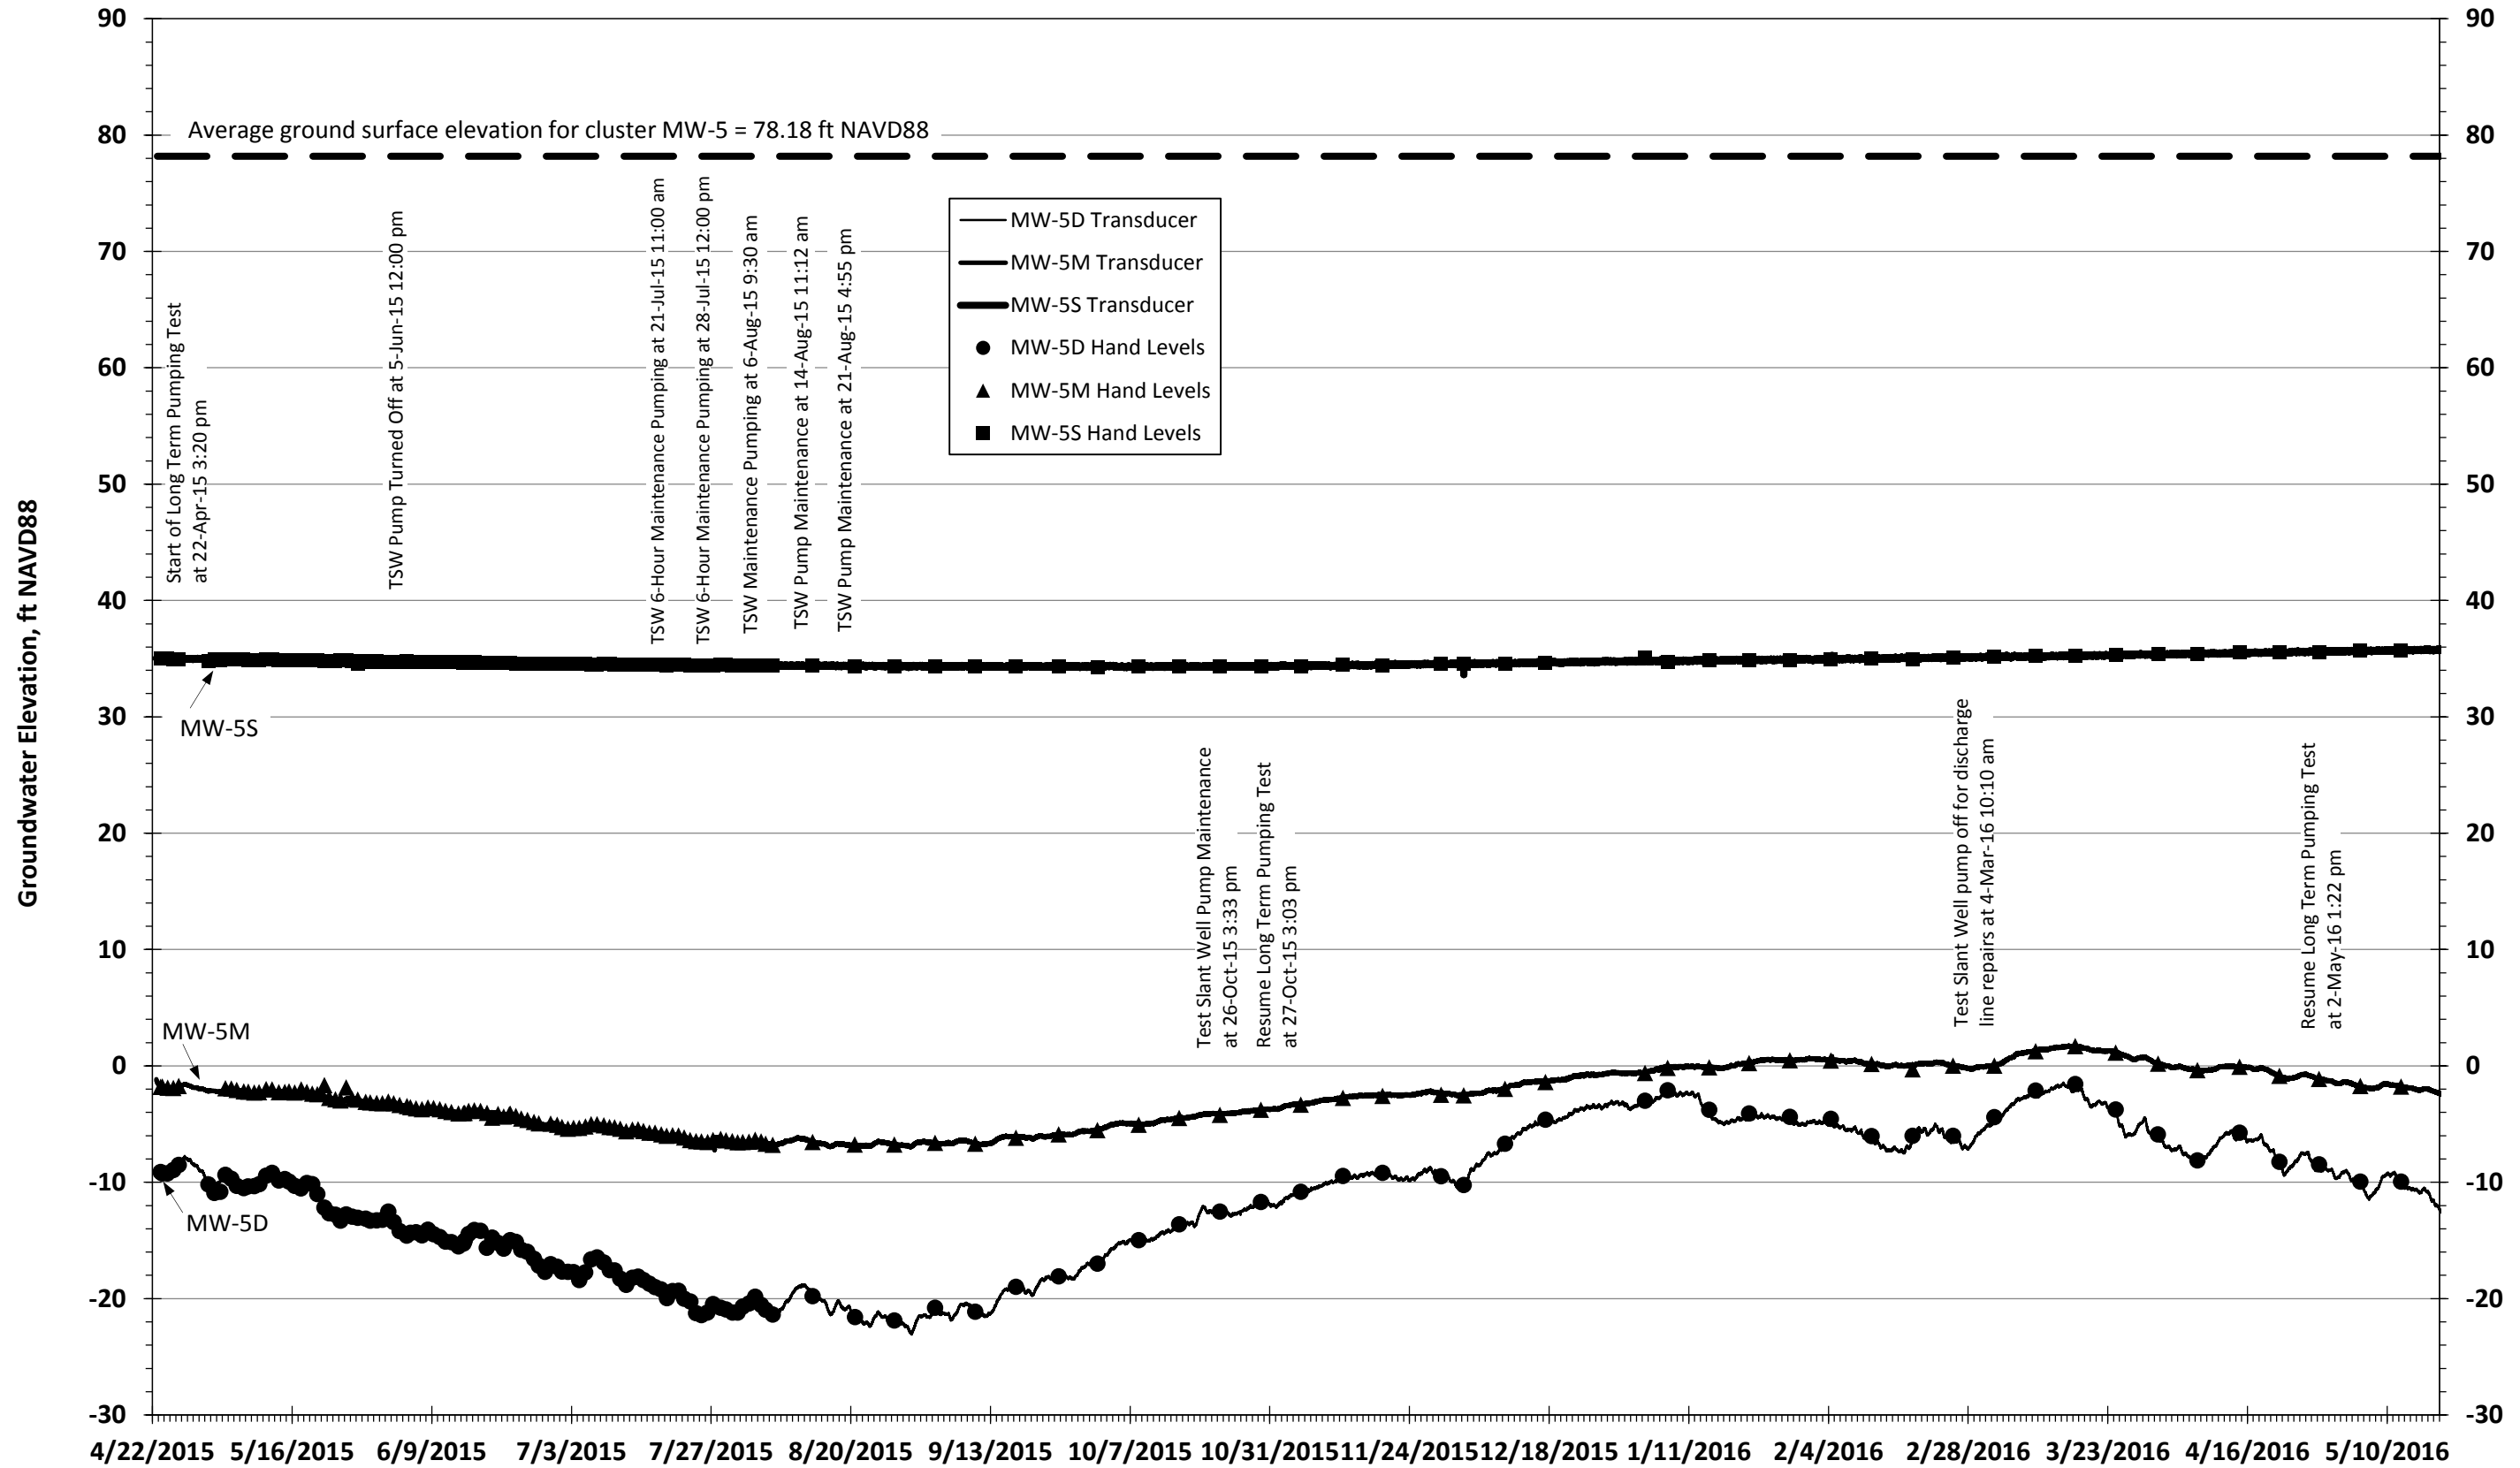


Figure 2-4

Groundwater Elevation in MPWSP MW-6

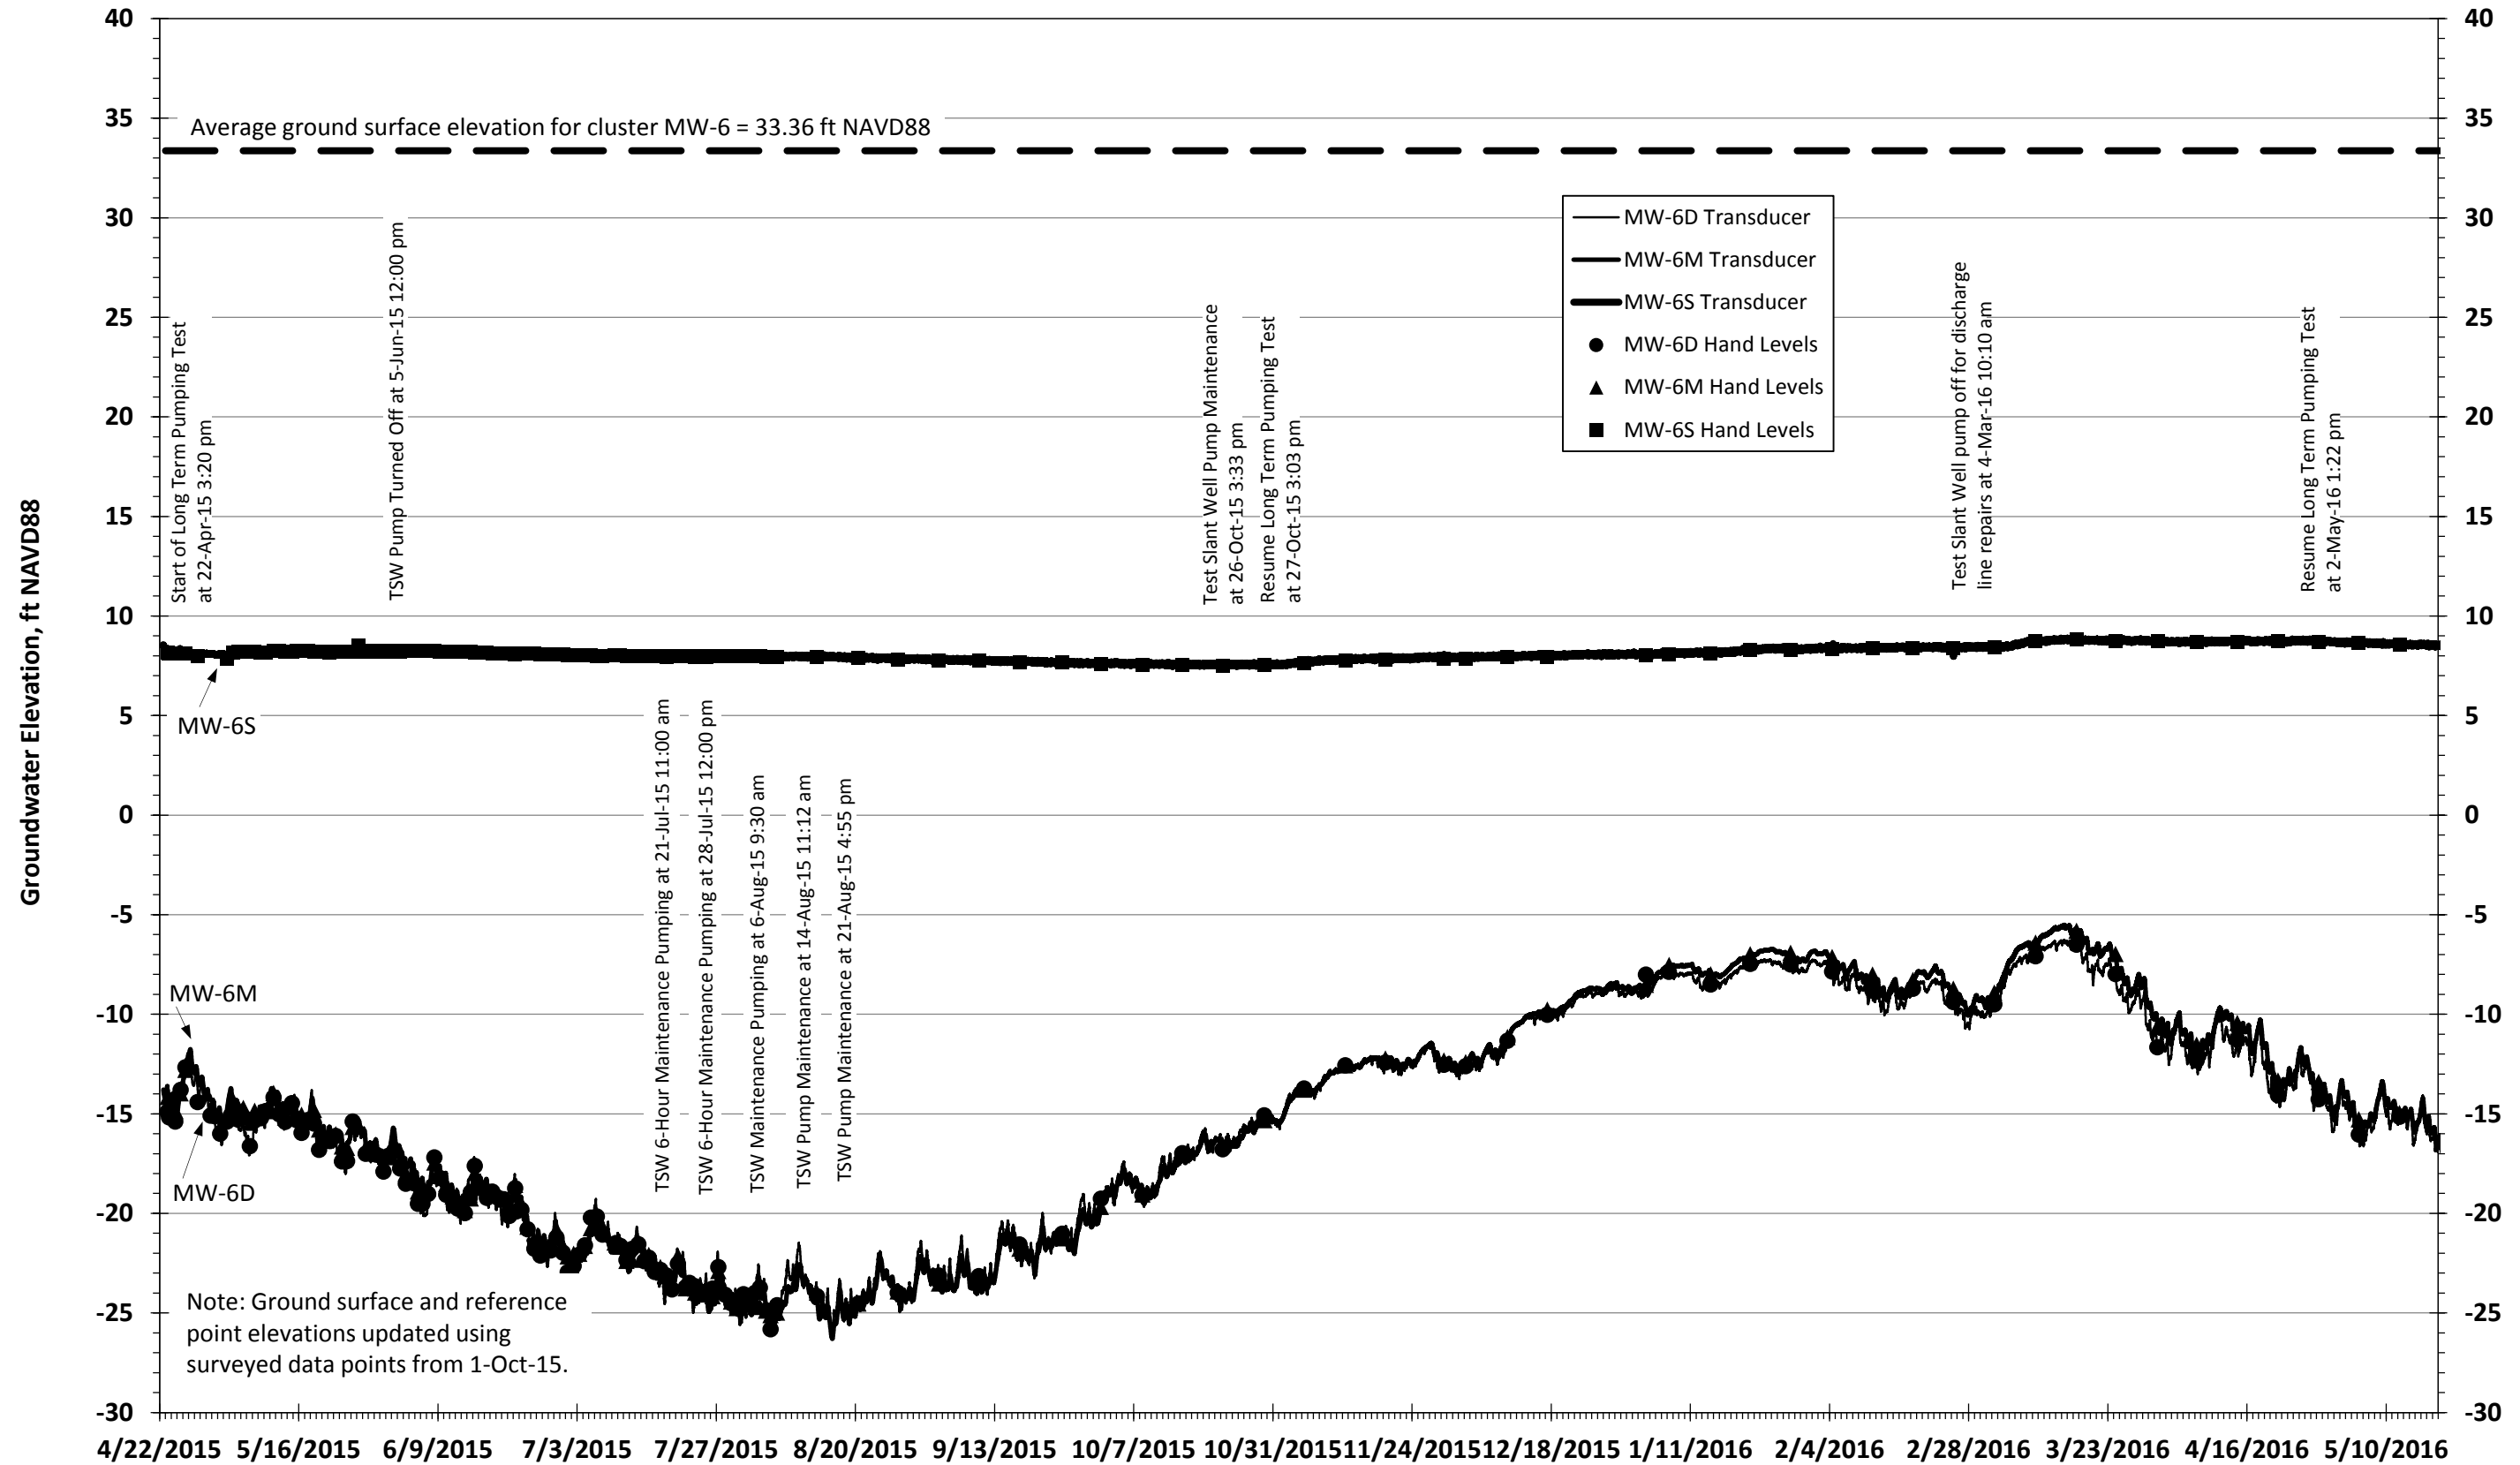


Figure 2-5

Groundwater Elevation in MPWSP MW-7

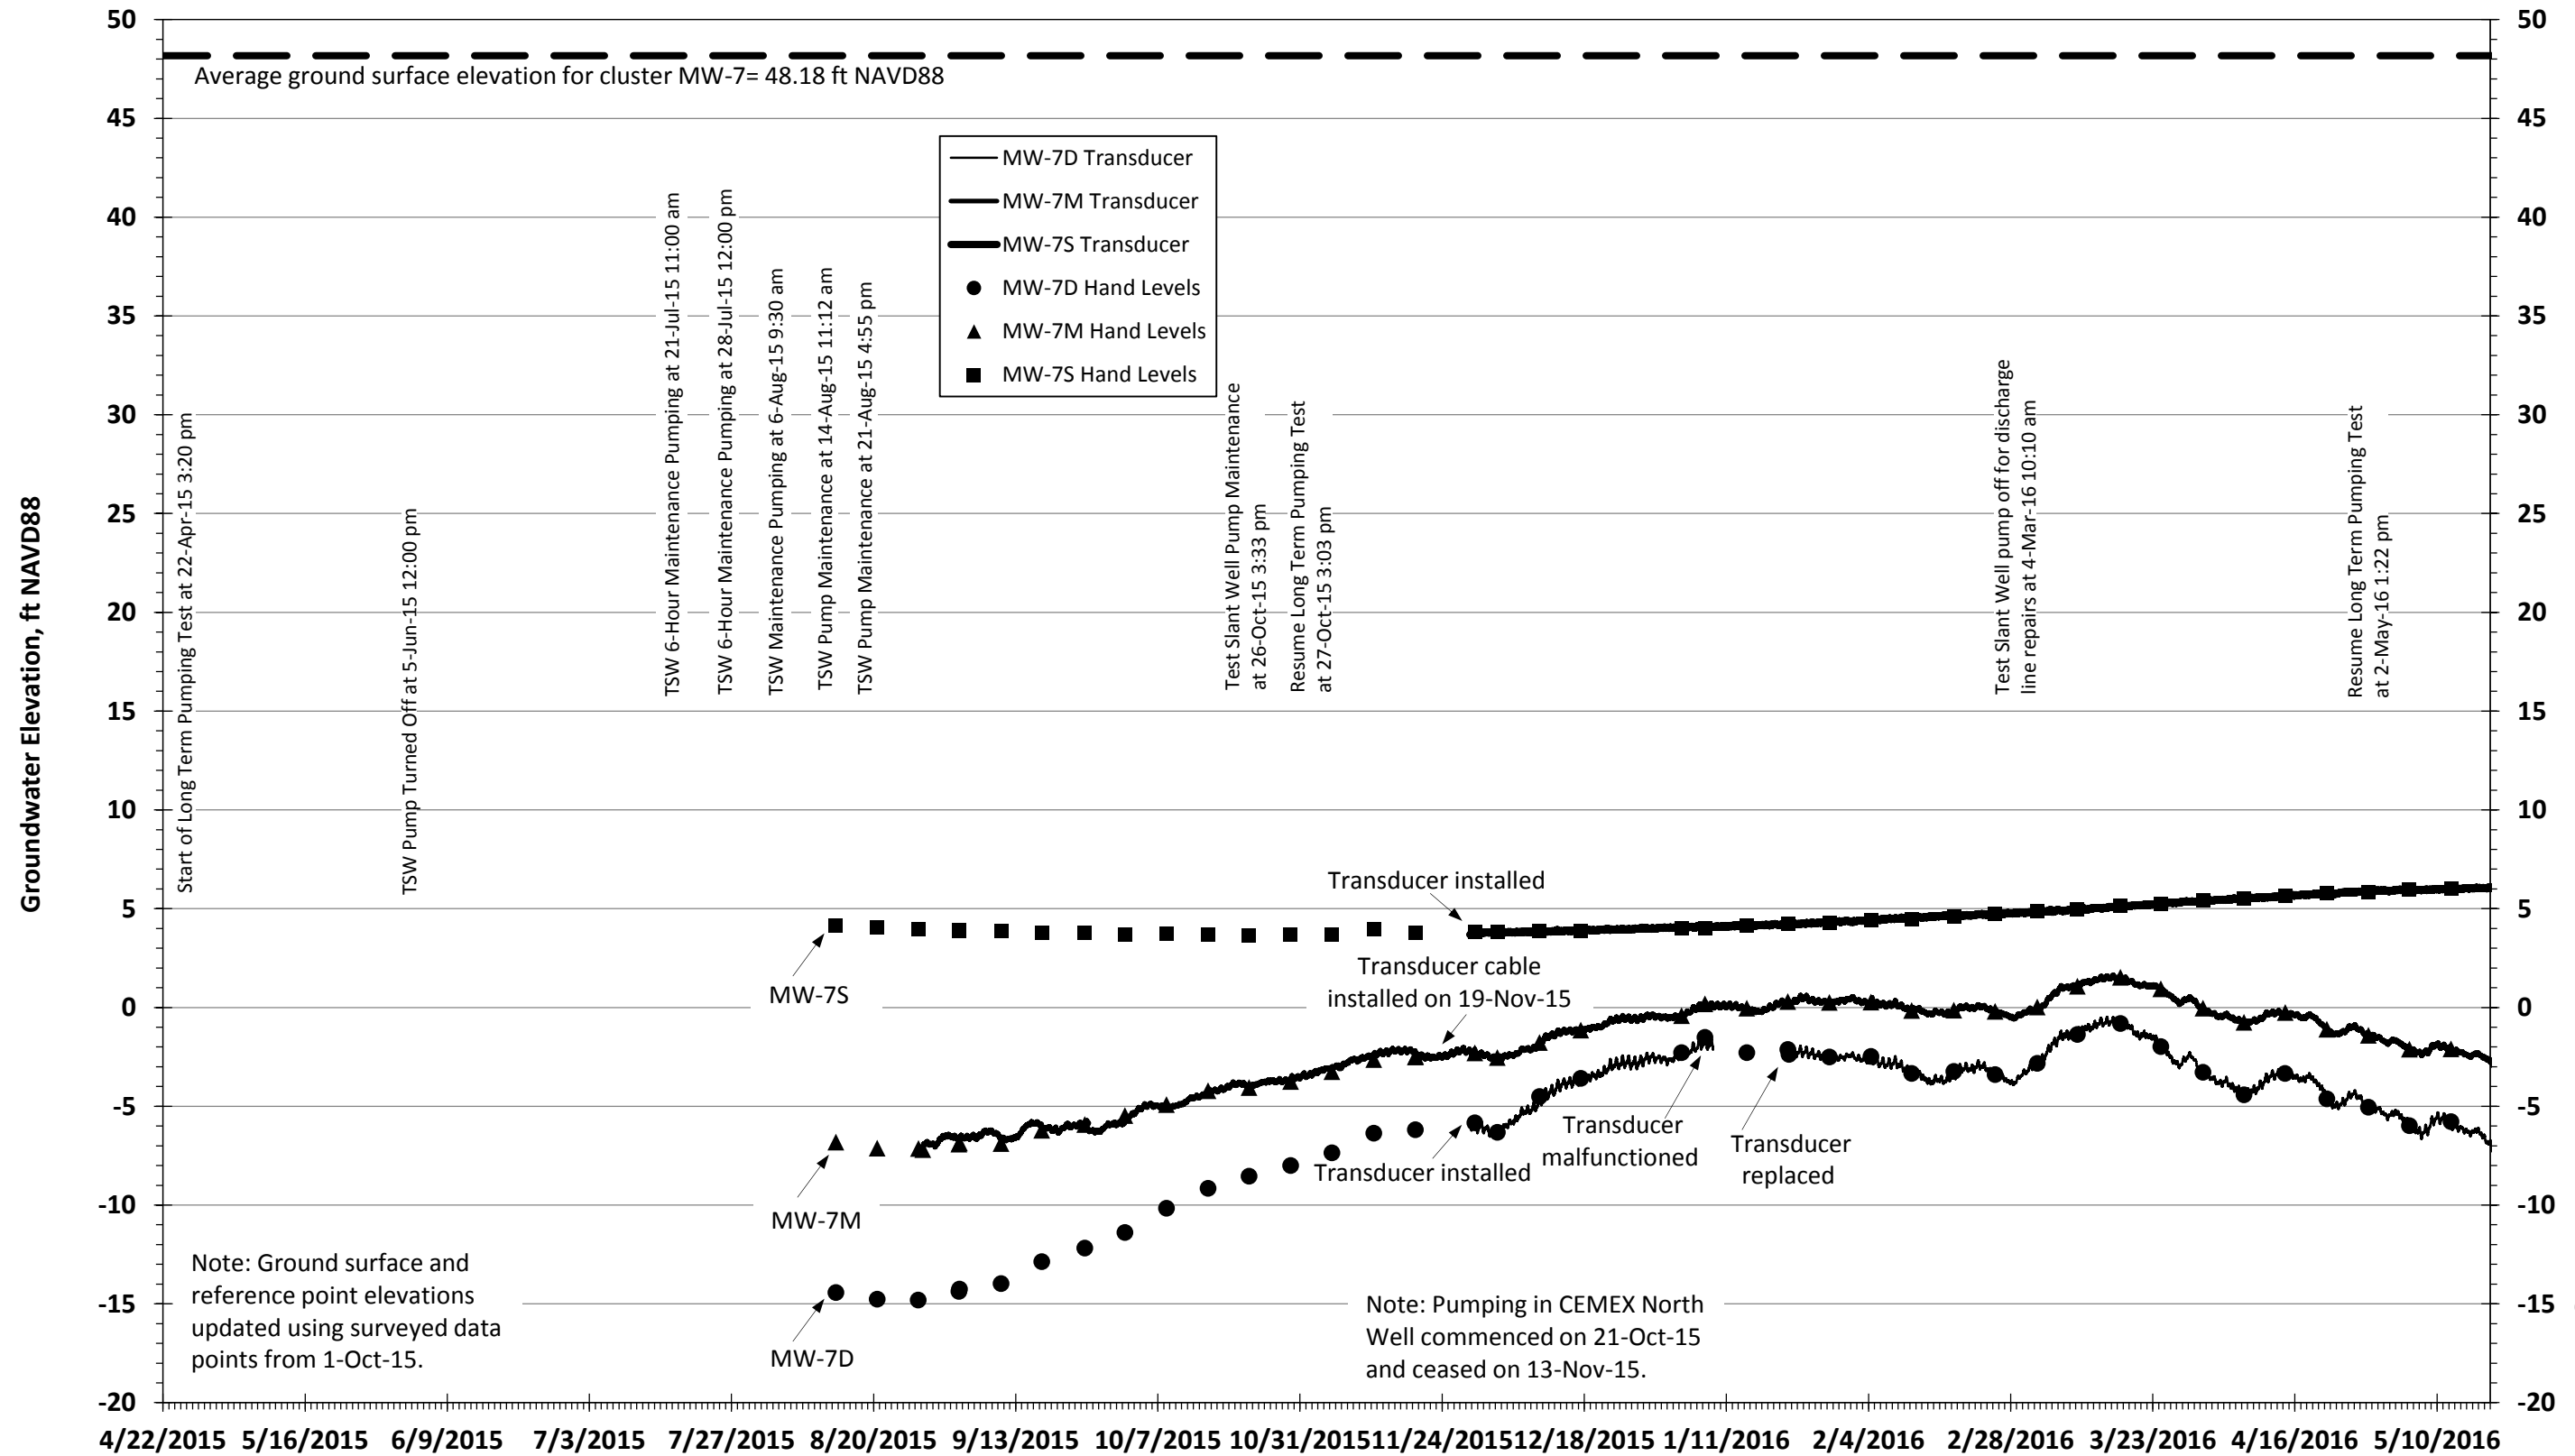


Figure 2-6

Groundwater Elevation in MPWSP MW-8


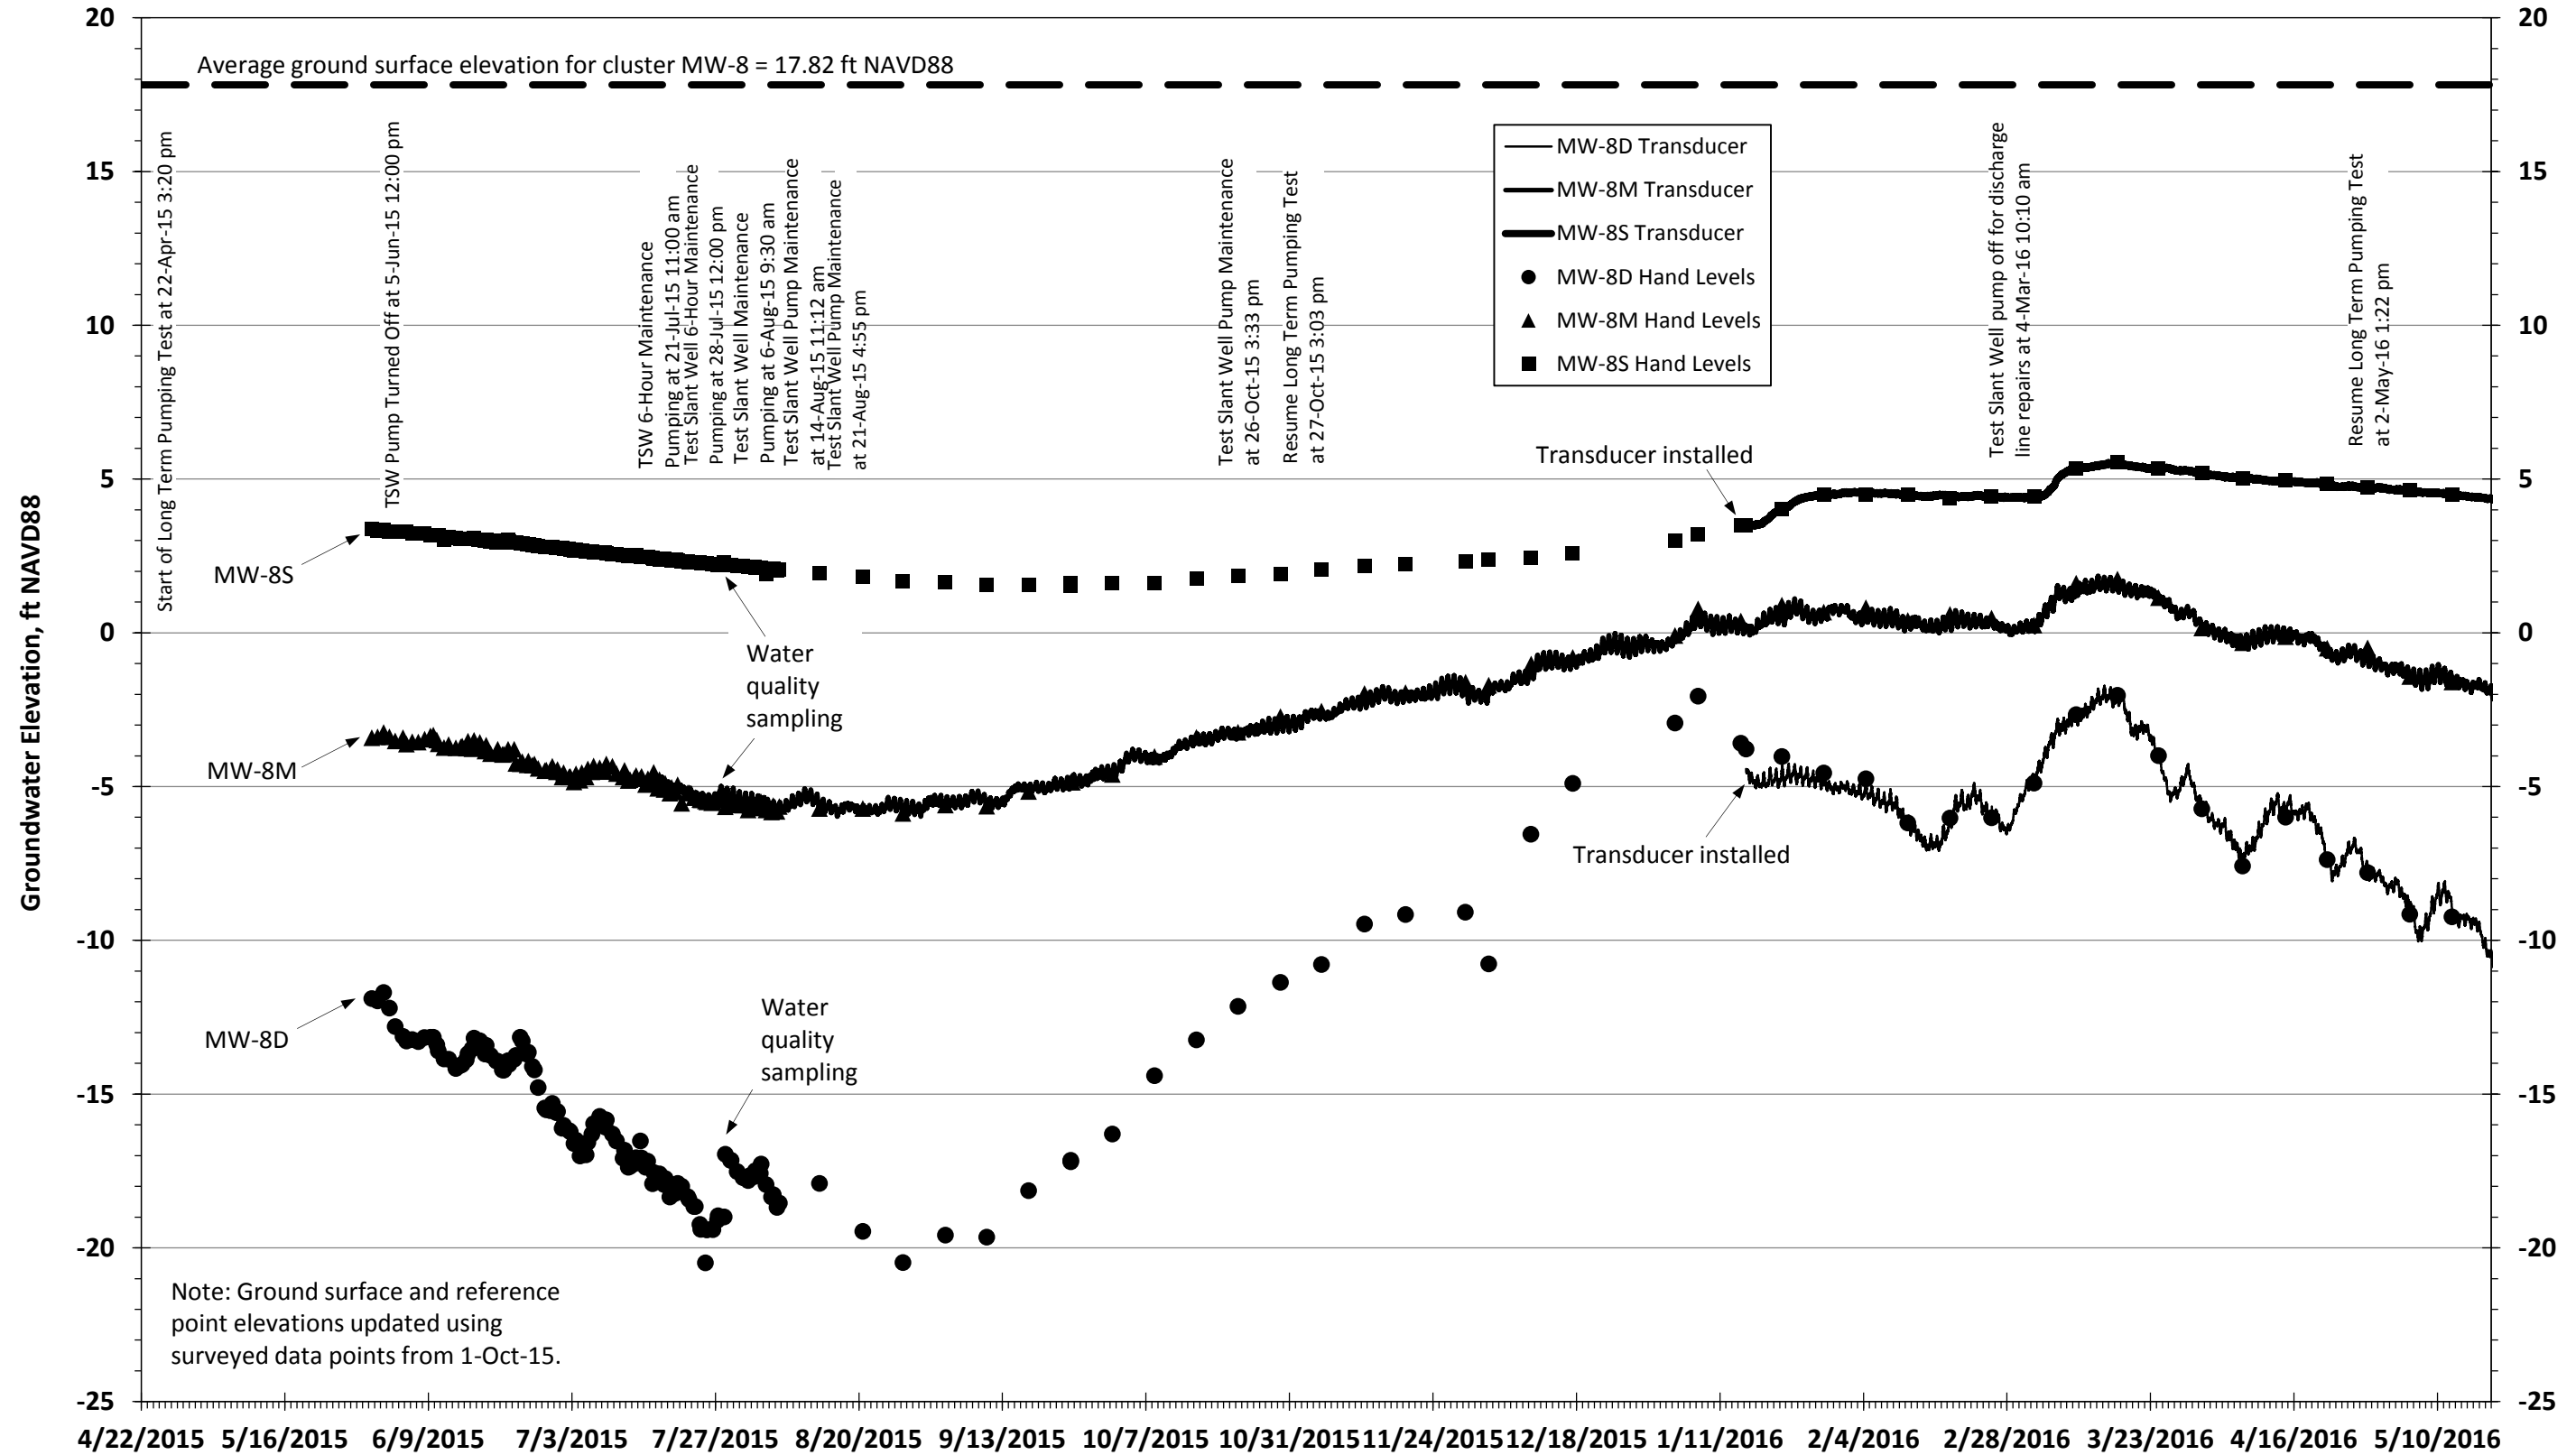


Figure 2-7

Groundwater Elevation in MPWSP MW-9

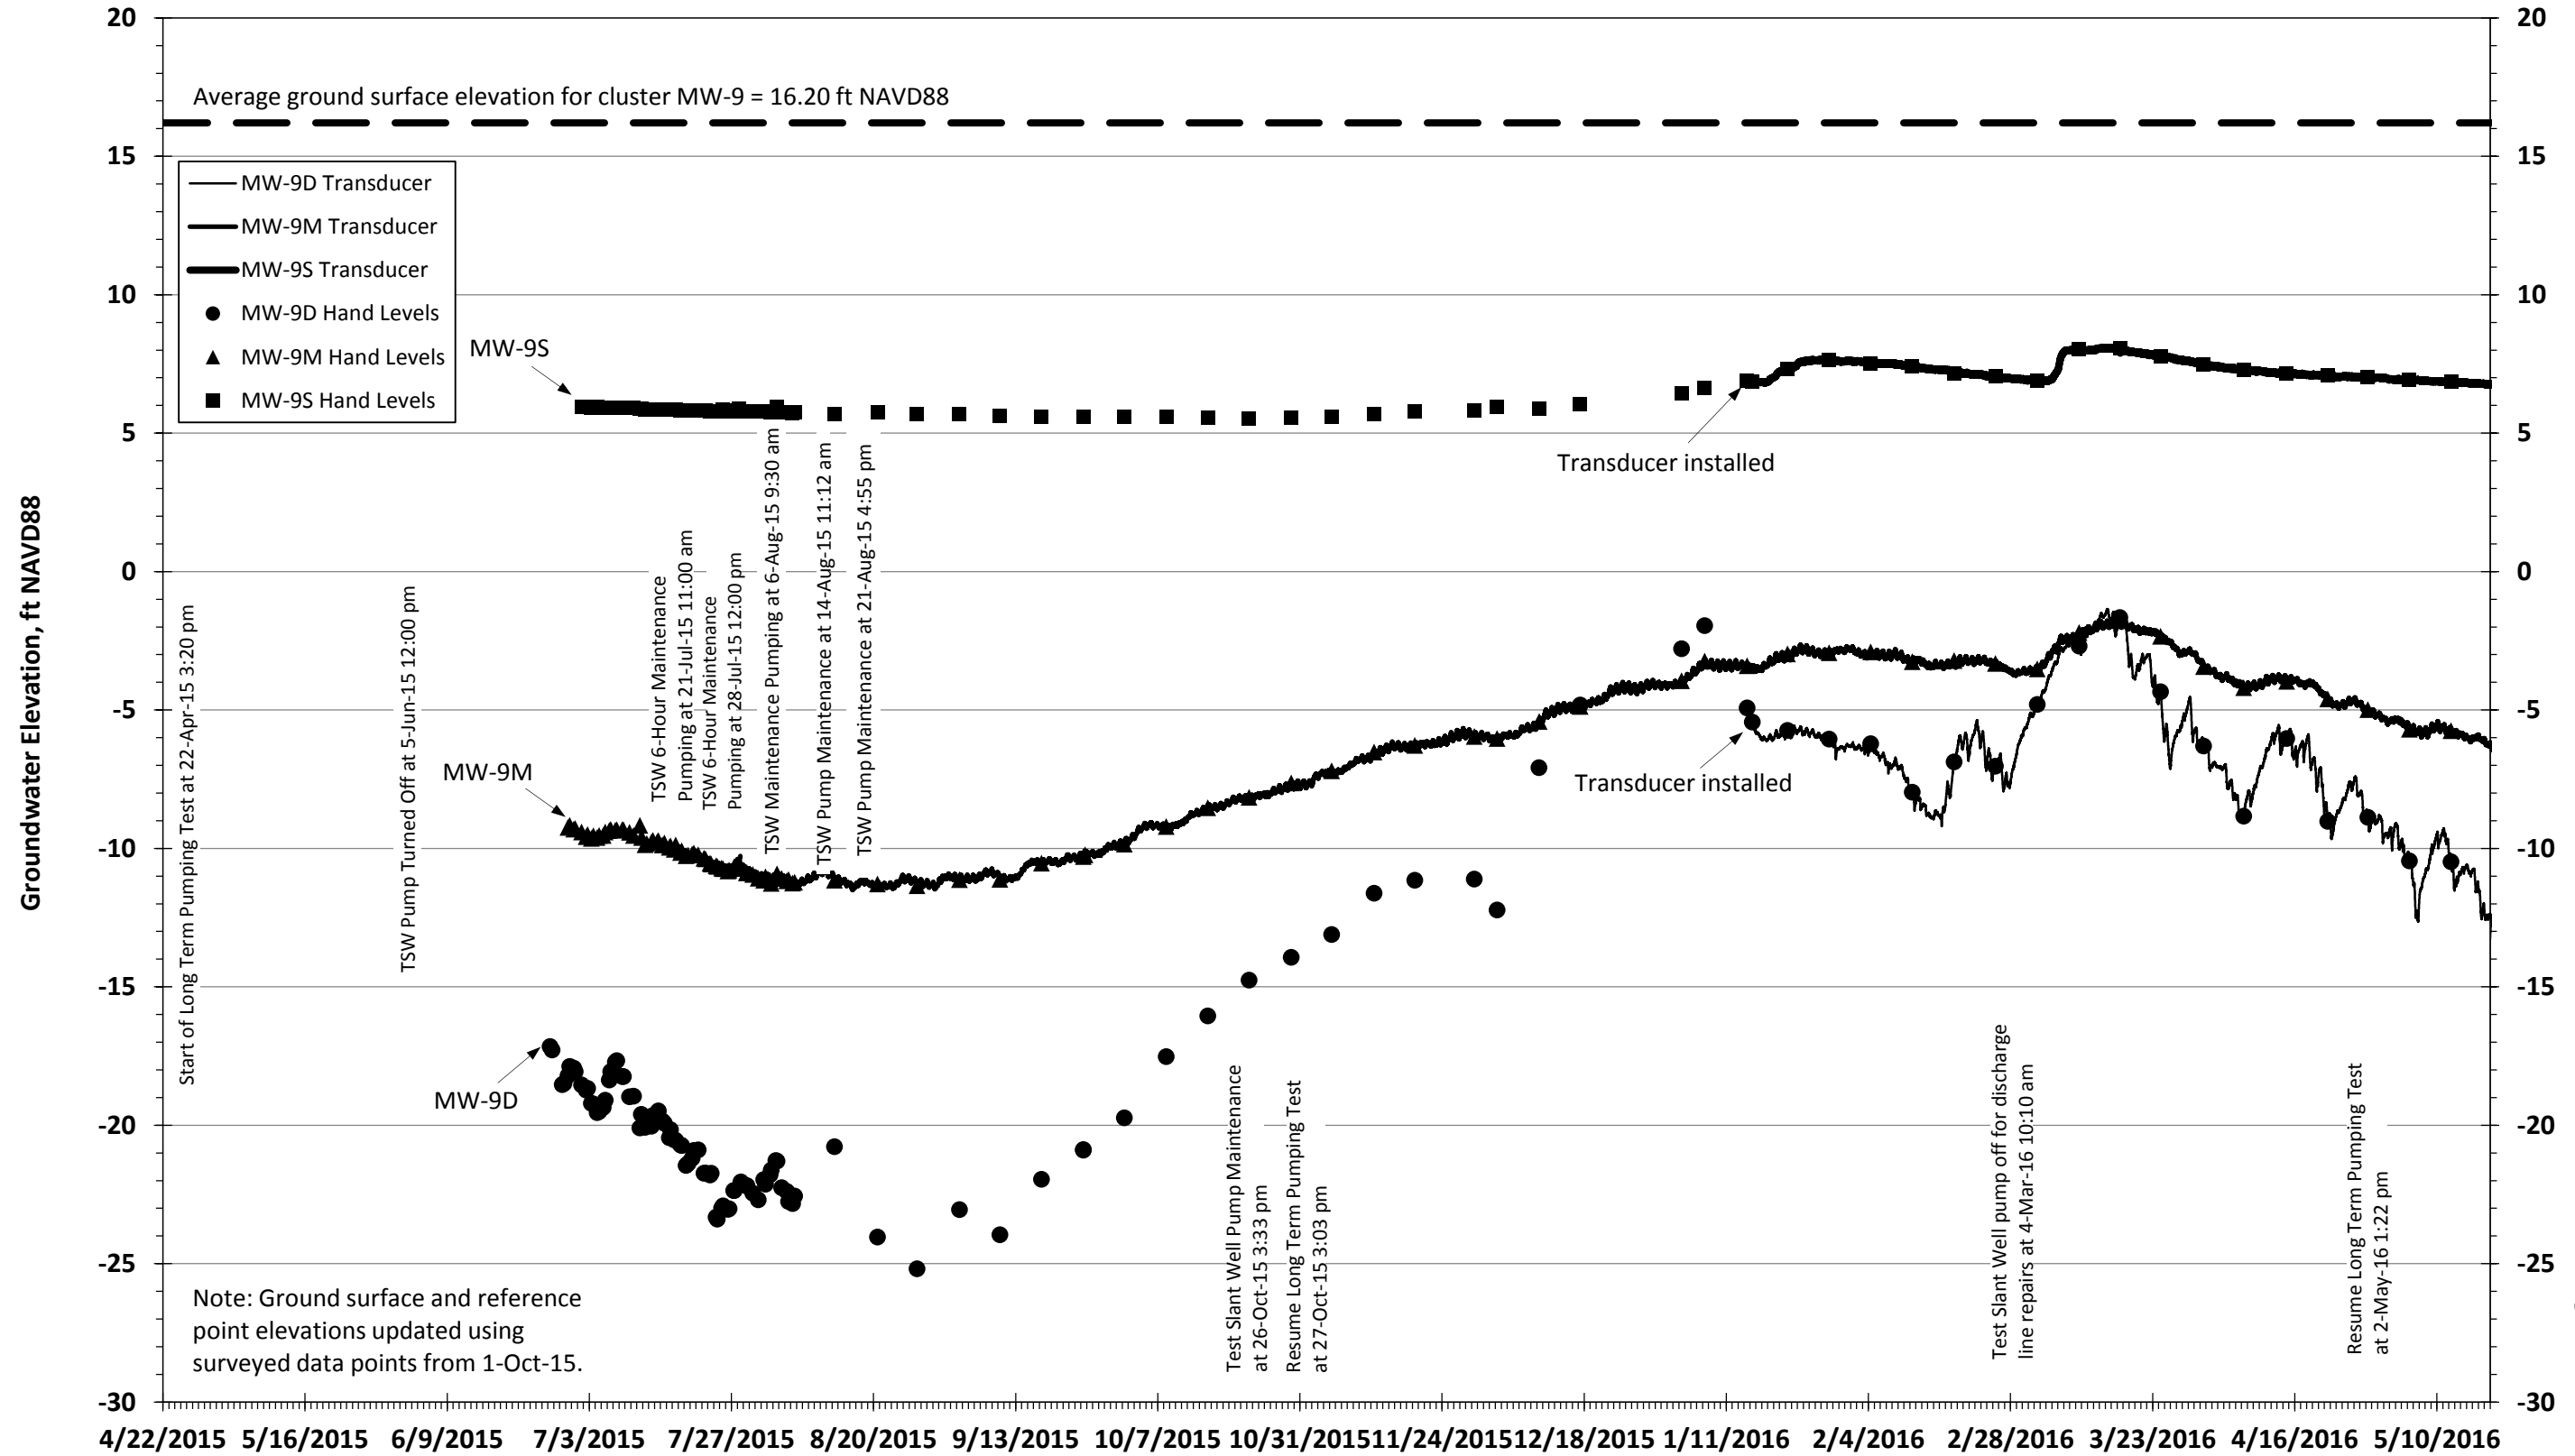

Groundwater Elevation in Monterey Regional Water Pollution Control Agency Wells

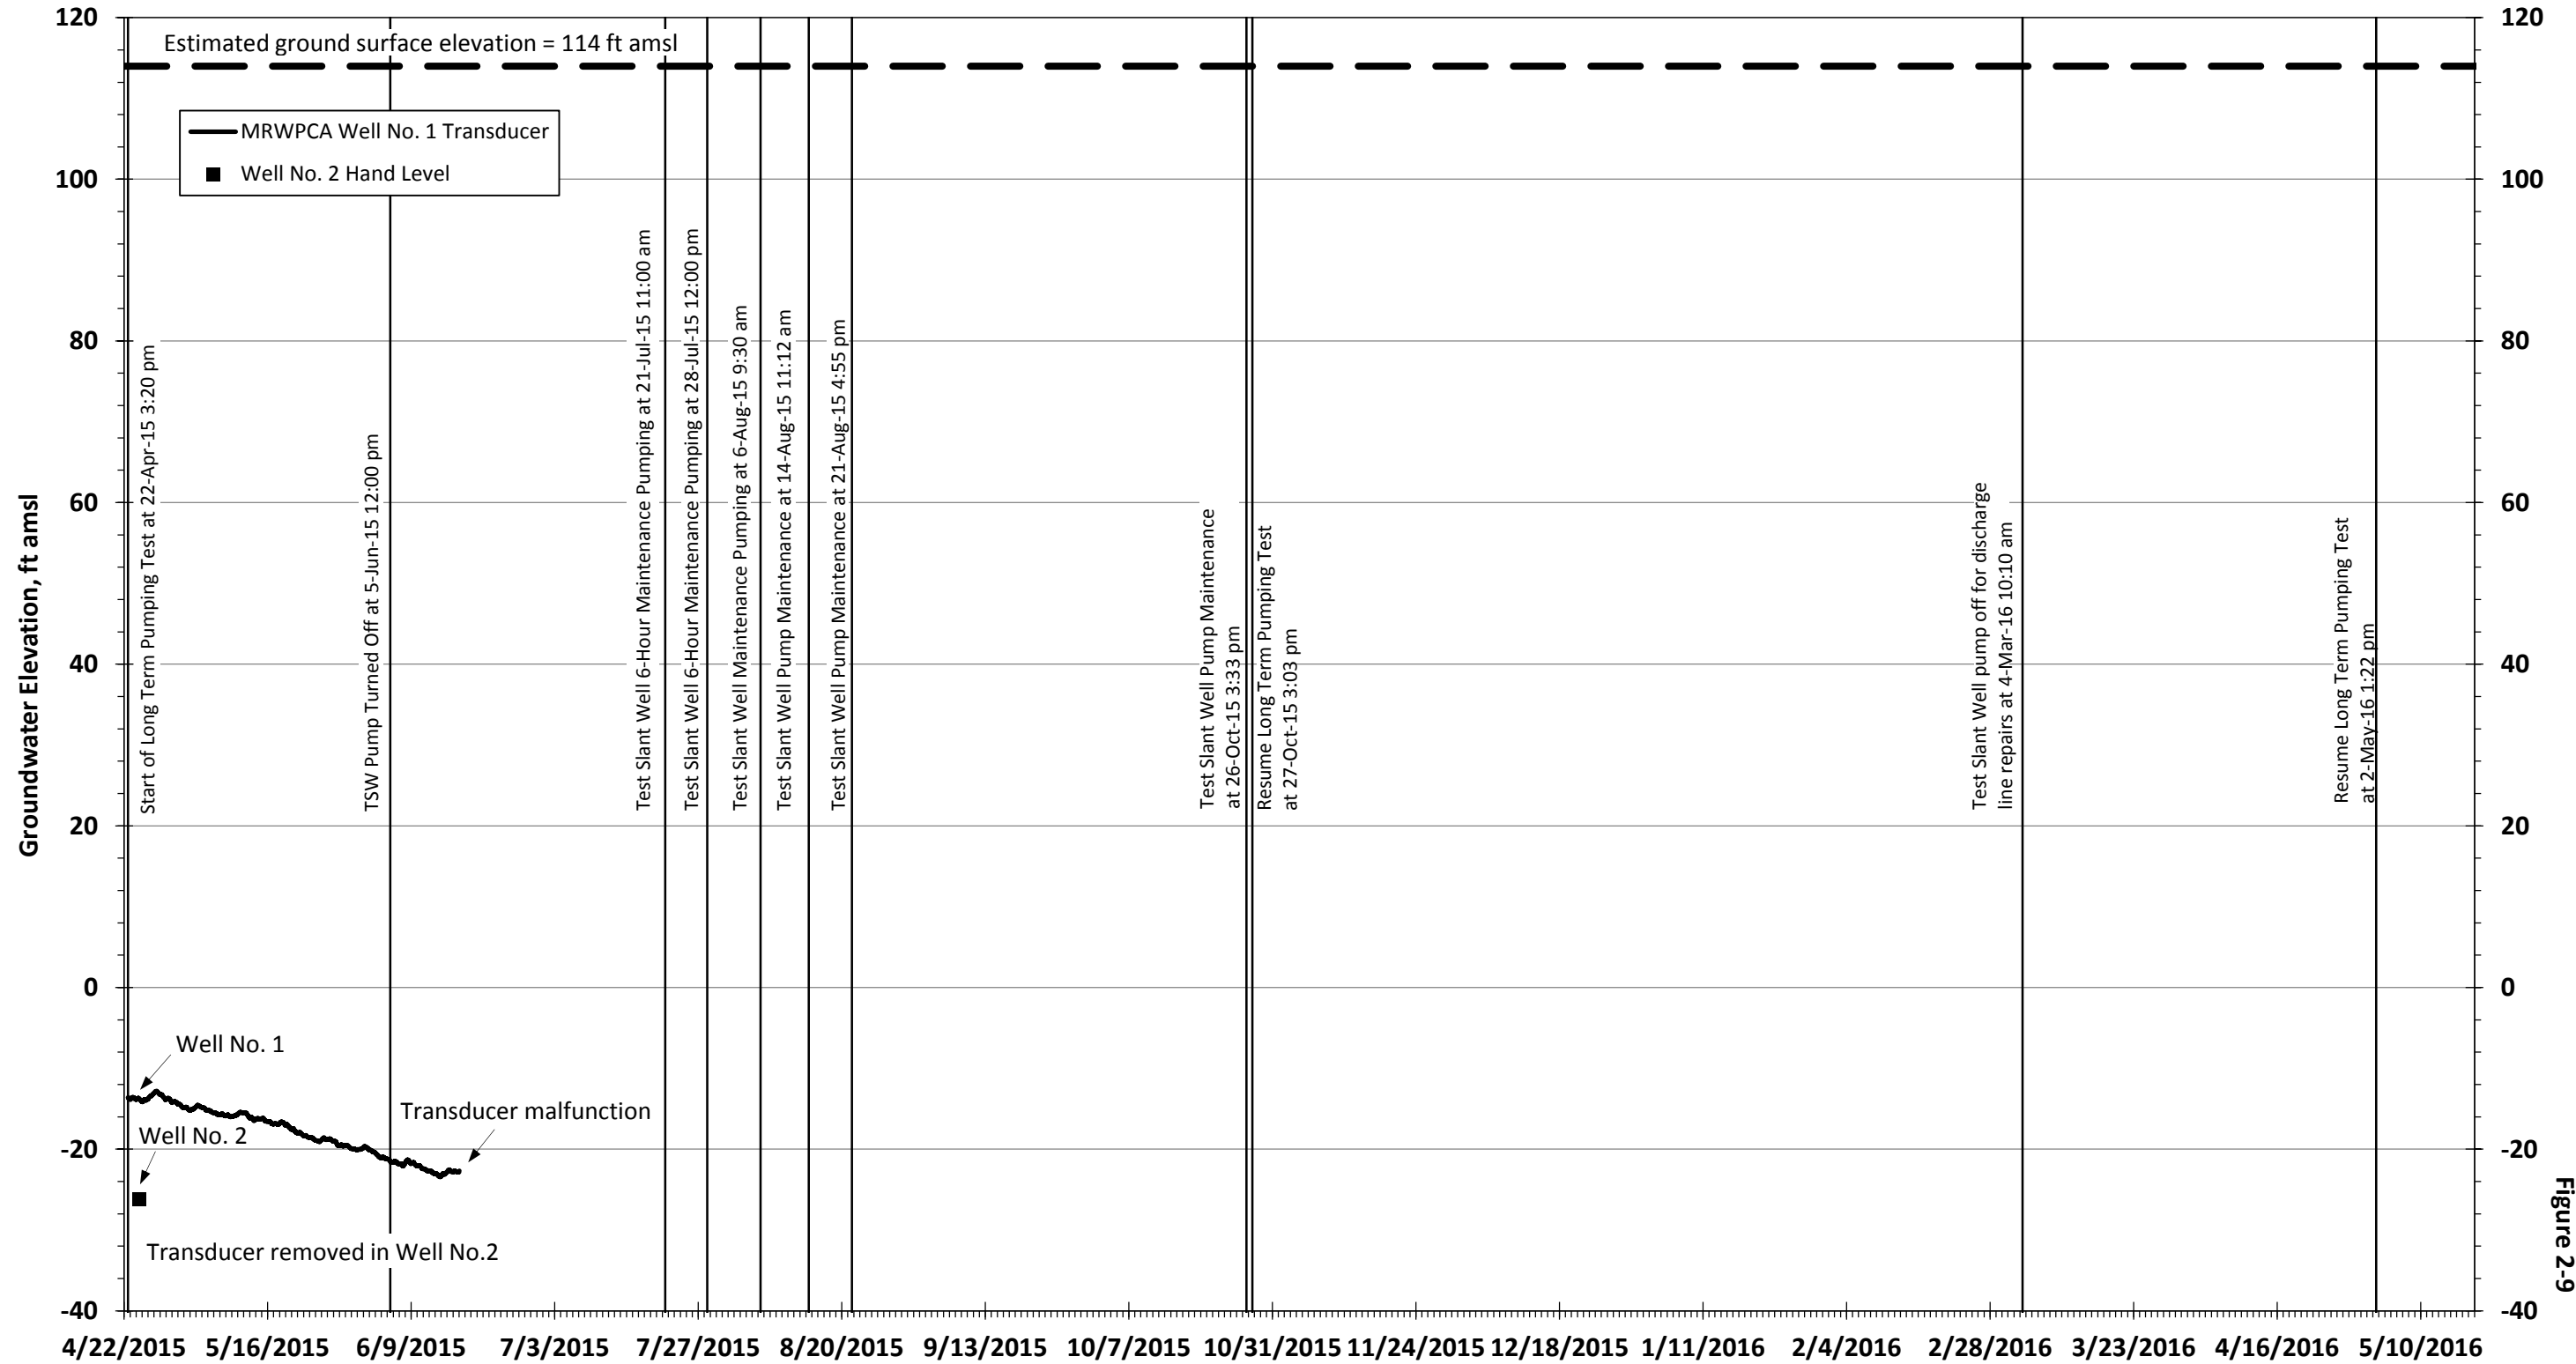


Figure 2-9

Surface Water Elevation in CEMEX Dredge Pond

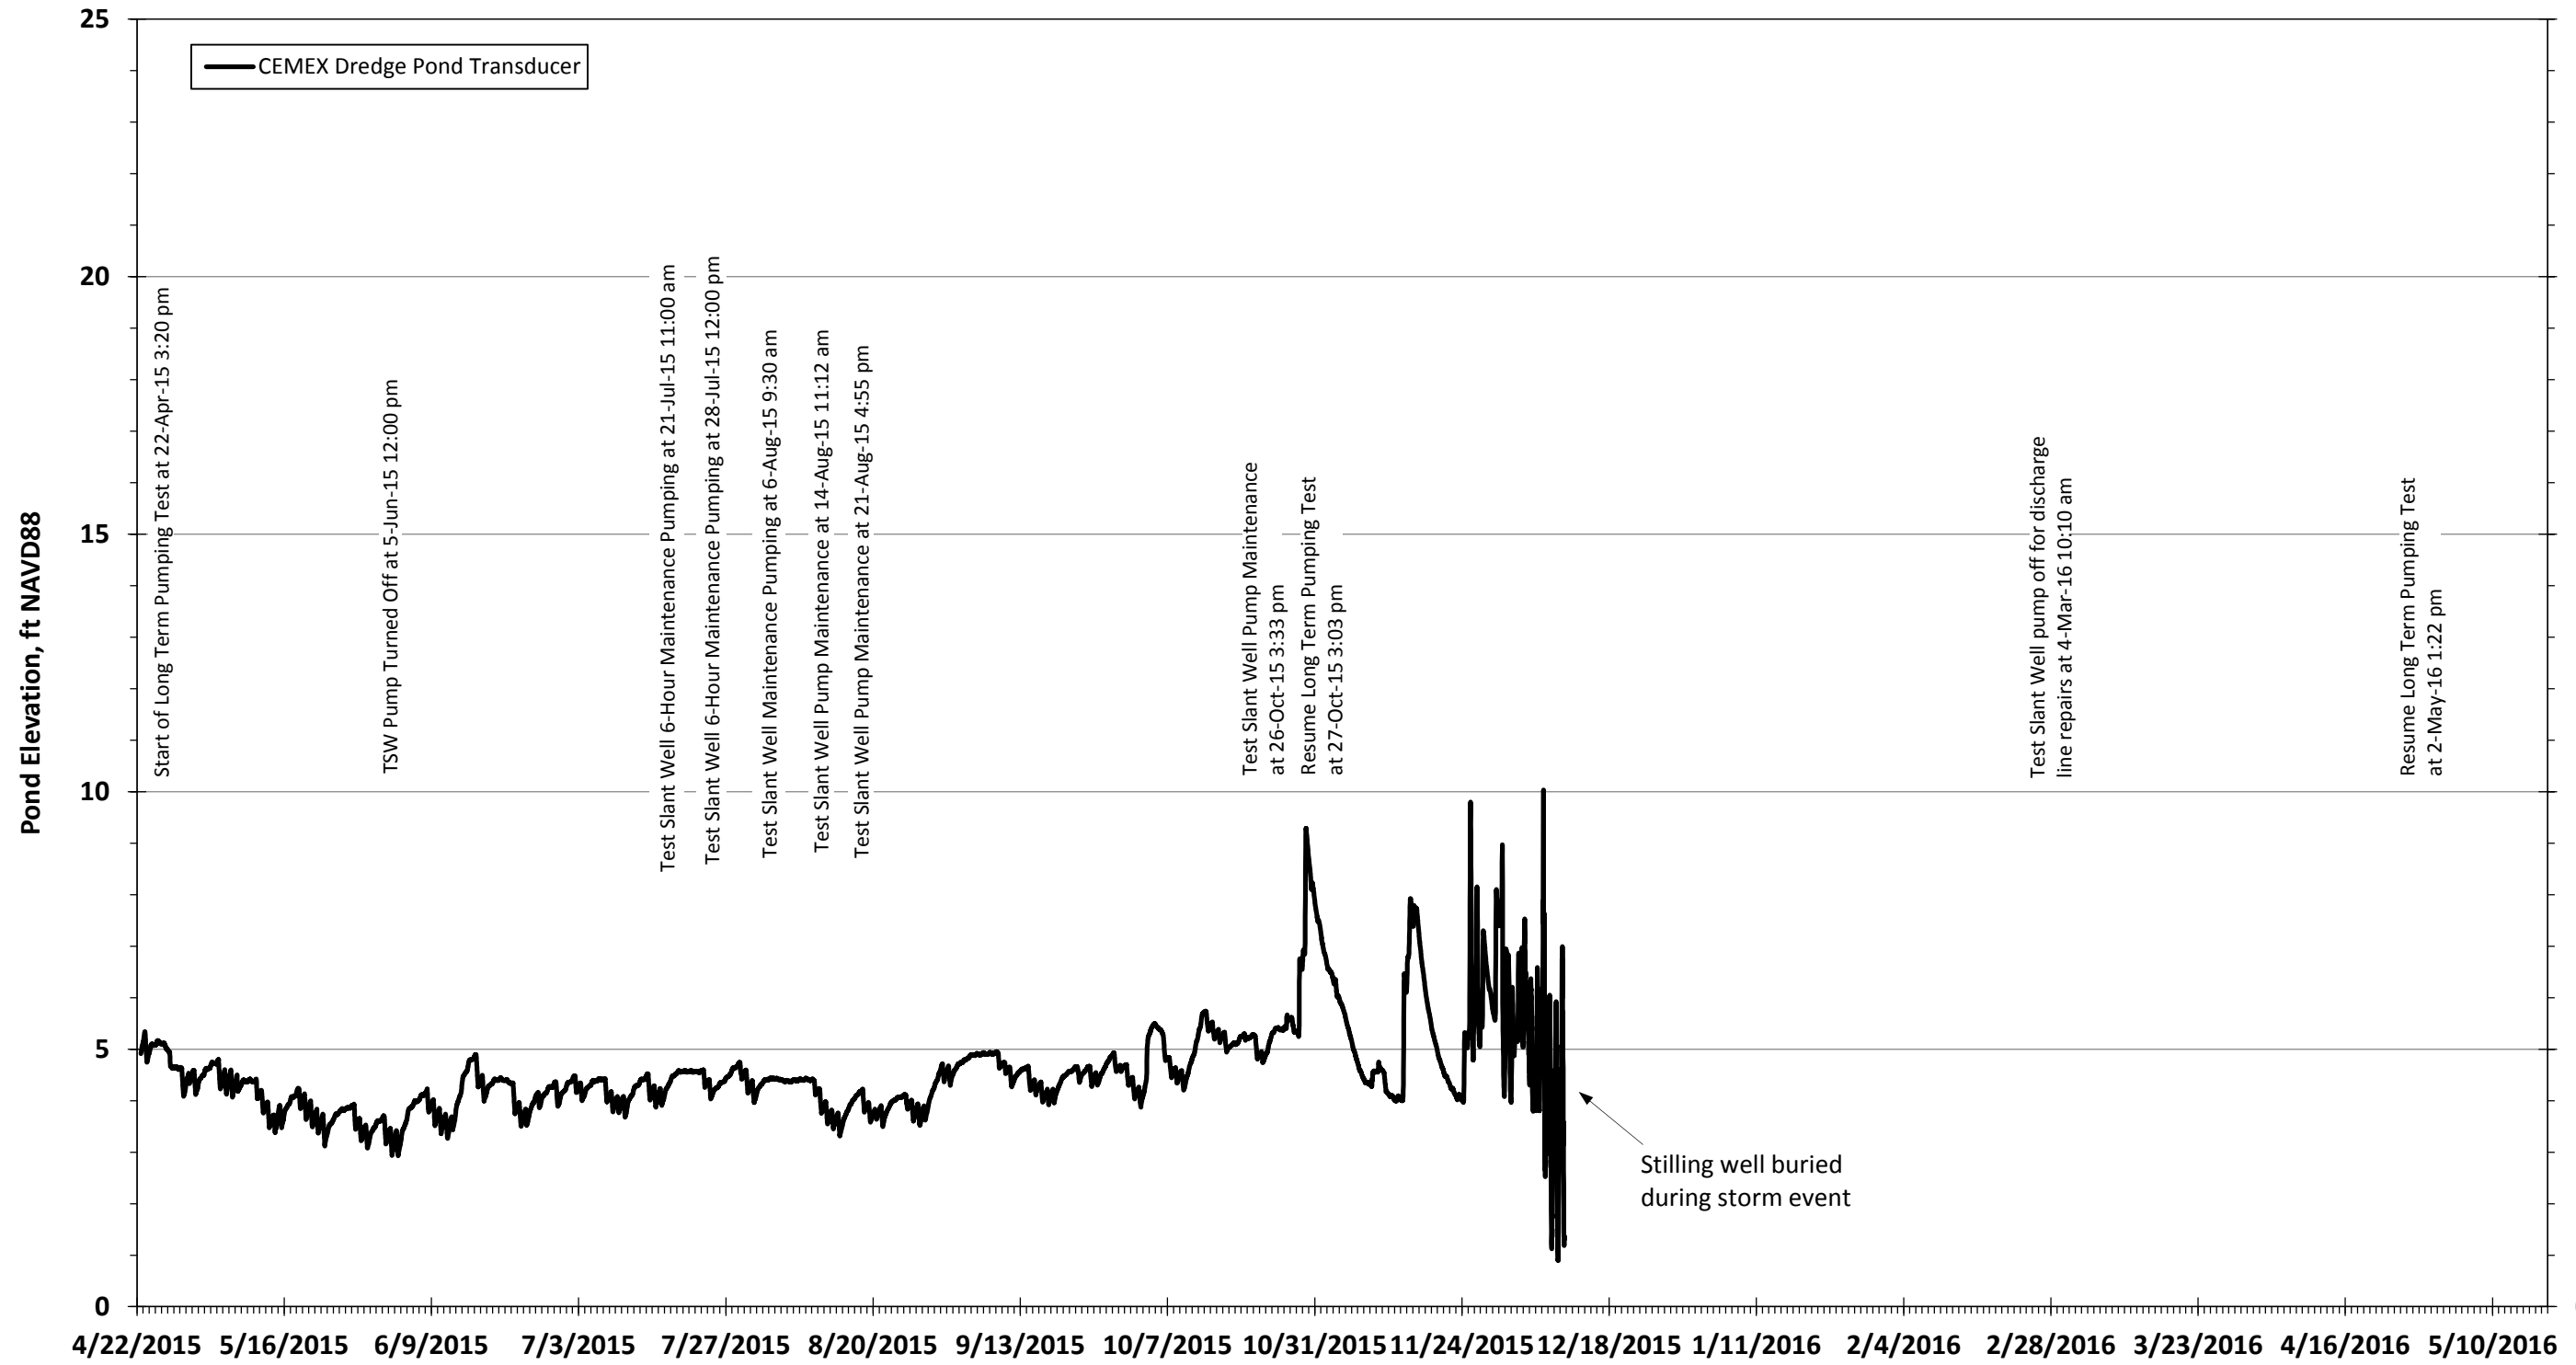


Figure 2-10

Groundwater Elevation in CEMEX North Well

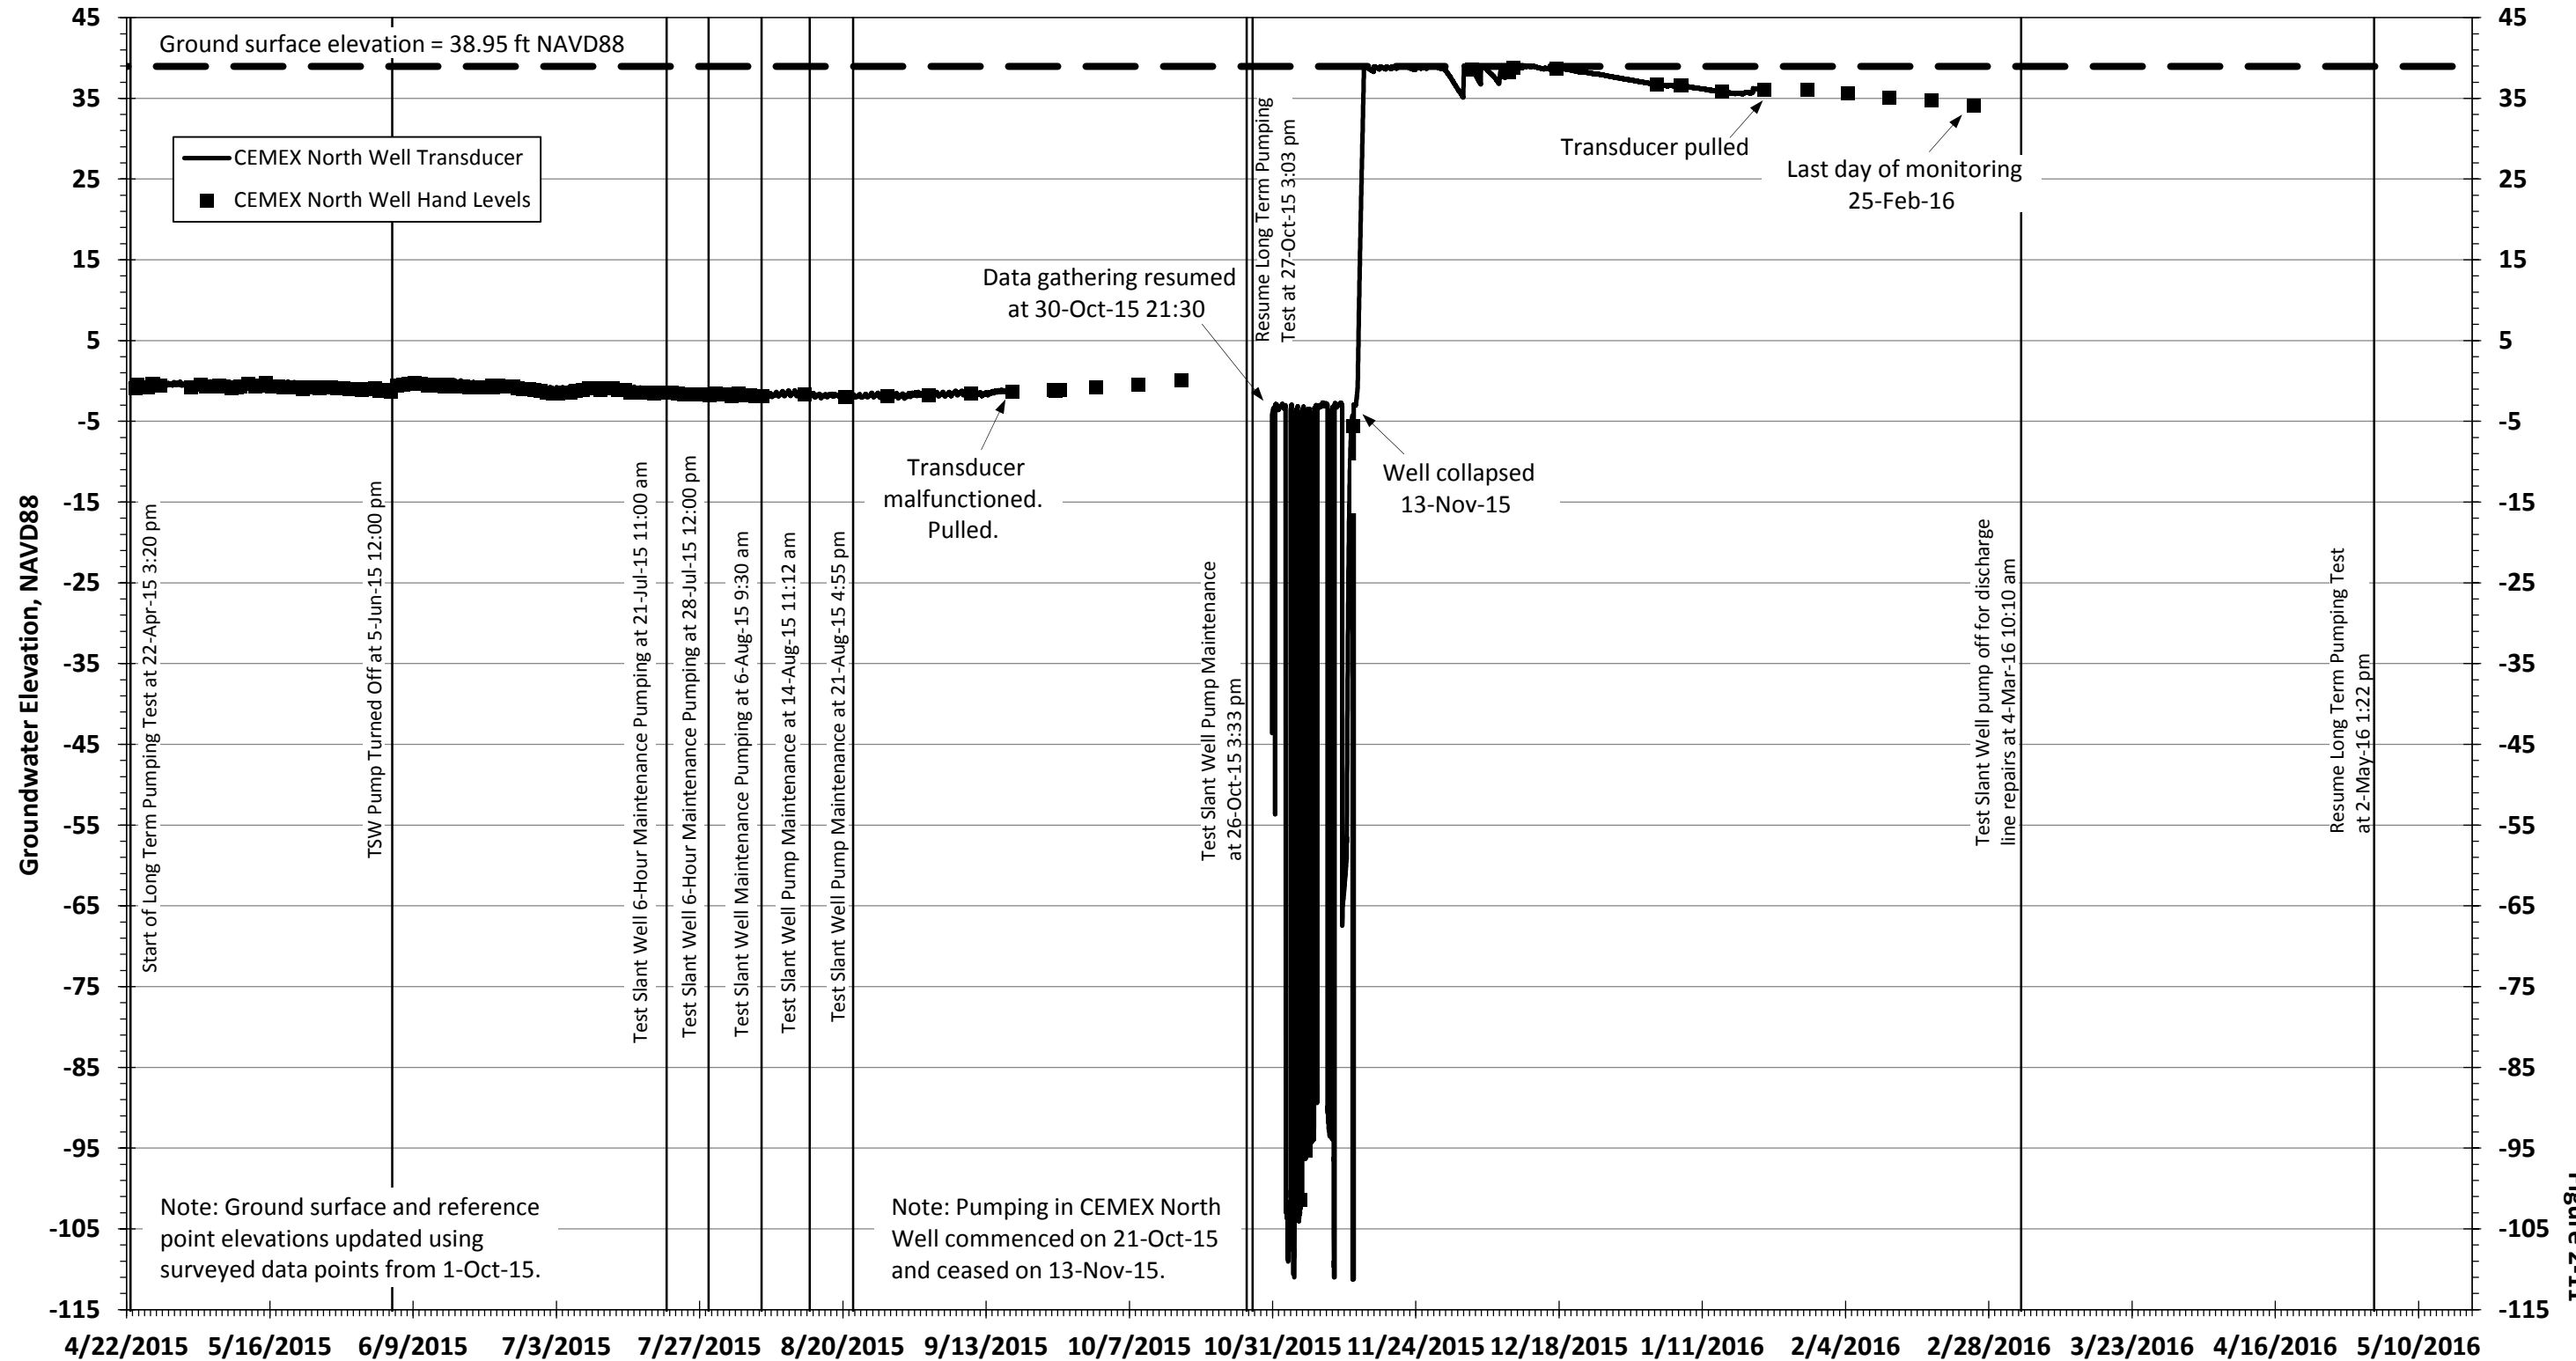


Figure 2-11

Groundwater Elevation in MPWSP Test Slant Well

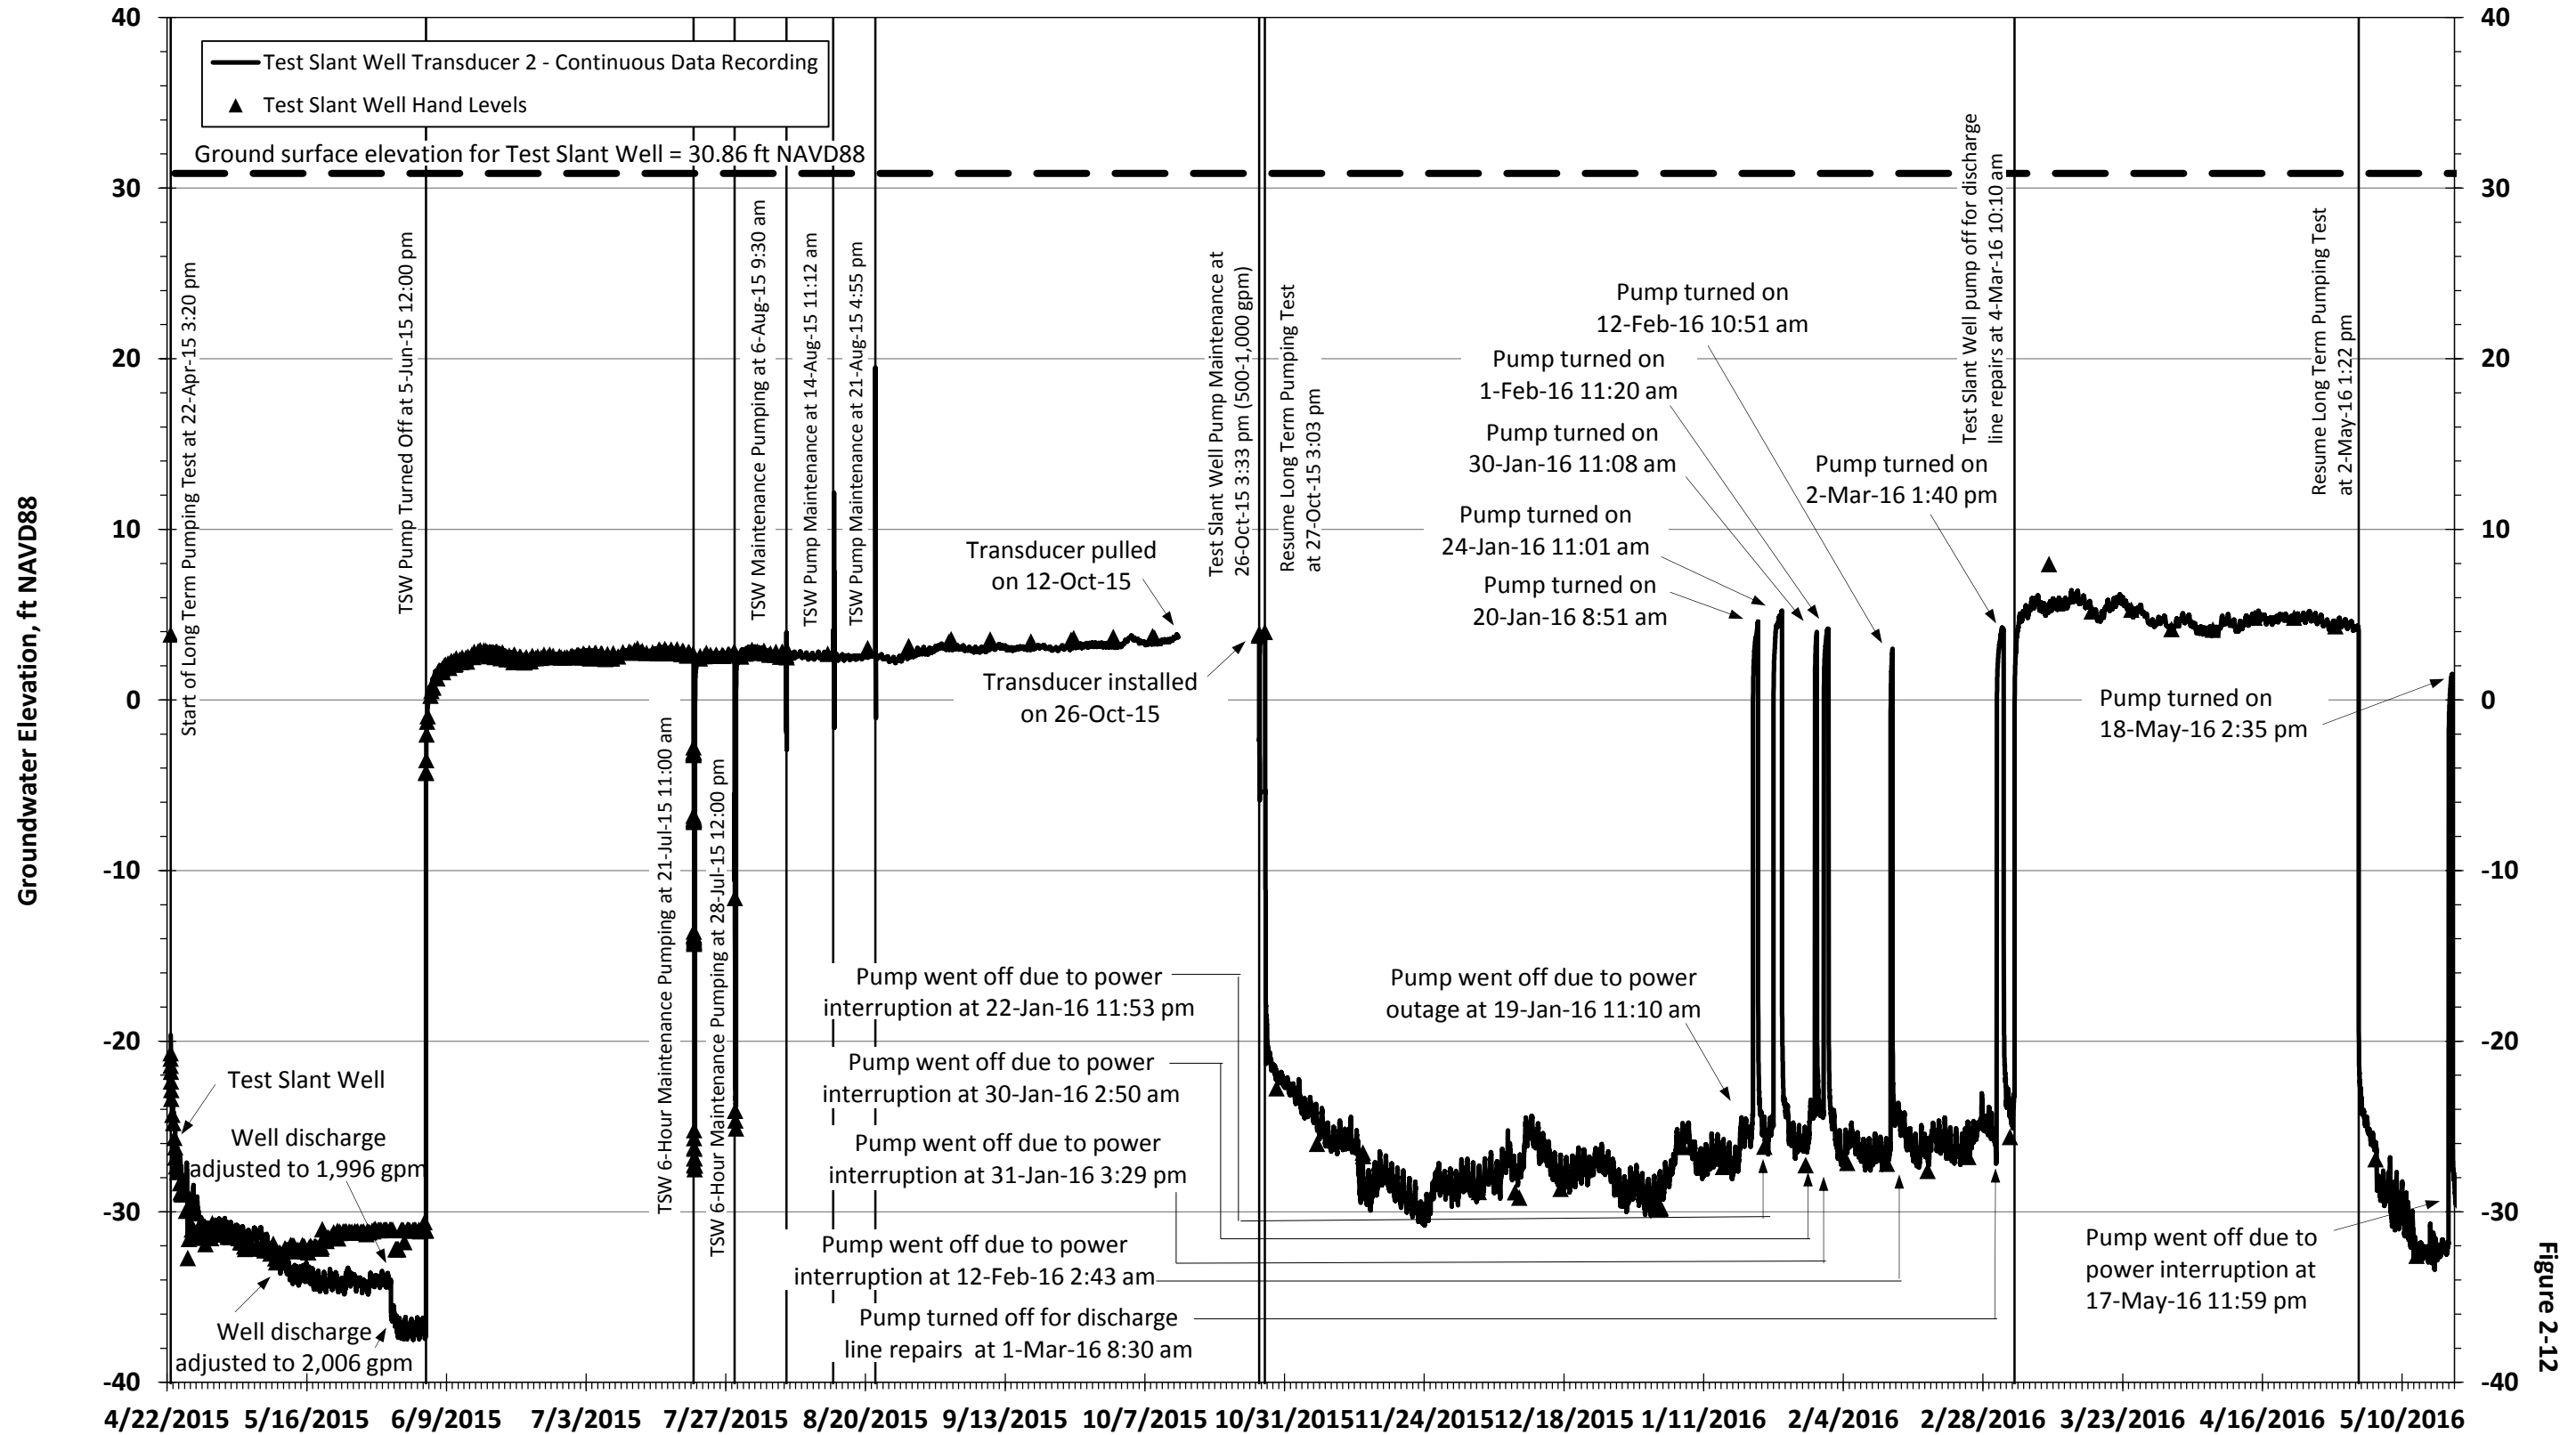


Figure 2-12

**ATTACHMENT C
LABORATORY WATER QUALITY
TEST RESULTS**

Cal Am / RBF
 Baseline Water and Total Dissolved Solids Levels
 Monterey Peninsula Water Supply Project Area

Table 2

Summary of Laboratory Water Quality Results in Monitoring Wells

Well Name:	MW-1D	MW-1M	MW-1S	MW-3D	MW-3M	MW-3S	MW-4D	MW-4M	MW-4S	MW-5D	MW-5M	MW-5S	Test Slant Well																
Screen Interval (ft bgs):	277 - 327	115 - 225	55 - 95	285 - 330	105 - 215	50 - 90	280 - 330	100 - 230	50 - 90	380 - 430	100 - 325	50 - 90	140 - 320, 400 - 710 (MD)																
Sample Date:	14-Feb-15	9-Apr-15	14-Feb-15	9-Apr-15	13-Feb-15	9-Apr-15	21-Feb-15	10-Apr-15	24-Feb-15	10-Apr-15	25-Feb-15	10-Apr-15	19-Feb-15	2-Apr-15	6-Mar-15	2-Apr-15	7-Mar-15	2-Apr-15	17-Feb-15	2-Apr-15	3-Mar-15	2-Apr-15	10-Mar-15	2-Apr-15	20-Mar-15	24-Mar-15	8-Apr-15		
Constituent ¹	Units	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result	Result		
Sulfate	mg/L	1,950	N/A	2,070	N/A	1,840	N/A	N/A	N/A	N/A	N/A	N/A	1,700	N/A	N/A	N/A	N/A	N/A	58	1,700	N/A	N/A	N/A	N/A	N/A	N/A	N/A		
Sulfate, Dissolved	mg/L	N/A	2,148	N/A	2,048	N/A	2,008	2,058	2,158	1,960	1,967	1,533	1,605	N/A	1,796	1,184	1,205	716	807	N/A	31	110	67	197	192	N/A	1,840		
Temperature	* C	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A		
Temperature (Field)	* C	19.2	20.02	17.2	17.89	18.8	17.64	19.6	20.22	16.3	18.74	17.5	19.17	19.9	19.8	18.4	18.3	17.7	18.1	21.3	21.4	16.97	18.2	16.7	18.1	20.9	19.1	17.2	
Total Diss. Solids	mg/L	29,100	28,700	30,900	28,300	26,600	27,500	32,600	28,600	28,500	28,300	23,400	23,300	27,500	27,600	17,900	17,500	11,900	12,800	2,616	2,437	663	454	1,166	1,117	25,300	24,400	25,400	
Total Susp. Solids	mg/L	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	36	ND	N/A
Turbidity	NTU	1.8	0.15	0.1	0.1	0.1	0.15	1	0.3	0.1	0.16	0.15	0.24	0.65	0.15	0.25	0.05	0.3	0.2	0.25	0.25	ND	ND	0.4	0.75	17	1.6	0.4	
Turbidity (Field)	NTU	0.65	0.69	0.41	0.35	0.28	0.43	0.38	0.87	0.42	0.21	0.96	0.55	0.76	0.53	0.71	0.84	0.52	0.17	0.71	0.87	0.47	0.45	1.31	1.26	40.3	0.66	0.74	
Volatile Org. Compounds (524)	µg/L	ND	N/A	ND	N/A	ND	N/A	ND	N/A	ND	N/A	RP	N/A	RP	N/A	ND	N/A	RP	N/A	RP	N/A	ND	N/A	RP	N/A	N/A	N/A	ND	
Zinc, Total	µg/L	ND	ND	ND	ND	413	ND	ND	ND	297	ND	312	ND	ND	ND	211	107	ND	108	51	ND	40	ND	43	ND	N/A	N/A	ND	

Notes:

- *C = Degrees Celsius
- CU = Color Units
- mg/L = Milligrams per Liter
- NTU = Nephelometric Turbidity Units
- µg/L = Picograms per Liter
- TON = Threshold Odor Number
- µg/L = Micograms per Liter
- µmhos/cm = Micromhos per Centimeter
- H = Analyzed outside of hold time
- MPN/100mL = The most probable number (MPN) of coliform or fecal coliform bacteria per 100 milliliter
- ND = NOT DETECTED at or above the Reporting Limit or Practical Quantitation Limit. If J-value reported, then NOT DETECTED at or above the Method Detection Limit (MDL)
- N/A = No Lab Results available
- RP = Results to be provided

¹ Laboratory water quality reports will be provided in the Test Slant Well and monitoring well completion report.

* Laboratory water quality results pending.

CONSTITUENT	UNIT	MW-6D	MW-6M	MW-6S	MW-7D	MW-7M	MW-7S	MW-8D	MW-8D	MW-8M	MW-8M	MW-8S	MW-8S	MW-9D	MW-9D	MW-9M	MW-9M	MW-9S	MW-9S
		4/2/2015	4/4/2015	4/5/2015	9-Aug-15	2-Aug-15	3-Aug-15	5/21/2015	6/23/2015	5/27/2015	6/23/2015	5/28/2015	6/23/2015	25-Jun-15	28-Jul-15	28-Jun-15	28-Jul-15	30-Jun-15	28-Jul-15
ALKALINITY, TOTAL (as CaCO ₃)	mg/L	117	397	366	109	98	29	152	112	140	155	320	302	170	176	127	128	1,051	1,019
ALUMINUM, TOTAL	µg/L	ND	ND	ND	ND	18	ND	37	128	292	ND	ND	ND	ND	ND	ND	ND	11	ND
AMMONIA-N	mg/L	NA	NA	NA				NA	NA	NA	NA	NA	NA						
AMMONIA-N, DISSOLVED	mg/L	ND	0.17	0.45	ND	ND	0.08	ND	ND	ND	ND	ND	ND	ND	0.07	0.12	0.17	2.83	2.86
AMMONIA-NH ₃ (CALC) UN-IONIZED	ug/L	NA	NA	NA				NA	NA	NA	NA	NA	NA						
ARSENIC, TOTAL	µg/L	3	5	16	41	4	1	1	11	28	24	1	1	2	2	39	35	11	12
BARIUM, DISSOLVED	µg/L	255	155	105	110	282	199	88	178	154	119	57	75	59	48	163	141	315	273
BICARBONATE (AS HCO ₃ -)	mg/L	143	484	447	133	120	35	185	137	171	189	390	368	207	215	155	156	1,282	1,243
BORON, DISSOLVED	mg/L	ND	ND	ND	1.71	ND	ND	0.05	0.66	1.83	1.37	0.22	0.29	0.08	0.07	2.93	2.77	0.69	0.64
BROMIDE, DISSOLVED	mg/L	2	0.5	0.2	44.3	6.6	1.3	0.6	11.5	42.1	33.6	0.9	1	0.2	0.2	49.6	47.6	4.2	3.5
CALCIUM	mg/L	341	139	93	1,900	507	120	64	413	1110	1500	149	142	32	34	878	1,060	209	234
CALCIUM, DISSOLVED	mg/L	347	140	92	1,890	520	114	59	416	1140	1500	151	139	35	33	869	1,100	242	235
CARBAMATES BY HPLC (EPA 531)	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	NA	ND	ND	ND	ND		ND	ND	ND	ND
CARBONATE AS CaCO ₃	mg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
CHLORIDE, DISSOLVED	mg/L	814	167	57	13,589	1,739	387	220	3995	12380	10546	261	251	74	75	16,519	10,436	1,199	1,038
CHLORINATED PESTICIDES AND PCB (EPA 508)	µg/L	ND	A	A	A	ND	ND	ND	ND	ND	ND	A	A	ND		ND		ND	
CHLORINE RESIDUAL, TOTAL (LABORATORY)	mg/L (H)	NA	NA	NA					NA	NA	NA	NA	NA						
COLIFORM, E. COLI (QUANTITRAY)	MPN/100ml	NA	NA	NA					NA	NA	NA	NA	NA						
COLIFORM, E. COLI (QUANTITRAY) - 18 HOUR	MPN/100ml	NA	NA	NA					NA	NA	NA	NA	NA						
COLIFORM, TOTAL (QUANTITRAY)	MPN/100ml	NA	NA	NA					NA	NA	NA	NA	NA						
COLIFORM, TOTAL (QUANTITRAY) - 18 HOUR	MPN/100ml	NA	NA	NA					NA	NA	NA	NA	NA						
COLOR, APPARENT (UNFILTERED)	CU	5	16	20	ND	ND	ND	11	16	ND	7	3	ND	ND	3	6	14	175	60
COPPER, TOTAL	µg/L	8	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	10	ND	ND	ND	ND	ND
DBCP & EDB	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
DIOXIN	pg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
DIQUAT (EPA 549)	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
DISSOLVED OXYGEN (FIELD)	mg/L (H)	NA	NA	NA					NA	NA	NA	NA	NA						
DISSOLVED OXYGEN (LABORATORY)	mg/L (H)	NA	NA	NA					NA	NA	NA	NA	NA						
ENDOTHALL	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
FLUORIDE, DISSOLVED	mg/L	0.1	ND	0.2	ND	ND	0.1	0.3	ND	0.4	ND	0.1	ND	0.3	0.3	ND	ND	ND	0.4
GLYPHOSATE	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
HARDNESS (AS CaCO ₃)	mg/L	1222	565	393	9,030	2,044	547	263	2057	6080	6698	578	556	133	138	6,718	7,296	1,218	1,206
HYDROXIDE	mg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
IODIDE	µg/L	ND	35	35	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	500	330
IRON	µg/L	ND	184	315	ND	ND	33	81	274	ND	ND	104	ND	10	ND	670	1,540	6,964	6,878
IRON, DISSOLVED	µg/L	ND	182	315	ND	ND	26	15	ND	ND	ND	99	ND	ND	ND	667	1,520	6,300	1,400
KIEHLDAHL NITROGEN, DISSOLVED	mg/L	ND	0.7	1	ND	ND	0.09	ND	ND	ND	ND	ND	ND	ND	0.11	0.2	0.19	6.12	2.9
LITHIUM	µg/L	25	17	6	271	29	5	49	157	132	132	ND	6	38	39	289	296	23	20
MAGNESIUM	mg/L	90	53	39	1,040	189	60	25	249	801	717	50	49	13	13	1,100	1,130	169	151
MAGNESIUM, DISSOLVED	mg/L	83	49	37	1,010	192	58	23	250	828	692	51	47	13	13	1,090	1,140	161	152
MANGANESE, DISSOLVED	µg/L	714	821	2090	230	372	476	283	759	353	642	ND	76	247	186	1,120	1,410	4,920	4,830
MANGANESE, TOTAL	µg/L	750	810	1880	232	372	500	310	847	354	668	ND	86	254	188	1,160	1,380	5,140	4,840
MBAS (SURFACTANTS)	mg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND
NITRATE AS NO ₃	mg/L	2	ND	ND	6	15	198	2	6	5	6	123	115	2	2	5	6	ND	ND
NITRATE+NITRITE AS N	mg/L	0.7	0.5	0.5	1.4	3.4	44.8	0.7	1.3	1.5	1.4	28.2	26.8	0.9	0.8	1.2	1.3	2.5	1.2
NITRITE AS NO ₂ -N, DISSOLVED	mg/L	0.2	0.1	0.5	ND	ND	0.1	0.3	ND	0.4	ND	0.4	0.8	0.3	0.3	ND	ND	2.5	1.2
ODOR THRESHOLD AT 60 C	TON	1	1	2	1	2	2	1	2	1	1	2	1	1	2	1	2	2	5
OIL & GREASE (HEM)	mg/L	NA	NA	NA					NA	NA	NA	NA	NA						
o-PHOSPHATE-P	mg/L	0.05	0.32	1.55	0.05	0.016	0.035	0.06	0.04	0.06	0.04	0.1	0.13	0.06	0.13	0.06	0.04	1.34	0.28
pH (FIELD TEST)	pH	7.24	7.43	7.07	6.77	7.17	7.05	7.33	8.17	6.67	6.92	7.13	6.99	7.44	8.03	6.84	7.03	7.06	7.04
pH (LABORATORY)	pH (H)	7.4	7.1	7.1	6.9	7.2	7.3	7.6	8.2	7.2	7.2	7.4	7.2	7.5	7.8	6.9	6.9	7.1	7.1
PHENOXY ACID HERBICIDES (515.3)	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
PHOSPHORUS, DISSOLVED TOTAL	mg/L	0.06	0.31	1.38	0.02	0.017	0.04	0.06	ND	0.07	ND	0.11	0.07	0.12	0.029	0.06	ND	1.4	0.16
POTASSIUM	mg/L	7.1	6.4	7.6	57	10	5.9	5.1	41	108	55	4.1	5	3.5	6.1	197	168	14	13
POTASSIUM, DISSOLVED	mg/L	8	7	7.2	55	10	5.5	4.6	42	111	50	4.3	4.8	3.6	6	196	167	12.8	13
QC RATIO TDS/SEC		0.67	0.63	0.61	0.69	0.68	0.68	0.56	0.58	0.69	0.7	0.62	0.63	0.59	0.61	0.66	0.69	0.6	0.58
REG. ORG. COMPOUNDS (EPA 525)	µg/L	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND	ND		ND		ND	
SETTLABLE SOLIDS	mL/L	NA	NA	NA					NA	NA	NA	NA	NA						
SILICA AS SiO ₂ , DISSOLVED	mg/L	44	44	34	35	30	37	45	33	30	33	37	40	45	44	35	30	43	40
SODIUM	mg/L	77	140	79	6,834	338	124	148	2192	6106	5310	262	245	68	75	8,407	8,224	732	691
SODIUM, DISSOLVED	mg/L	78	141	79	6,540	342	119	135	2290	6270	4950	265	239	68	74	8,430	8,240	698	692
SPECIFIC CONDUCTANCE (E.C)	µmhos/cm	2758	1545	989	38,800	5,650	1,768	1045	12190	35020	29320	2036	1935	624	617	44,090	44,660	5,330	5,190
SPECIFIC CONDUCTANCE (E.C) (FIELD)	µmhos/cm	2859	1531	869	39,065	5,507	1,762	1113	15312	35040	29888	2004	1932	574	658	44,462	45,724	5,384	5,255
STRONTIUM, DISSOLVED	µg/L	1826	761	561	12,676	3,689	1,327	470	3536	8504	8507	868	855	273	260	8,148	8,301	3,064	1,861
SULFATE	mg/L	NA	NA	NA					NA	NA	NA	NA	NA						
SULFATE, DISSOLVED	mg/L	85	175	87	1,882	176	61	32	541	1743	1430	258	239	25	23	2,286	2,207	210	220
TEMPERATURE	°C	NA	NA	NA					NA	NA	NA	NA	NA						
TEMPERATURE (FIELD)	°C	10.6	16.8	NA	19.7	18.4	18.2	21.2	19.2	17.17	17.2	16.83	17	21.2	20.2	17.2	17.3	17.3	17.1
TOTAL DISS. SOLIDS	mg/L	1840	966	608	26,700	3,832	1,200	583	7100	24000	20500	1260	1214	366	377	29,000	30,600	3,204	2,997
TOTAL SUSP. SOLIDS	mg/L	NA	NA	NA					NA	NA	NA	NA	NA						
TURBIDITY	NTU	0.2	0.7	2.6	0.2	0.2	0.3	0.55	1.9	0.1	0.2	0.1	0.15	0.1	0.5	1.3	3	55	50
TURBIDITY (FIELD)	NTU	0.59	0.7	0.62	0.85	0.88	0.7	2.48	1	0.56	1	0.92	1	0.86	0.7	0.29	0.3	0.82	0.2
VOLATILE ORG. COMPOUNDS (524)	µg/L	ND	ND	ND	ND	A	ND	ND	ND	ND	ND	A	A	ND		ND		A	
ZINC, TOTAL	µg/L	24	ND	ND	ND	ND	ND	ND	ND	340	ND	636	ND	22	ND	ND	ND	ND	ND

Appendix F: Water Shortage Contingency Plan with Resolution of Adoption

The following documents are included in this appendix:

1. Resolution 2015-33, dated July 6, 2015, Adopting an Updated Water Shortage Contingency Plan
2. MCWD Water Shortage Contingency Plan, dated July 6, 2015
3. Resolution 2014-34, dated November 3, 2014, Declaring Water Conservation Stage 3 (included as an example of an implementing resolution)

July 6, 2015

Resolution No. 2015-33
Resolution of the Board of Directors
Marina Coast Water District
Adopting an Updated Water Shortage Contingency Plan

RESOLVED by the Board of Directors (“Directors”) of the Marina Coast Water District (“MCWD”), at a regular meeting duly called and held on July 6, 2015, at 211 Hillcrest Avenue, Marina, California as follows:

WHEREAS, Section 10632 of the California Water Code requires the Marina Coast Water District to maintain a Water Shortage Contingency Plan within its Urban Water Management Plan; and,

WHEREAS, the District maintains a Water Shortage Contingency Plan and desires to update said plan in accordance with the Water Code and provide a guidance document for management of water shortages within the District; and,

WHEREAS, due to ongoing historic drought conditions, the District desires to incorporate current mandatory water conservation measures into an updated Water Shortage Contingency Plan.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby:

1. Approve and adopt the attached Water Shortage Contingency Plan, and,
2. Authorize the Interim General Manager to file the Water Shortage Contingency Plan with the California Department of Water Resources.

PASSED AND ADOPTED on July 6, 2015 by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Shriner, Moore, Lee, Le

Noes: Directors None


Absent: Directors Gustafson

Abstained: Directors None



Peter Le, Vice President


ATTEST:

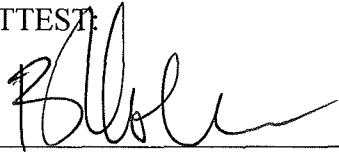

Bill Kocher, Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2015-33 adopted July 6, 2015.



Bill Kocher, Secretary

MARINA COAST WATER DISTRICT WATER SHORTAGE CONTINGENCY PLAN

1.0 INTRODUCTION AND BACKGROUND

This Water Shortage Contingency Plan is developed in compliance with California Water Code Section 10632. Requirements of subsections (a)(1)-(a)(9) and (b) are identified below and are accompanied by the required elements and information.

The Marina Coast Water District (MCWD) obtains its water supply from the Salinas Valley Groundwater Basin (SVGB). The SVGB is not adjudicated and provides water for growers, municipalities and other municipal and industrial uses in the Salinas Valley. Due to cumulative basin pumping, coastal aquifers are experiencing seawater intrusion. MCWD continues to work with Monterey County Water Resources Agency (MCWRA) in developing plans to coordinate and encourage preservation of the SVGB aquifers by all municipal and agricultural users.

In 2005, MCWD interconnected its two service areas, Central Marina and the Ord Community. The interconnection has improved system-wide reliability, making maximum use of available water storage tanks in the Ord Community and allowing both areas to be served by any of the eight District wells. In 2007, the District consolidated the two systems under a single Public Water System Permit.

The District continues its participation as a member of the Water Awareness Committee of Monterey County (WAC). Through the WAC, representatives from several agencies throughout Monterey County work together coordinating conservation and other water awareness efforts including education programs, information booths for special events and public understanding of Monterey County water challenges and opportunities.

California Water Code Section 10632(a)(3) Actions to be undertaken by the urban water supplier to prepare for, and implement during, a catastrophic interruption of water supplies, including but not limited to, a regional power outage, an earthquake or other disaster.

The MCWD developed and adopted an Emergency Response Plan¹ for emergency and disaster occurrences with guidelines and agreements for cooperative efforts with other State and local agencies, as required by the State Water Resources Control Board, Division of Drinking Water (DDW). This Plan contains actions MCWD would initiate in the event of a catastrophic reduction in its water supply.

2.0 STAGES OF ACTION

California Water Code Section 10632(a)(1) Stages of action to be undertaken by the urban water supplier in response to water supply shortages, including up to a 50 percent reduction in water supply and an outline of specific water supply conditions which are applicable to each stage.

¹ Ordinance 44, adopted in 2007

The MCWD has developed a five-stage Water Conservation Plan that includes two voluntary and three mandatory stages. Table 1 generally describes the various stages. Specific water supply conditions applicable to each stage, referred to as “triggering mechanisms” herein, are discussed in the next section.

Table 1: Water Conservation Stages and Demand Reduction Goals

<u>Stage</u>	<u>Water Shortage Level</u>	<u>Demand Reduction Goal</u>	<u>Type Program</u>
Stage 1	0 – 10%	10% reduction	Voluntary Compliance
Stage 2	>10 - 25%	20% reduction	Voluntary Compliance
Stage 3	>25 - 35%	30% reduction	Mandatory Compliance
Stage 4	>35 – 50%	40% reduction	Mandatory Compliance
Stage 5	>50%	50%+ reduction	Mandatory Compliance
<p>Priorities for use of available water, based on California Water Code Chapter 3 are:</p> <ol style="list-style-type: none"> 1. Health and Safety - interior residential and fire fighting 2. Commercial, Industrial, and Governmental - maintain jobs & economic base 3. Existing Landscaping - especially trees and shrubs 4. New Demand - projects without permits when shortage declared 			

California Water Code Section 10632(a)(2) An estimate of the minimum water supply available during each of the next three water years based on the driest three-year historic sequence for the agency’s water supply.

This requirement is oriented toward water supply systems that are primarily supplied with surface water and are therefore directly affected by short-term fluctuations in hydrology (i.e., drought conditions). MCWD’s current water supply is produced through groundwater pumping from the large SVGB. MCWD supply availability from this basin has not historically varied due to short-term hydrologic conditions. MCWD’s wells are located in the Pressure Sub-Area of the SVGB. Within the Pressure Sub-Area, the historic difference between water levels under average and drought conditions is only 10- to 20-feet. The minimum water supply available during the driest three-year sequence is expected to match demands as discussed in the Urban Water Management Plan.

3.0 TRIGGERING MECHANISMS

The SVGB is currently the most important source of water for MCWD. In 2004, the MCWD's groundwater withdrawals of about 4,600 acre-feet accounted for less than one percent (1%) of the estimated basin-wide annual extractions of roughly 550,000 acre-feet. Given this relatively small percentage, MCWD conservation and contingency management activities can play only a small part within the SVGB. The foremost concern in developing appropriate triggers is achieving the maximum practical protection of an adequate long-term water supply of acceptable quality for MCWD customers. To that end, triggering mechanisms should be tied to factors that, directly or indirectly, have the greatest potential effect on the quality and quantity of available groundwater. Two general types of threats could cause MCWD to experience water shortages:

1. Unanticipated catastrophic system failure due to an earthquake, terrorist attack or sudden contamination of water supply, or
2. Chronic system shortage due to seawater intrusion reaching water supply wells in

concentrations such that those wells would have to be removed from service.

In the case of a catastrophic failure, the MCWD would assess the nature and extent of the failure, and the General Manager would identify the appropriate Conservation Stage in accordance with the expected level of water supply shortage. Should shortages be anticipated in amounts beyond fifty percent of normal demands, emergency actions will be taken in accordance with the MCWD's Emergency Response Plan, including enacting emergency ordinances as may be required by MCWD Board of Directors.

The chronic system threat to MCWD's present water supplies is seawater intrusion, which has occurred along the coastal margin of the Salinas Valley in response to historic over-drafting of the basin. Contamination from volatile organic compounds (VOCs) has also affected MCWD wells and could pose additional problems. Although seawater intrusion has not yet affected the deep zone (900-Foot Aquifer) of the SVGB (which is the source of supply for District Wells No.10, 11, 12 and 34), it is possible that continued extractions in the 900-Foot Aquifer could ultimately lead to contamination of these water supplies by seawater. MCWD monitors the rate of seawater intrusion and plans to develop alternative water resources that would be insulated from intrusion. However, it is possible for intrusion to appear in a relatively short time span and reduce overall supplies available. Consequently, the MCWD has structured this Water Shortage Contingency Plan with the primary goal of reducing water demands to allow time for alternative water supply measures, including the drilling of alternate wells in areas unaffected by intrusion and/or contamination. A specific triggering mechanism for various levels of conservation is tied to concentrations of chlorides in MCWD wells and possible concentrations of VOCs, such as trichloroethylene (TCE) which was previously observed at low levels in Well No. 9 (no longer in service) in Central Marina and is occasionally detected at Wells No. 29, 30 and 31 in the Ord Community. Chloride concentration is directly related to the seawater intrusion problem, and both parameters (chloride and VOCs) are related to the overall basin viability as a secure source of water supply.

Chloride concentration is a key indicator of water quality degradation due to seawater intrusion. Tests for statistically significant changes in chloride concentrations assist in the detection of the earliest stages of intrusion and are appropriate indicators of a water supply emergency. In addition, MCWD currently monitors its Ord Community wells for the presence of TCE and other organic compounds, and works with the U.S. Army regarding the Army's groundwater cleanup actions in the Ord Community.

Climate conditions are monitored by the State of California and by Monterey County. Monterey County specifically monitors water levels in the Salinas Valley Groundwater Basin. During prolonged or extended periods of drought, the State of California, acting through the Legislature, the State Water Resources Control Board (SWRCB) and/or the Department of Water Resources may enact rules or legislation directing urban water suppliers to implement demand reduction measures. Similarly, the County of Monterey, acting through the Board of Supervisors and/or the Monterey County Water Resources Agency may enact rules or ordinances directing urban water suppliers to implement demand reduction measures. Such legislation, rules or ordinances shall be considered as triggering mechanisms under this Plan.

TRIGGERING MECHANISMS FOR CONSERVATION STAGES

These Triggering mechanisms shall be interpreted as guidelines and are summarized in Table 2. The General Manager and/or Board of Directors may impose any of the following conservation stages based upon facts and circumstances which may not have been otherwise anticipated in this plan.

Table 2 Conservation Level Triggering Mechanisms

Conservation Stage and Water Shortage Level	Triggering Mechanism
Stage One 0-10% Water Shortage Voluntary Compliance	1) system malfunction resulting in up to 10% shortage 2) increase in chlorides which do not threaten to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Two >10-25% Water Shortage Voluntary Compliance	1) system malfunction resulting in greater than 10% shortage 2) increase in chlorides which may threaten to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Three >25-35% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 25% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced by up to 25% 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Four >35-50% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 35% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard 3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced more than 35% 4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions
Stage Five >50% Water Shortage Mandatory Compliance	1) system malfunction resulting in greater than 50% shortage 2) increase in chlorides which are expected to exceed drinking water quality standard

	<p>3) increase in VOC concentrations which do not threaten to exceed standards with blending or when remaining capacity is reduced more than 50%</p> <p>4) directive by the State of California or the County of Monterey to implement demand reduction measures in response to drought conditions</p>
--	--

STAGE 1 Triggers: Up to 10% Water Supply Shortage

Stage 1 conservation measures may be called for as a result of malfunction of all or portions of the water system that reduces supplies by up to 10% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey, and/or the determination that there is a need to focus public attention on water conservation.

Further triggering could also be based on:

- 1) detection of a statistically significant increase in chloride concentrations but where such concentrations do not threaten to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of a statistically significant increase in VOC concentrations but where such concentrations do not threaten to exceed the primary drinking water maximum contaminant level (MCL) for each VOC at the well(s) in question and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards.

STAGE 2 Triggers: >10% to 25% Water Supply Shortage

Stage 2 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 10% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey, and/or the determination that there is a need to focus public attention on water conservation.

Further triggering could also be based on:

- 1) detection of a statistically significant increase in chloride concentrations where such concentrations may threaten to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of a statistically significant increase in VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC at the well(s) in question and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards.

STAGE 3 Triggers: >25% to 35% Water Supply Shortage

Stage 3 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 25% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or when gross reduced well production of up to 25% is necessary to maintain adequate water quality.

STAGE 4 Triggers: >35% to 50% Water Supply Shortage

Stage 4 conservation measures may be called for due to malfunction or failure of all or portions of the water system that reduces supplies by greater than 35% on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the DDW “Upper Level” secondary (aesthetics) drinking water standard currently set at 500 mg/l at the well(s) in question, or
- 2) detection of VOC concentrations, but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and/or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or gross reduced well production of up to 35% is necessary to maintain adequate water quality.

STAGE 5 Triggers: >50% Water Supply Shortage

Stage 5 conservation measures may be called for due to in malfunction or failure of all or portions of the water system that reduces supplies by 50 % or more on a daily, peak seasonal or annual basis. It also may be called due to prolonged drought conditions that result in legislation, rules or ordinances enacted by the State of California and/or the County of Monterey.

Further triggering could also be based on:

- 1) detection of an increase in chloride concentrations where such concentrations are expected to exceed the short term primary drinking water standard of 600 mg/l at

- the well(s) in question, or
- 2) detection of VOC concentrations but where such concentrations do not threaten to exceed the primary drinking water MCL for each VOC, and /or blending of this supply with other well supplies cannot maintain a distribution system concentration(s) below these standards, and/or gross reduced well production of over 50% is necessary to maintain adequate water quality.

4.0 CONSERVATION REQUIREMENTS AND APPEAL PROCEDURES

The following are MCWD's conservation requirements by customer type and stage and the appeal procedures. These requirements and procedures are adopted as part of MCWD's Water Shortage Contingency Plan.

STAGE 1 Actions: Voluntary – Minimal Conservation Requirement, 10% Demand Reduction Goal

MCWD shall:

- notify all customers of the water shortage
- mail information to every customer and reasonably available potential water user explaining the importance of significant water use reductions
- provide technical information to customers on ways to improve water use efficiency
- conduct media campaign to remind consumers of the need to save water
- publicize the showerhead, toilet rebate and other efficiency programs
- enforce mandatory restrictions on water waste as provided in MCWD Code, Chapter 3

Stage 1 actions shall apply under any triggering event.

STAGE 2 Actions: Voluntary – Moderate Conservation Requirement, 20% Demand Reduction Goal

In addition to the actions listed in Stage 1, MCWD shall call for voluntary reductions of up to 25% for each connection based on the average use during a base period proposed by the Water Conservation Commission and adopted by MCWD's Board of Directors. Stage 2 actions shall apply under any triggering event.

STAGE 3 Actions: Mandatory – Severe Conservation Requirement, 30% Demand Reduction Goal

In addition to the actions listed in Stage 1 and 2, MCWD shall establish mandatory annual allotments for each connection based on the average use of all connections within that category during a base period proposed by the Water Conservation Commission and adopted by MCWD's Board of Directors. When Stage 3 use reductions become necessary, administration and enforcement of the District's mandatory restrictions on water waste become the major focus of MCWD. If necessary, additional temporary personnel may be hired and special meetings of the Water Conservation Commission and /or Board of Directors may be scheduled.

Stage 3 actions shall be applied based upon triggering event, as noted below.

1. Each water service connection shall receive an allotted quantity of water, typically specified in hundred cubic feet (hcf) units per billing cycle. The Board of Directors may elect not to impose this action in response to a drought if the supply reduction trigger is not met.
2. The Board of Directors may pass an emergency ordinance increasing the usage rate for potable water consumed over a connections allocation, and/or in order to ensure stable revenues for operation and maintenance of MCWD. The Board of Directors may elect not to impose this action if water service allocations are not imposed.
3. As individual customers are notified of allotments, it is expected that many requests for special consideration will be received. These petitions must be processed rapidly, efficiently and fairly. Every application for waiver must be heard, evaluated and acted upon by the Water Conservation Commission as rapidly as possible. Every action by the Water Conservation Commission shall be referred to MCWD's Board of Directors for consideration. The procedures for appeal are defined, below. Appeals shall be considered under any Stage in which mandatory restrictions or allocations are imposed.
4. No building permits will be issued or meters installed for new accounts that had not received building permits before the "Severe Shortage" was declared. The Board of Directors may elect not to impose this action in response to a drought if the supply reduction trigger is not met.
5. The following water use restrictions shall be imposed.

Stage	Type Use	Restriction	Applies
3	Existing, Irrigated Landscapes Commercial Complexes, Residential Units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering using sprinklers or automated irrigation systems is permitted only two days per week, Wednesdays and Saturdays, before 10:00 a.m. or after 5:00 p.m. The Board of Directors may choose to assign different watering days to specific areas if daily system-wide usage limits are required. (2) With on-site supervision, including supervision by a professional gardener/landscaper, landscapes may be manually watered with drip irrigation, a soaker hose, a handheld hose with a positive action shut-off nozzle, or a watering can/bucket at any time, on any day, not more than 2 days per week. (3) Irrigation of ornamental turf in roadway medians and parkway strips is prohibited. Plantings of trees, shrubs, ornamental grasses, and ground covers with low water demand, watered by drip irrigation, are encouraged.	During both Water Shortage and Drought Conditions
3	New, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering is permitted three (3) days a week to maintain adequate growth on newly installed landscapes, for a period generally up to five (5) weeks. Watering days for new landscapes are Monday, Wednesday, and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation. (2) Following the initial establishment period, landscape watering using sprinklers or automated irrigation systems is permitted only on the days associated with the current conservation stage in effect.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
3	Golf Courses	<p>Landscape watering with recycled water or other non-potable water sources may continue without restriction.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (2) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). (3) Course operators shall implement a plan to achieve a twenty (20) percent reduction in monthly irrigation water use. 	During both Water Shortage and Drought Conditions
3	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must offer and clearly notify guests of a "limited linen/towel exchange" program.	During both Water Shortage and Drought Conditions
3	Swimming pools, hot tubs	Initially filling new and existing swimming pools is prohibited. Draining and refilling existing swimming pools is permitted only if repairing a pool leak or repairing, maintaining or replacing a pool component that has become hazardous. All pools and tubs shall be covered when not in use to reduce evaporation.	During both Water Shortage and Drought Conditions
3	Decorative fountains, ponds and waterfalls over 20 gallons in size	Initially filling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals.	During both Water Shortage and Drought Conditions
3	Industrial and Commercial	Reduction of water use by any means is encouraged. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
3	Vehicle and Equipment Washing	<p>Washing of vehicles and mobile equipment (e.g., washing vehicle at a residence) is permitted on any day, any time of the day, with the use of a positive action shut-off nozzle.</p> <p>All customers are encouraged to only wash those vehicles as is necessary for health and safety utilizing commercial car wash facilities.</p>	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
3	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible.	During both Water Shortage and Drought Conditions

STAGE 4 Actions: Mandatory – Critical Conservation Requirement, 40% Demand Reduction Goal

In addition to the actions listed in the previous stages, MCWD shall establish allotments based upon a 35% -50% curtailment of water use. All new and previous appeals for waiver shall be evaluated by field audit and shall be reheard by the Water Conservation Commission, if necessary, upon recommendation of MCWD staff. Water rates may be increased by the Board of Directors.

The following water use restrictions shall be imposed.

Stage	Type Use	Restriction	Applies
4	Existing, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (1) Landscape watering using sprinklers or automated irrigation systems is permitted only one day per week, on Wednesdays before 10:00 a.m. or after 5:00 p.m. The Board of Directors may choose to assign different watering days to specific areas if daily system-wide usage limits are required. (2) With on-site supervision, including supervision by a professional gardener/landscaper, landscapes may be manually watered with drip irrigation, a soaker hose, a handheld hose with a positive action shut-off nozzle, or a watering can/bucket at any time, on any day, not more than 1 day per week. (3) Irrigation of ornamental turf in roadway medians and parkway strips is prohibited. Plantings of trees, shrubs, ornamental grasses, and ground covers with low water demand, watered by drip irrigation, are encouraged.	During both Water Shortage and Drought Conditions
4	New, Irrigated Landscapes	Landscape watering with recycled or other non-potable water sources water may continue without restriction.	During both Water

Stage	Type Use	Restriction	Applies
	Commercial Complexes, Residential units, Public Parks, and Athletic Fields	<p>The installation of new landscapes irrigated with potable water is discouraged.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) Landscape watering is permitted three (3) days a week to maintain adequate growth on newly installed landscapes, for a period generally up to five (5) weeks. Watering days for new landscapes are Monday, Wednesday, and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation. (2) Following the initial establishment period, landscape watering using sprinklers or automated irrigation systems is permitted only on the days associated with the current conservation stage in effect. 	Shortage and Drought Conditions
4	Golf Courses	<p>Landscape watering with recycled water or other non-potable water sources may continue without restriction.</p> <p>Landscape watering with potable water shall be subject to the following limits:</p> <ul style="list-style-type: none"> (1) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (2) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). <p>Course operators shall implement a plan to achieve a thirty (30) percent reduction in monthly irrigation water use.</p>	During both Water Shortage and Drought Conditions
4	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must limit linen/towel changes to once every two (2) nights or for the entire stay, whichever is shorter, except for health and safety.	During both Water Shortage and Drought Conditions
4	Swimming pools, hot tubs	Initially filling new and existing swimming pools is prohibited. Draining and refilling existing swimming pools is permitted only if repairing a pool leak or repairing, maintaining or replacing a pool component that has become hazardous. All pools and tubs shall be covered when not in use to reduce evaporation.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
4	Decorative fountains, ponds and waterfalls over 20 gallons in size	Filling or refilling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals. Owners are encouraged to move fish and aquatic animals to indoor tanks less subject to evaporation.	During both Water Shortage and Drought Conditions
4	Vehicle and Equipment Washing	Washing of vehicles and mobile equipment (e.g., washing vehicle at a residence) is permitted on any day, any time of the day, with the use of a positive action shut-off nozzle. All customers are encouraged to only wash those vehicles as is necessary for health and safety utilizing commercial car wash facilities.	During both Water Shortage and Drought Conditions
4	Industrial and commercial	Reduction of water use by any means is encouraged. The Board of Directors may establish mandatory use reduction targets, if needed. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
4	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible.	During both Water Shortage and Drought Conditions

STAGE 5 Actions: Mandatory – Emergency Conservation Requirement, 50% Demand Reduction Goal

Appropriate 50% water shortage allotments shall be calculated and noticed to customers. Appropriate administration and enforcement of this stringent program shall be the highest priority of MCWD activity. All resources of MCWD will be directed toward improvement and increase of water supply to the system. Water rates may be further increased by the Board of Directors.

The following water use restrictions shall be imposed:

Stage	Type Use	Restriction	Applies
5	Existing, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water is prohibited.	During both Water Shortage and Drought Conditions
5	New, Irrigated Landscapes Commercial Complexes, Residential units, Public Parks, and Athletic Fields	Landscape watering with recycled water or other non-potable water sources may continue without restriction. The installation of new landscapes irrigated with potable water is prohibited during Conservation Stage 5. New landscapes installed prior to declaration of Conservation Stage 5 may water two (2) days a week to maintain adequate growth on newly installed landscapes, for the remainder of the initial five (5) week establishment period. Watering days for new landscapes are Wednesday and Saturday. Property owners must notify the District of the address where new landscape is installed and the date of installation	During both Water Shortage and Drought Conditions
5	Golf Courses	Landscape watering with recycled water or other non-potable water sources may continue without restriction. Landscape watering with potable water shall be subject to the following limits: (3) All landscape out-of-play areas such as may be found around a clubhouse or entryway shall follow the general landscape irrigation restrictions. (4) All in-play areas may be irrigated during the standard watering hours (before 10:00 a.m. or after 5:00 p.m.). Course operators shall implement a plan to achieve a forty (40) percent reduction in monthly irrigation water use.	During both Water Shortage and Drought Conditions
5	Hotels, motels and bed and breakfasts	Hotels, motels and B&B's must limit linen/towel changes to once every three (3) nights or for the entire stay, whichever is shorter, except for health and safety.	During both Water Shortage and Drought Conditions

Stage	Type Use	Restriction	Applies
5	Swimming pools, hot tubs	Filling new swimming pools and/or draining and refilling existing swimming pools is prohibited. All pools and tubs shall be covered when not in use to reduce evaporation. Contact District conservation staff if an existing swimming pool must be repaired and refilled during Conservation Stage 5.	During both Water Shortage and Drought Conditions
5	Decorative fountains, ponds and waterfalls over 20 gallons in size	Filling or refilling new and existing decorative fountains, ponds and waterfalls is prohibited. Adding water to make up for evaporative loss is allowed only for ponds and fountains that serve as aquarium tanks for fish or aquatic animals. Owners are encouraged to move fish and aquatic animals to indoor tanks less subject to evaporation.	During both Water Shortage and Drought Conditions
5	Vehicle and Equipment Washing	Washing of vehicles and mobile equipment is prohibited. Only commercial facilities with water recycling systems may be used.	During both Water Shortage and Drought
5	Industrial and commercial	Reduction of water use by any means is encouraged. The Board of Directors may establish mandatory use reduction targets, if needed. Compliance with mandatory demand reduction measures is required for outdoor water uses including landscape irrigation, swimming pools, and vehicle washing.	During both Water Shortage and Drought Conditions
5	Heavy Construction	The use of potable water for dust control shall be reduced to the greatest extent possible. The District may establish mandatory construction water budgets, if needed.	During both Water Shortage and Drought Conditions

Appeals Procedure

1. Any person who wishes to appeal a customer classification or allotment shall do so in writing by using the forms provided by MCWD.
2. Appeals will be reviewed by the District staff. Site visits may be scheduled if required.
3. A condition of granting an appeal shall be that all plumbing fixtures or irrigation systems be replaced or modified for maximum water conservation.
4. Examples of appeals that may be considered are as follows:
 - a. Substantial medical requirements.

- b. Commercial/Industrial/Institutional accounts where any additional water supply reductions will result in unemployment or inappropriate hardship, after confirmation by the MCWD staff that the account has instituted all applicable water efficiency improvements.
5. In the event an appeal is requested for irrigation of trees or vegetation, MCWD staff may use the services of a qualified consultant in determining the validity of the request. Costs for such consulting services shall be paid by the party or parties making the request.
 6. District staff shall refer all appeals to the Water Conservation Commission. The Water Conservation Commission may refer appeals to MCWD's Board of Directors.
 7. If the Water Conservation Commission and the applicant are unable to reach accord, then the appeal shall be heard by the MCWD Board of Directors, who will make the final determination.
 8. All appeals shall be reported monthly to the Board as a part of the Water Supply Report.

5.0 MANDATORY PROHIBITIONS ON WATER USE

California Water Code Section 10632(a)(4) Additional, mandatory prohibitions against specific water use practices during water shortages, including, but not limited to, prohibiting the use of potable water for street cleaning. Section 10632(b) Commencing with the urban water management plan update due December 31, 2015, for purposes of developing the water shortage contingency analysis pursuant to subdivision (a), the urban water supplier shall analyze and define water features that are artificially supplied with water, including ponds, lakes, waterfalls, and fountains, separately from swimming pools and spas, as defined in subdivision (a) of Section 115921 of the Health and Safety Code. Section 10632(a)(5) Consumption reduction methods in the most restrictive stages. Each urban water supplier may use any type of consumption reduction methods in its water shortage contingency analysis that would reduce water use, are appropriate for its area, and have the ability to achieve a water use reduction consistent with up to a 50 percent reduction in water supply.

The MCWD adopted a "Water Waste/Water Conservation" Ordinance (Ordinance No. 20) in April of 1990, which prohibits water waste and promotes water conservation. Since the initial adoption, revisions were adopted by the Board of Directors on April 14, 1992 and October 4, 1993. The ordinance has most recently been revised on and now appears as Chapter 3.36 of MCWD Code. Section 3.36.030, Mandatory Restrictions on Water Waste, details the applicable prohibitions of use. These prohibitions are in force at all times. Additional water use reduction methods available to water users or MCWD to adopt in order to comply with use reductions during the more restrictive stages of water shortages (Stages 4 and 5) include, but are not limited to, the following:

- a) elimination of turf irrigation with potable supplies;
- b) restriction of landscape watering to shrubs and trees by hand or drip irrigation only;
- c) elimination of vehicle washing except in car washes that have water recirculation

systems;

- d) prohibition on filling or topping off of swimming pools where damage to pumping equipment will not result;
- e) elimination of the issuance of construction meters;
- f) shut-off of dedicated landscape irrigation meters; and
- g) moratorium on provision of new supply meters.

If water use reductions called for in Stages 3-5 are not achieved, the MCWD may amend this Water Shortage Contingency Plan to make any of the above available conservation tactics mandatory.

6.0 PENALTIES OR CHARGES FOR EXCESSIVE USE

California Water Code Section 10632(a)(6) Penalties or charges for excessive use.

Section 3.36.050 of MCWD Code provides for a system of violations and notices. Violation of provisions of this Water Shortage Contingency Plan shall be enforced under Section 3.36.050 of MCWD Code.

7.0 REVENUE AND EXPENDITURE IMPACTS

California Water Code Section 10632(a)(7) – An analysis of the impacts of each of the actions and conditions described in subdivisions (a)(1) to (a)(6), inclusive, on the revenues and expenditures of the urban water supplier, and proposed measures to overcome those impacts, such as the development of reserves and rate adjustments.

Enforcement of the Water Shortage Contingency Plan is assumed to be covered by enhanced revenues from application of excess use charges and penalties. MCWD reserves may be used temporarily should revenues remain below expectations. MCWD’s rate structure is based upon adopted rate ranges and allows for modification of rates on short notice within those ranges. MCWD retains the ability to modify rates to meet all legitimate MCWD needs. Revenue impacts from water sales losses are estimated as follows, based upon Tier 2 rates of \$2.79/hcf in Central Marina and \$3.27/hcf in the Ord Community, and recognizing approximately 10% of MCWD’s customers are not metered as of 2013.

Table 3: Potential Revenue Impacts of Implementation of WSCP

	Stage 1	Stage 2	Stage 3	Stage 4	Stage 5
Assumed Reduction	10 percent	20 percent	30 percent	40 percent	50 percent
Water Sales Loss	\$579,804	\$1,159,607	\$1,739,411	\$2,319,215	\$2,899,018
Revenue Source: Pumping savings at \$135/af	\$57,807	\$115,614	\$173,421	\$231,228	\$289,035
Net Revenue Reduction	\$521,997	\$1,043,993	\$1,565,990	\$2,087,987	\$2,609,983

Percent of Total Annual Water System Revenue	6%	12%	18%	24%	30%
--	----	-----	-----	-----	-----

* Table based on FY2012-13 water sales, \$8,839,268 for 4,282 acre-feet

8.0 WATER SHORTAGE CONTINGENCY PLAN IMPLEMENTATION

California Water Code Section 10632 (a)(8) A draft water shortage contingency resolution or ordinance.

MCWD Board of Directors adopted the Water Shortage Contingency Plan in Resolution No. 2014-___, which enables implementation of the Plan upon advice of staff based in part on the triggering mechanisms discussed herein. The resolution is attached as Appendix A to this Plan.

Chapter 3.36.035 of the MCWD Code of Ordinances² provides for enforcement of the current Water Shortage Contingency Plan. Chapter 2.09 of the Code of Ordinances³ contains a sample ordinance which may be adopted in the event of a local emergency, including a water shortage.

9.0 WATER USE MONITORING PROCEDURES

California Water Code Section 10632 (a)(9) A mechanism for determining actual reductions in water use pursuant to the urban water shortage contingency plan.

Normal Monitoring Procedure:

In normal water supply conditions, production figures are recorded daily by MCWD O&M personnel. Totals are reported monthly to the O&M Superintendent. Production figures are reported in the Annual Report to the Drinking Water Program, which is submitted to the SWRCB Division of Drinking Water each year.

Stage 1 and 2 Water Shortages

During a Stage 1 or 2 water shortage, daily production figures will be reported to the O&M Superintendent. The O&M Superintendent compares the weekly production to the target weekly production to verify that the reduction goal is being met. Monthly reports are forwarded to the District Engineer and the General Manager, the Water Conservation Commission and the MCWD Board of Directors. If reduction goals are not met, the General Manager may notify the Board of Directors so that corrective action can be taken.

Stage 3 and 4 Water Shortages

During a Stage 3 or 4 water shortage, the procedure listed above will be followed, with the addition of a daily production report to the General Manager and weekly reports to the Water Conservation Commission and Board of Directors. Special meetings may be called for administration of the

² Ordinance 41, adopted in 2005

³ Ordinance 44, adopted in 2007

Water Shortage Contingency Plan.

Stage 5 Water Shortage

During a Stage 5 shortage, production figures will be reported to the O&M Superintendent hourly, and to the General Manager daily. Reports will also be provided to MCWD's Board of Directors, the Monterey County Office of Emergency Services, and land use jurisdictions located within MCWD's service territory.

November 3, 2014

Resolution No. 2014-34
Resolution of the Board of Directors
Marina Coast Water District
Declaring Water Conservation Stage 3 as Required by the State Water Resource Control Board's
Emergency Mandatory Water Conservation Regulations

RESOLVED by the Board of Directors ("Directors") of the Marina Coast Water District ("MCWD"), at a regular meeting duly called and held on November 3, 2014, at 211 Hillcrest Avenue, Marina, California as follows:

WHEREAS, the State Water Resources Control Board (SWRCB) adopted Mandatory Water Conservation Regulations (Emergency Regulations), which went into effect on July 29, 2014; and,

WHEREAS, the District supplies more than 3,000 acre-feet of water annually and, therefore, the District is classified as an "urban water supplier" pursuant to Water Code Section 10617; and,

WHEREAS, the Emergency Regulations specifically require the following:

To promote water conservation, each urban water supplier shall implement all requirements and actions of the stage of its water shortage contingency plan that imposes mandatory restrictions on outdoor irrigation of ornamental landscapes or turf with potable water.

WHEREAS, on November 3, 2014, the District adopted a Water Shortage Contingency Plan (District Plan) pursuant to Water Code Section 10632; and,

WHEREAS, under the District Plan, mandatory restrictions on outdoor irrigation of ornamental landscapes or turf with potable water are not required until Stage 3; and,

WHEREAS, the District' water supply is not actually experiencing a severe water shortage; and,

WHEREAS, the Emergency Regulations require the Board of Directors to declare a Water Conservation Stage 3 even though the District is not actually experiencing a severe water shortage.

NOW, THEREFORE, BE IT RESOLVED, that the Board of Directors of the Marina Coast Water District does hereby do the following:

1. Declare a Water Conservation Stage 3 under the District Plan as mandated by the SWRCB.

2. Find that since the District’s water supply is not actually experiencing a severe water shortage, the following Stage 3 requirements shall **not** be implemented at this time, but shall be subject to periodic review by the Board of Directors:

a. “Each water service connection shall receive an allotted quantity of water, typically specified in hundred cubic feet (hcf) units per billing cycle.”

b. “No building permits will be issued or meters installed for new accounts that had not received building permits before the ‘Severe Shortage’ was declared.”

3. The Stage 3 mandatory water use restrictions set forth in the District Plan’s restrictions table for Stage 3 shall be implemented effective with the adoption of this Resolution.

4. Direct staff to notify all customers in writing of this decision within 10 days of the date of adoption.


PASSED AND ADOPTED on November 3, 2014 by the Board of Directors of the Marina Coast Water District by the following roll call vote:

Ayes: Directors Le, Shriner, Moore


Noes: Directors None

Absent: Directors Gustafson, Lee

Abstained: Directors None



Thomas P. Moore, President

ATTEST:


Brian C. Lee, Deputy Secretary

CERTIFICATE OF SECRETARY

The undersigned Secretary of the Board of the Marina Coast Water District hereby certifies that the foregoing is a full, true and correct copy of Resolution No. 2014-34 adopted November 3, 2014.


Brian C. Lee, Deputy Secretary

This page is intentionally blank.

Appendix G: DWR Urban Water Management Plan Checklist

Checklist arranged by Water Code Section

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10608.20(b)	Retail suppliers shall adopt a 2020 water use target using one of four methods.	Baselines and Targets	Section 5.7 and App E	3.4
10608.20(e)	Retail suppliers shall provide baseline daily per capita water use, urban water use target, interim urban water use target, and compliance daily per capita water use, along with the bases for determining those estimates, including references to supporting data.	Baselines and Targets	Chapter 5 and App E	3.4
10608.22	Retail suppliers' per capita daily water use reduction shall be no less than 5 percent of base daily per capita water use of the 5 year baseline. This does not apply if the suppliers base GPCD is at or below 100.	Baselines and Targets	Section 5.7.2	3.4
10608.24(a)	Retail suppliers shall meet their interim target by December 31, 2015.	Baselines and Targets	Section 5.8 and App E	3.4
10608.24(d) (2)	If the retail supplier adjusts its compliance GPCD using weather normalization, economic adjustment, or extraordinary events, it shall provide the basis for, and data supporting the adjustment.	Baselines and Targets	Section 5.8.2	N/A
10608.26(a)	Retail suppliers shall conduct a public hearing to discuss adoption, implementation, and economic impact of water use targets.	Plan Adoption, Submittal, and Implementation	Section 10.3	1.2
10608.36	Wholesale suppliers shall include an assessment of present and proposed future measures, programs, and policies to help their retail water suppliers achieve targeted water use reductions.	Baselines and Targets	Section 5.1	N/A
10608.40	Retail suppliers shall report on their progress in meeting their water use targets. The data shall be reported using a standardized form.	Baselines and Targets	Section 5.8 and App E	3.4 App H
10620(b)	Every person that becomes an urban water supplier shall adopt an urban water management plan within one year after it has become an urban water supplier.	Plan Preparation	Section 2.1	1.4 App A

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10620(d)(2)	Coordinate the preparation of its plan with other appropriate agencies in the area, including other water suppliers that share a common source, water management agencies, and relevant public agencies, to the extent practicable.	Plan Preparation	Section 2.5.2	1.3
10620(f)	Describe water management tools and options to maximize resources and minimize the need to import water from other regions.	Water Supply Reliability Assessment	Section 7.4	4.2 4.4
10621(b)	Notify, at least 60 days prior to the public hearing, any city or county within which the supplier provides water that the urban water supplier will be reviewing the plan and considering amendments or changes to the plan.	Plan Adoption, Submittal, and Implementation	Section 10.2.1	1.3 App D
10621(d)	Each urban water supplier shall update and submit its 2015 plan to the department by July 1, 2016.	Plan Adoption, Submittal, and Implementation	Sections 10.3.1 and 10.4	1.4
10631(a)	Describe the water supplier service area.	System Description	Section 3.1	2.1
10631(a)	Describe the climate of the service area of the supplier.	System Description	Section 3.3	2.2
10631(a)	Indicate the current population of the service area.	System Description and Baselines and Targets	Sections 3.4 and 5.4	2.3
10631(a)	Provide population projections for 2020, 2025, 2030, and 2035.	System Description	Section 3.4	2.3
10631(a)	Describe other demographic factors affecting the supplier's water management planning.	System Description	Section 3.4	2.4
10631(b)	Identify and quantify the existing and planned sources of water available for 2015, 2020, 2025, 2030, and 2035.	System Supplies	Chapter 6	4.1 4.2 4.4
10631(b)	Indicate whether groundwater is an existing or planned source of water available to the supplier.	System Supplies	Section 6.2	4.1 4.2

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10631(b)(1)	Indicate whether a groundwater management plan has been adopted by the water supplier or if there is any other specific authorization for groundwater management. Include a copy of the plan or authorization.	System Supplies	Section 6.2.2	4.2
10631(b)(2)	Describe the groundwater basin.	System Supplies	Section 6.2.1	4.2
10631(b)(2)	Indicate if the basin has been adjudicated and include a copy of the court order or decree and a description of the amount of water the supplier has the legal right to pump.	System Supplies	Section 6.2.2	4.2
10631(b)(2)	For unadjudicated basins, indicate whether or not the department has identified the basin as overdrafted, or projected to become overdrafted. Describe efforts by the supplier to eliminate the long-term overdraft condition.	System Supplies	Section 6.2.3	4.2
10631(b)(3)	Provide a detailed description and analysis of the location, amount, and sufficiency of groundwater pumped by the urban water supplier for the past five years	System Supplies	Section 6.2.4	4.2
10631(b)(4)	Provide a detailed description and analysis of the amount and location of groundwater that is projected to be pumped.	System Supplies	Sections 6.2 and 6.9	4.2
10631(c)(1)	Describe the reliability of the water supply and vulnerability to seasonal or climatic shortage.	Water Supply Reliability Assessment	Section 7.1	5.1 5.2
10631(c)(1)	Provide data for an average water year, a single dry water year, and multiple dry water years	Water Supply Reliability Assessment	Section 7.2	5.1
10631(c)(2)	For any water source that may not be available at a consistent level of use, describe plans to supplement or replace that source.	Water Supply Reliability Assessment	Section 7.1	4.2.5 4.2.6
10631(d)	Describe the opportunities for exchanges or transfers of water on a short-term or long-term basis.	System Supplies	Section 6.7	4.3
10631(e)(1)	Quantify past, current, and projected water use, identifying the uses among water use sectors.	System Water Use	Section 4.2	3.1 3.2 3.3

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10631(e)(3)(A)	Report the distribution system water loss for the most recent 12-month period available.	System Water Use	Section 4.3	6.2.5 App J
10631(f)(1)	Retail suppliers shall provide a description of the nature and extent of each demand management measure implemented over the past five years. The description will address specific measures listed in code.	Demand Management Measures	Sections 9.2 and 9.3	6.2
10631(f)(2)	Wholesale suppliers shall describe specific demand management measures listed in code, their distribution system asset management program, and supplier assistance program.	Demand Management Measures	Sections 9.1 and 9.3	N/A
10631(g)	Describe the expected future water supply projects and programs that may be undertaken by the water supplier to address water supply reliability in average, single-dry, and multiple-dry years.	System Supplies	Section 6.8	4.4
10631(h)	Describe desalinated water project opportunities for long-term supply.	System Supplies	Section 6.6	4.6
10631(i)	CUWCC members may submit their 2013-2014 CUWCC BMP annual reports in lieu of, or in addition to, describing the DMM implementation in their UWMPs. This option is only allowable if the supplier has been found to be in full compliance with the CUWCC MOU.	Demand Management Measures	Section 9.5	N/A
10631(j)	Retail suppliers will include documentation that they have provided their wholesale supplier(s) – if any - with water use projections from that source.	System Supplies	Section 2.5.1	N/A
10631(j)	Wholesale suppliers will include documentation that they have provided their urban water suppliers with identification and quantification of the existing and planned sources of water available from the wholesale to the urban supplier during various water year types.	System Supplies	Section 2.5.1	N/A
10631.1(a)	Include projected water use needed for lower income housing projected in the service area of the supplier.	System Water Use	Section 4.5	3.3.1

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10632(a) and 10632(a)(1)	Provide an urban water shortage contingency analysis that specifies stages of action and an outline of specific water supply conditions at each stage.	Water Shortage Contingency Planning	Section 8.1	5.5 App F
10632(a)(2)	Provide an estimate of the minimum water supply available during each of the next three water years based on the driest three-year historic sequence for the agency.	Water Shortage Contingency Planning	Section 8.9	5.7
10632(a)(3)	Identify actions to be undertaken by the urban water supplier in case of a catastrophic interruption of water supplies.	Water Shortage Contingency Planning	Section 8.8	5.5.1 App F
10632(a)(4)	Identify mandatory prohibitions against specific water use practices during water shortages.	Water Shortage Contingency Planning	Section 8.2	5.5 App F
10632(a)(5)	Specify consumption reduction methods in the most restrictive stages.	Water Shortage Contingency Planning	Section 8.4	5.5 App F
10632(a)(6)	Indicated penalties or charges for excessive use, where applicable.	Water Shortage Contingency Planning	Section 8.3	5.5.3 App F
10632(a)(7)	Provide an analysis of the impacts of each of the actions and conditions in the water shortage contingency analysis on the revenues and expenditures of the urban water supplier, and proposed measures to overcome those impacts.	Water Shortage Contingency Planning	Section 8.6	5.5.4 App F
10632(a)(8)	Provide a draft water shortage contingency resolution or ordinance.	Water Shortage Contingency Planning	Section 8.7	App F
10632(a)(9)	Indicate a mechanism for determining actual reductions in water use pursuant to the water shortage contingency analysis.	Water Shortage Contingency Planning	Section 8.5	App F
10633	For wastewater and recycled water, coordinate with local water, wastewater, groundwater, and planning agencies that operate within the supplier's service area.	System Supplies (Recycled Water)	Section 6.5.1	4.6
10633(a)	Describe the wastewater collection and treatment systems in the supplier's service area. Include quantification of the amount of wastewater collected and treated and the methods of wastewater disposal.	System Supplies (Recycled Water)	Section 6.5.2	4.6

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10633(b)	Describe the quantity of treated wastewater that meets recycled water standards, is being discharged, and is otherwise available for use in a recycled water project.	System Supplies (Recycled Water)	Section 6.5.2.2	4.6
10633(c)	Describe the recycled water currently being used in the supplier's service area.	System Supplies (Recycled Water)	Section 6.5.3 and 6.5.4	N/A
10633(d)	Describe and quantify the potential uses of recycled water and provide a determination of the technical and economic feasibility of those uses.	System Supplies (Recycled Water)	Section 6.5.4	4.6
10633(e)	Describe the projected use of recycled water within the supplier's service area at the end of 5, 10, 15, and 20 years, and a description of the actual use of recycled water in comparison to uses previously projected.	System Supplies (Recycled Water)	Section 6.5.4	4.6 4.4
10633(f)	Describe the actions which may be taken to encourage the use of recycled water and the projected results of these actions in terms of acre-feet of recycled water used per year.	System Supplies (Recycled Water)	Section 6.5.5	4.5.2
10633(g)	Provide a plan for optimizing the use of recycled water in the supplier's service area.	System Supplies (Recycled Water)	Section 6.5.5	4.5.2
10634	Provide information on the quality of existing sources of water available to the supplier and the manner in which water quality affects water management strategies and supply reliability	Water Supply Reliability Assessment	Section 7.1	4.2.4 4.2.5 5.2
10635(a)	Assess the water supply reliability during normal, dry, and multiple dry water years by comparing the total water supply sources available to the water supplier with the total projected water use over the next 20 years.	Water Supply Reliability Assessment	Section 7.3	5.1
10635(b)	Provide supporting documentation that Water Shortage Contingency Plan has been, or will be, provided to any city or county within which it provides water, no later than 60 days after the submission of the plan to DWR.	Plan Adoption, Submittal, and Implementation	Section 10.4.4	App F

CWC Section	UWMP Requirement	Subject	Guidebook Location	UWMP Location
10642	Provide supporting documentation that the water supplier has encouraged active involvement of diverse social, cultural, and economic elements of the population within the service area prior to and during the preparation of the plan.	Plan Preparation	Section 2.5.2	App D
10642	Provide supporting documentation that the urban water supplier made the plan available for public inspection, published notice of the public hearing, and held a public hearing about the plan.	Plan Adoption, Submittal, and Implementation	Sections 10.2.2, 10.3, and 10.5	App D
10642	The water supplier is to provide the time and place of the hearing to any city or county within which the supplier provides water.	Plan Adoption, Submittal, and Implementation	Sections 10.2.1	App D
10642	Provide supporting documentation that the plan has been adopted as prepared or modified.	Plan Adoption, Submittal, and Implementation	Section 10.3.1	App A
10644(a)	Provide supporting documentation that the urban water supplier has submitted this UWMP to the California State Library.	Plan Adoption, Submittal, and Implementation	Section 10.4.3	Transmittal Letter
10644(a)(1)	Provide supporting documentation that the urban water supplier has submitted this UWMP to any city or county within which the supplier provides water no later than 30 days after adoption.	Plan Adoption, Submittal, and Implementation	Section 10.4.4	Transmittal Letter
10644(a)(2)	The plan, or amendments to the plan, submitted to the department shall be submitted electronically.	Plan Adoption, Submittal, and Implementation	Sections 10.4.1 and 10.4.2	Transmittal Letter
10645	Provide supporting documentation that, not later than 30 days after filing a copy of its plan with the department, the supplier has or will make the plan available for public review during normal business hours.	Plan Adoption, Submittal, and Implementation	Section 10.5	Transmittal Letter

Appendix H: Standardized Data Tables and SB X7-7 Verification Form

The following tables are provided, as required by the Department of Water Resources 2015 UWMP Guidebook for Urban Water Suppliers. Only the tables applicable to MCWD are included, as listed below.

DWR Reporting Tables: 2-1, 2-2, 2-3, 2-4, 3-1, 4-1, 4-2, 4-3, 4-4, 4-5, 5-1, 5-2, 6-1, 6-2, 6-3, 6-4, 6-5, 6-6, 6-7, 7-1, 7-2, 7-3, 7-4, 8-1, 8-2, 8-3, 8-4, 10-1

SB X7-7 Verification Tables: 0, 1, 2, 3, 4, 4-A, 5, 6, 7, 7-E, 7-F, 8, 9

Table 2-1 Retail Only: Public Water Systems			
Public Water System Number	Public Water System Name	Number of Municipal Connections 2015	Volume of Water Supplied 2015
CA2710017	Marina Coast Water District	7,500	3228.04
TOTAL		7500	3,228
NOTES:			

Table 2-2: Plan Identification (Select One)	
<input checked="" type="checkbox"/>	Individual UWMP
<input type="checkbox"/>	Regional UWMP (RUWMP) <i>(checking this triggers the next line to appear)</i>
Select One:	
<input type="checkbox"/>	RUWMP includes a Regional Alliance
<input type="checkbox"/>	RUWMP does not include a Regional Alliance
NOTES:	

Table 2-3: Agency Identification	
Type of Agency (select one or both)	
<input type="checkbox"/>	Agency is a wholesaler
<input checked="" type="checkbox"/>	Agency is a retailer
Fiscal or Calendar Year (select one)	
<input checked="" type="checkbox"/>	UWMP Tables Are in Calendar Years
<input type="checkbox"/>	UWMP Tables Are in Fiscal Years
If Using Fiscal Years Provide Month and Day that the Fiscal Year Begins (dd/mm)	
<i>dd/mm</i>	
Units of Measure Used in UWMP (select from Drop down)	
Unit	AF
NOTES:	

Table 2-4 Retail: Water Supplier Information Exchange

The retail supplier has informed the following wholesale supplier(s) of projected water use in accordance with CWC 10631.

Wholesale Water Supplier Name *(Add additional rows as needed)*

Not Applicable

NOTES:

Table 3-1 Retail: Population - Current and Projected						
Population Served	2015	2020	2025	2030	2035	2040(<i>opt</i>)
	32,375	40,464	56,648	64,635	70,161	
NOTES:						

Table 4-1 Retail: Demands for Potable and Raw Water - Actual			
Use Type <i>(Add additional rows as needed)</i>	2015 Actual		
<i>Use Drop down list</i> <i>May select each use multiple times</i> <i>These are the only Use Types that will be</i> <i>recognized by the WUEdata online submittal</i> <i>tool</i>	Additional Description <i>(as needed)</i>	Level of Treatment When Delivered <i>Drop down list</i>	Volume
Single Family	metered	Drinking Water	968
Multi-Family	flat rate	Drinking Water	206
Multi-Family	metered	Drinking Water	905
Commercial	metered	Drinking Water	327
Industrial	metered	Drinking Water	0
Institutional/Governmental	metered	Drinking Water	156
Landscape	metered	Drinking Water	632
Losses		Drinking Water	34
		TOTAL	3,228
NOTES:			

Table 4-2 Retail: Demands for Potable and Raw Water - Projected						
Use Type <i>(Add additional rows as needed)</i>	Additional Description <i>(as needed)</i>	Projected Water Use <i>Report To the Extent that Records are Available</i>				
<u>Use Drop down list</u> <i>May select each use multiple times</i> <i>These are the only Use Types that will be recognized by the WUEdata online submittal tool</i>		2020	2025	2030	2035	2040-opt
Single Family		1,717	2,728	3,128	3,432	
Multi-Family		1,658	2,351	2,734	2,971	
Commercial		1,220	2,339	2,616	2,645	
Industrial		24	214	250	750	
Institutional/Governmental		276	501	503	508	
Landscape	Municipal/Domestic	275	257	61	64	
Losses		435	467	467	467	
TOTAL		5604.844	8856.874	9759.495	10837.98	0
NOTES:						

Table 4-3 Retail: Total Water Demands						
	2015	2020	2025	2030	2035	2040 <i>(opt)</i>
Potable and Raw Water <i>From</i> <i>Tables 4-1 and 4-2</i>	3,228	5,605	8,857	9,759	10,838	0
Recycled Water Demand <i>From</i> <i>Table 6-4</i>	0	600	1,080	1,359	1,359	0
TOTAL WATER DEMAND	3,228	6,205	9,936	11,118	12,197	0
NOTES:						

Table 4-4 Retail: 12 Month Water Loss Audit Reporting	
Reporting Period Start Date (mm/yyyy)	Volume of Water Loss
07/2014	86.1

NOTES: Report based on FY14/15

Table 4-5 Retail Only: Inclusion in Water Use Projections	
<p style="text-align: center;">Are Future Water Savings Included in Projections? (Refer to Appendix K of UWMP Guidebook) <i>Drop down list (y/n)</i></p>	No
<p>If "Yes" to above, state the section or page number, in the cell to the right, where citations of the codes, ordinances, etc... utilized in demand projections are found.</p>	
<p style="text-align: center;">Are Lower Income Residential Demands Included In Projections? <i>Drop down list (y/n)</i></p>	Yes
<p>NOTES: Projections for new developments reflect water-conserving fixtures, but no reduction are made for</p>	

Table 5-1 Baselines and Targets Summary					
<i>Retail Agency or Regional Alliance Only</i>					
Baseline Period	Start Year	End Year	Average Baseline GPCD*	2015 Interim Target *	Confirmed 2020 Target*
10-15 year	1999	2008	135.25	126.13	117
5 Year	2004	2008	130.64		
*All values are in Gallons per Capita per Day (GPCD)					
NOTES:					

Appendix H-1, DWR Standard Tables

Table 5-2: 2015 Compliance									
Retail Agency or Regional Alliance Only*									
Actual 2015 GPCD	2015 Interim Target GPCD	Optional Adjustments to 2015 GPCD "0" for adjustments not used <i>Methodology 8</i>					Enter From	2015 GPCD (Adjusted if applicable)	Did Supplier Achieve Targeted Reduction for 2015? Y/N
		Extraordinary Events	Economic Adjustment	Weather Normalization	TOTAL Adjustments	Adjusted 2015 GPCD			
89.01	126.13	0	0	0	0	89.01	89.01	Yes	
*All values are in Gallons per Capita per Day (GPCD)									
NOTES:									

Update with population check.

Appendix H-1, DWR Standard Tables

Table 6-1 Retail: Groundwater Volume Pumped						
<input type="checkbox"/>	Supplier does not pump groundwater. The supplier will not complete the table below.					
Groundwater Type <i>Drop Down List</i> <i>May use each category multiple times</i>	Location or Basin Name	2011	2012	2013	2014	2015
<i>Add additional rows as needed</i>						
Alluvial Basin	Salinas Valley Groundwater Basin, Seaside Subbasin	4046.6	4173.6	4413.3	4025.9	3228.04
TOTAL		4,047	4,174	4,413	4,026	3,228
NOTES:						

Appendix H-1, DWR Standard Tables

Table 6-2 Retail: Wastewater Collected Within Service Area in 2015						
<input type="checkbox"/>	There is no wastewater collection system. The supplier will not complete the table below.					
100	Percentage of 2015 service area covered by wastewater collection system <i>(optional)</i>					
100	Percentage of 2015 service area population covered by wastewater collection system <i>(optional)</i>					
Wastewater Collection			Recipient of Collected Wastewater			
Name of Wastewater Collection Agency	Wastewater Volume Metered or Estimated? <i>Drop Down List</i>	Volume of Wastewater Collected in 2015	Name of Wastewater Treatment Agency Receiving Collected Wastewater	Treatment Plant Name	Is WWTP Located Within UWMP Area? <i>Drop Down List</i>	Is WWTP Operation Contracted to a Third Party? <i>(optional)</i> <i>Drop Down List</i>
<i>Add additional rows as needed</i>						
MCWD - Marina PS	Metered	1,226	MRWPCA	MRWPCA RTP	No	No
MCWD - Ord Flume	Metered	887	MRWPCA	MRWPCA RTP	No	No
MCWD - Marina Airport	Estimated	2.2	MRWPCA	MRWPCA RTP	No	No
Total Wastewater Collected from Service Area in 2015:		2,115				

NOTES: The Monterey Regional Water Pollution Control Agency (MRWPCA) provides regional wastewater treatment.

Appendix H-1, DWR Standard Tables

Table 6-3 Retail: Wastewater Treatment and Discharge Within Service Area in 2015										
<input type="checkbox"/> No wastewater is treated or disposed of within the UWMP service area. The supplier will not complete the table below.										
Wastewater Treatment Plant Name	Discharge Location Name or Identifier	Discharge Location Description	Wastewater Discharge ID Number (optional)	Method of Disposal <i>Drop down list</i>	Does This Plant Treat Wastewater Generated Outside the Service Area?	Treatment Level <i>Drop down list</i>	2015 volumes			
							Wastewater Treated	Discharged Treated Wastewater	Recycled Within Service Area	Recycled Outside of Service Area
<i>Add additional rows as needed</i>										
MRWPCA	Ocean Outfall	Monterey Bay	Permit CA00485	Ocean outfall	Yes	Secondary, Disinfected - 2.2	19,712	5,462	0	14,250
Total							19,712	5,462	0	14,250

NOTES: WW from MCWD is treated at the MRWPCA Regional treatment Plant. The majority is recycled and delivered to the Castroville Seawater Intrusion project for

Appendix H-1, DWR Standard Tables

Table 6-4 Retail: Current and Projected Recycled Water Direct Beneficial Uses Within Service Area									
<input type="checkbox"/> Recycled water is not used and is not planned for use within the service area of the supplier. The supplier will not complete the table below.									
Name of Agency Producing (Treating) the Recycled Water:			Monterey Regional Water Pollution Control Agency						
Name of Agency Operating the Recycled Water Distribution System:									
Supplemental Water Added in 2015									
Source of 2015 Supplemental Water									
Beneficial Use Type	General Description of 2015 Uses	Level of Treatment	2015	2020	2025	2030	2035	2040 (opt)	
<i>These are the only Use Types that will be recognized by the DWR online submittal tool</i> <i>Drop down list</i>									
Agricultural irrigation									
Landscape irrigation (excludes golf courses)	Planned for future	Tertiary	0	200	480	759	759		
Golf course irrigation	Planned for future	Tertiary	0	400	600	600	600		
Commercial use									
Industrial use									
Geothermal and other energy production									
Seawater intrusion barrier									
Recreational impoundment									
Wetlands or wildlife habitat									
Groundwater recharge (IPR)									
Surface water augmentation (IPR)									
Direct potable reuse									
Other	Type of Use								
Total:			0	600	1,080	1,359	1,359	0	
<i>IPR - Indirect Potable Reuse</i>									
NOTES:									

Appendix H-1, DWR Standard Tables

Table 6-5 Retail: 2010 UWMP Recycled Water Use Projection Compared to 2015 Actual		
□	Recycled water was not used in 2010 nor projected for use in 2015. The supplier will not complete the table below.	
Use Type <i>These are the only Use Types that will be recognized by the WUEdata online submittal tool</i>	2010 Projection for 2015	2015 actual use
Agricultural irrigation	0	0
Landscape irrigation (excludes golf courses)	319	0
Golf course irrigation	461	0
Commercial use	0	0
Industrial use	0	0
Geothermal and other energy production	0	0
Seawater intrusion barrier	0	0
Recreational impoundment	0	0
Wetlands or wildlife habitat	0	0
Groundwater recharge (IPR)	0	0
Surface water augmentation (IPR)	0	0
Direct potable reuse	0	0
Other	Required for this use	
Total	780	0
NOTES: Construction of recycled water delivery system delayed due to economic downturn.		

Table 6-6 Retail: Methods to Expand Future Recycled Water Use			
□	Supplier does not plan to expand recycled water use in the future. Supplier will not complete the table below but will provide narrative explanation.		
	Provide page location of narrative in UWMP		
Name of Action	Description	Planned Implementation Year	Expected Increase in Recycled Water Use
<i>Add additional rows as needed</i>			
RUWAP (Recycled)	Build distribution system	2018	600
Total			600
NOTES:			

Appendix H-1, DWR Standard Tables

Table 6-7 Retail: Expected Future Water Supply Projects or Programs						
<input type="checkbox"/>	No expected future water supply projects or programs that provide a quantifiable increase to the agency's water supply. Supplier will not complete the table below.					
<input type="checkbox"/>	Some or all of the supplier's future water supply projects or programs are not compatible with this table and are described in a narrative format.					
	Provide page location of narrative in the UWMP					
Name of Future Projects or Programs	Joint Project with other agencies?		Description (if needed)	Planned Implementation Year	Planned for Use in Year Type <i>Drop Down List</i> <i>User may select more than one.</i>	Expected Increase in Water Supply to Agency <i>This may be a range</i>
	<i>Drop Down List (y/n)</i>	<i>If Yes, Agency Name</i>				
<i>Add additional rows as needed</i>						
RUWAP (Potable)	No		Seawater Desal	2025	Average Year	500 to 1800
NOTES: planned seawater desalination facility will be needed by 2025.						

Table 6-8 Retail: Water Supplies — Actual				
Water Supply	Additional Detail on Water Supply	2015		
<i>Drop down list</i> <i>May use each category multiple times.</i> <i>These are the only water supply categories that will be recognized by the WUEdata online submittal tool</i>		Actual Volume	Water Quality <i>Drop Down List</i>	Total Right or Safe Yield <i>(optional)</i>
<i>Add additional rows as needed</i>				
Groundwater	Marina Wells	1,420	Drinking Water	3,020
Groundwater	Ord Wells	1,808	Drinking Water	6,600
Total		3,228		9,620
NOTES:				

Appendix H-1, DWR Standard Tables

Table 6-9 Retail: Water Supplies — Projected											
Water Supply	Additional Detail on Water Supply	Projected Water Supply <i>Report To the Extent Practicable</i>									
<i>Drop down list</i> <i>May use each category multiple times.</i> <i>These are the only water supply categories that will be recognized by the WUdata online submittal tool</i>		2020		2025		2030		2035		2040 (opt)	
		Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)	Reasonably Available Volume	Total Right or Safe Yield (optional)
<i>Add additional rows as needed</i>											
Groundwater	Marina Wells	3,020	3,020	3,020	3,020	3,020	3,020	3,020	3,020	3,020	3,020
Groundwater	Ord Wells	6,600	6,600	6,600	6,600	6,600	6,600	6,600	6,600	6,600	6,600
Groundwater	Armstrong Ranch	680	920	680	920	680	920	680	920	680	920
Groundwater	Cemex	500	500	500	500	500	500	500	500	500	500
Recycled Water		600		1,080		1,359		1,359		1,359	
Desalinated Water		0		491		1,335		1,766		1,800	
	Total	11,400	11,040	12,371	11,040	13,494	11,040	13,925	11,040	13,959	11,040

NOTES: Groundwater from the Salinas Valley Groundwater Basin, 180/400 ft Subarea.

Table 7-1 Retail: Basis of Water Year Data			
Year Type	Base Year	Available Supplies if Year Type Repeats	
		Agency may provide volume only, percent only, or both	
		Volume Available	% of Average Supply
Average Year	2035	13,959	100%
Single-Dry Year	2035	13,959	100%
Multiple-Dry Years 1st Year	2035	13,959	100%
Multiple-Dry Years 2nd Year	2035	13,959	100%
Multiple-Dry Years 3rd Year	2035	13,959	100%
Multiple-Dry Years 4th Year <i>Optional</i>			
Multiple-Dry Years 5th Year <i>Optional</i>			
Multiple-Dry Years 6th Year <i>Optional</i>			
<p><i>Agency may use multiple versions of Table 7-1 if different water sources have different base years and the supplier chooses to report the base years for each water source separately. If an agency uses multiple versions of Table 7-1, in the "Note" section of each table, state that multiple versions of Table 7-1 are being used and identify the particular water source that is being reported in each table.</i></p>			
NOTES:			

Table 7-2 Retail: Normal Year Supply and Demand Comparison					
	2020	2025	2030	2035	2040 <i>(Opt)</i>
Supply totals <i>(autofill from Table 6-9)</i>	11,400	12,371	13,494	13,925	13,959
Demand totals <i>(autofill from Table 4-3)</i>	6,205	9,936	11,118	12,197	0
Difference	5,195	2,435	2,376	1,728	13,959
NOTES:					

Table 7-3 Retail: Single Dry Year Supply and Demand Comparison					
	2020	2025	2030	2035	2040 (Opt)
Supply totals	10,220	11,871	12,994	13,925	
Demand totals	6,267	10,036	11,230	12,319	
Difference	3,953	1,835	1,764	1,606	0
NOTES:					

Table 7-4 Retail: Multiple Dry Years Supply and Demand Comparison						
		2020	2025	2030	2035	2040 (Opt)
First year	Supply totals	10,220	11,871	12,994	13,925	13,959
	Demand totals	6,267	10,036	11,230	12,319	
	Difference	3,953	1,835	1,764	1,606	13,959
Second year	Supply totals	10,220	11,871	12,994	13,925	13,959
	Demand totals	5,460	8,744	9,784	10,733	
	Difference	4,760	3,127	3,210	3,192	13,959
Third year	Supply totals	10,220	11,871	12,994	13,925	13,959
	Demand totals	4,654	7,452	8,339	9,148	
	Difference	5,566	4,419	4,655	4,777	13,959
Fourth year <i>(optional)</i>	Supply totals					
	Demand totals					
	Difference	0	0	0	0	0
Fifth year <i>(optional)</i>	Supply totals					
	Demand totals					
	Difference	0	0	0	0	0
Sixth year <i>(optional)</i>	Supply totals					
	Demand totals					
	Difference	0	0	0	0	0
NOTES:						

Table 8-1 Retail Stages of Water Shortage Contingency Plan		
Stage	Complete Both	
	Percent Supply Reduction ¹ <i>Numerical value as a percent</i>	Water Supply Condition <i>(Narrative description)</i>
<i>Add additional rows as needed</i>		
1	10%	Mechanical loss of 10% capacity, or
1	10%	Chlorides increase but WQ standard met, or
1	10%	VOC increase but WQ standards met, or
1	10%	Drought declared by State or County
2	25%	Mechanical loss of 10-25% capacity, or
2	25%	Chlorides increase but WQ standard met, or
2	25%	VOC increase but WQ STD can be met, or
2	25%	Drought declared by State or County
3	35%	Mechanical loss of 25-35% capacity, or
3	35%	Chlorides increase above WQ standard, or
3	35%	VOC increase but WQ STD can be met, or
3	35%	Drought declared by State or County
4	50%	Mechanical loss of 35-50% capacity, or
4	50%	Chlorides increase above WQ standard, or
4	50%	VOC increase but WQ STD can be met, or
4	50%	Drought declared by State or County
5	51%	Mechanical loss of over 50% capacity, or
5	51%	Chlorides increase above WQ standard, or
5	51%	VOC increase but WQ STD can be met, or
5	51%	Drought declared by State or County
¹ <i>One stage in the Water Shortage Contingency Plan must address a water shortage of 50%.</i>		
NOTES: See the full WSCP for detailed descriptions		

Table 8-2 Retail Only: Restrictions and Prohibitions on End Uses			
Stage	Restrictions and Prohibitions on End Users <i>Drop down list</i> <i>These are the only categories that will be accepted by the WUEdata online submittal tool</i>	Additional Explanation or Reference <i>(optional)</i>	Penalty, Charge, or Other Enforcement? <i>Drop Down List</i>
<i>Add additional rows as needed</i>			
0-5	Landscape - Restrict or prohibit runoff from landscape irrigation		Yes
0-5	Landscape - Limit landscape irrigation to specific times		Yes
0-5	Landscape - Prohibit certain types of landscape irrigation		Yes
0-5	CII - Restaurants may only serve water upon request		Yes
0-5	Other - Customers must repair leaks, breaks, and malfunctions in a timely manner		Yes
0-5	Other water feature or swimming pool restriction	Drain and refill for repair only	Yes
0-5	Water Features - Restrict water use for decorative water features, such as fountains	Must be recirculating	Yes
0-5	Other - Prohibit use of potable water for washing hard surfaces		Yes
3-5	Pools and Spas - Require covers for pools and spas		Yes
3-5	Landscape - Limit landscape irrigation to specific days		Yes
3-5	CII - Lodging establishment must offer opt out of linen service		Yes
3-5	Other - Prohibit use of potable water for construction and dust control	Use recycled/non-potable when available	Yes
5	Landscape - Prohibit all landscape irrigation	Only recycled water	Yes
5	Other - Prohibit use of potable water for construction and dust control	Only recycled water	Yes
5	Other - Prohibit vehicle washing except at facilities using recycled or recirculating water		Yes
NOTES: Stage 0 (no shortage) reflects District Code Section 3.36.030, Prohibitions on Water Waste			

Table 8-3 Retail Only: Stages of Water Shortage Contingency Plan - Consumption Reduction Methods		
Stage	Consumption Reduction Methods by Water Supplier <i>Drop down list</i> <i>These are the only categories that will be accepted by the WUEdata online submittal tool</i>	Additional Explanation or Reference <i>(optional)</i>
<i>Add additional rows as needed</i>		
1-5	Expand Public Information Campaign	
0-5	Offer Water Use Surveys	
0-5	Provide Rebates on Plumbing Fixtures and Devices	
0-5	Provide Rebates for Landscape Irrigation Efficiency	
0-5	Provide Rebates for Turf Replacement	
2-5	Decrease Line Flushing	
3-5	Implement or Modify Drought Rate Structure or Surcharge	
NOTES: See the full WSCP for full descriptions		

Table 8-4 Retail: Minimum Supply Next Three Years			
	2016	2017	2018
Available Water Supply	9,620	9,620	9,620
NOTES:			

Table 10-1 Retail: Notification to Cities and Counties		
City Name	60 Day Notice	Notice of Public Hearing
<i>Add additional rows as needed</i>		
City of Marina	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
City of Seaside	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
City of Del Rey Oaks	X	X
City of Monterey	X	X
CSU Monterey Bay	X	X
UC MBEST	X	X
CA State Parks	X	X
U.S. Army Presidio of Monterey	X	X
Fort Ord Reuse Authority	X	X
MCWRA	X	X
MPWMD	X	X
Cal-Am	X	X
	<input type="checkbox"/>	<input type="checkbox"/>
County Name <i>Drop Down List</i>	60 Day Notice	Notice of Public Hearing
<i>Add additional rows as needed</i>		
Monterey County	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>
NOTES:		

SB X7-7 Table 0: Units of Measure Used in UWMP*

(select one from the drop down list)

Acre Feet

**The unit of measure must be consistent with Table 2-3*

NOTES:

SB X7-7 Table-1: Baseline Period Ranges			
Baseline	Parameter	Value	Units
10- to 15-year baseline period	2008 total water deliveries	4,102	Acre Feet
	2008 total volume of delivered recycled water	0	Acre Feet
	2008 recycled water as a percent of total deliveries	0.00%	Percent
	Number of years in baseline period ¹	10	Years
	Year beginning baseline period range	1999	
	Year ending baseline period range ²	2008	
5-year baseline period	Number of years in baseline period	5	Years
	Year beginning baseline period range	2004	
	Year ending baseline period range ³	2008	
<p>¹ If the 2008 recycled water percent is less than 10 percent, then the first baseline period is a continuous 10-year period. If the amount of recycled water delivered in 2008 is 10 percent or greater, the first baseline period is a continuous 10- to 15-year period.</p>			
<p>² The ending year must be between December 31, 2004 and December 31, 2010.</p>			
<p>³ The ending year must be between December 31, 2007 and December 31, 2010.</p>			
NOTES:			

SB X7-7 Table 2: Method for Population Estimates	
Method Used to Determine Population (may check more than one)	
<input checked="" type="checkbox"/>	1. Department of Finance (DOF) DOF Table E-8 (1990 - 2000) and (2000-2010) and DOF Table E-5 (2011 - 2015) when available
<input checked="" type="checkbox"/>	2. Persons-per-Connection Method
<input type="checkbox"/>	3. DWR Population Tool
<input type="checkbox"/>	4. Other DWR recommends pre-review
NOTES: Service area crosses multiple jurisdictions. All of the City of	

SB X7-7 Table 3: Service Area Population		
Year		Population
10 to 15 Year Baseline Population		
Year 1	1999	28,657
Year 2	2000	29,137
Year 3	2001	29,416
Year 4	2002	29,648
Year 5	2003	29,613
Year 6	2004	29,633
Year 7	2005	29,477
Year 8	2006	29,154
Year 9	2007	29,065
Year 10	2008	29,533
<i>Year 11</i>		
<i>Year 12</i>		
<i>Year 13</i>		
<i>Year 14</i>		
<i>Year 15</i>		
5 Year Baseline Population		
Year 1	2004	29,633
Year 2	2005	29,477
Year 3	2006	29,154
Year 4	2007	29,065
Year 5	2008	29,533
2015 Compliance Year Population		
	2015	32,375
NOTES:		

Appendix H-2, SB X7-7 Verification Tables

SB X7-7 Table 4: Annual Gross Water Use *								
	Baseline Year <i>Fm SB X7-7 Table 3</i>	Volume Into Distribution System <i>Fm SB X7-7 Table(s) 4-A</i>	Deductions					Annual Gross Water Use
			Exported Water	Change in Dist. System Storage (+/-)	Indirect Recycled Water <i>Fm SB X7-7 Table 4-B</i>	Water Delivered for Agricultural Use	Process Water <i>Fm SB X7-7 Table(s) 4-D</i>	
10 to 15 Year Baseline - Gross Water Use								
Year 1	1999	4637	0	0	0	0	0	4,637
Year 2	2000	4671.2	0	0	0	0	0	4,671
Year 3	2001	4513	0	0	0	0	0	4,513
Year 4	2002	4442.8	0	0	0	0	0	4,443
Year 5	2003	4329.7	0	0	0	0	0	4,330
Year 6	2004	4684.6	0	0	0	0	0	4,685
Year 7	2005	4188.1	0	0	0	0	0	4,188
Year 8	2006	4295.3	0	0	0	0	0	4,295
Year 9	2007	4563	0	0	0	0	0	4,563
Year 10	2008	4102.2	0	0	0	0	0	4,102
<i>Year 11</i>	0	0			0		0	0
<i>Year 12</i>	0	0			0		0	0
<i>Year 13</i>	0	0			0		0	0
<i>Year 14</i>	0	0			0		0	0
<i>Year 15</i>	0	0			0		0	0
10 - 15 year baseline average gross water use								2,962
5 Year Baseline - Gross Water Use								
Year 1	2004	4,685	0	0	0	0	0	4,685
Year 2	2005	4,188	0	0	0	0	0	4,188
Year 3	2006	4,295	0	0	0	0	0	4,295
Year 4	2007	4,563	0	0	0	0	0	4,563
Year 5	2008	4,102	0	0	0	0	0	4,102
5 year baseline average gross water use								4,367
2015 Compliance Year - Gross Water Use								
2015		3,228	0	0	0	0	0	3,228
* NOTE that the units of measure must remain consistent throughout the UWMP, as reported in Table 2-3								
NOTES: All water supply from District-owned wells.								

SB X7-7 Table 4-A: Volume Entering the Distribution System(s)

Complete one table for each source.

Name of Source		Salinas Valley Groundwater Basin		
This water source is:				
<input checked="" type="checkbox"/>	The supplier's own water source			
<input type="checkbox"/>	A purchased or imported source			
Baseline Year <i>Fm SB X7-7 Table 3</i>	Volume Entering Distribution System	Meter Error Adjustment* <i>Optional (+/-)</i>	Corrected Volume Entering Distribution System	
10 to 15 Year Baseline - Water into Distribution System				
Year 1	1999	4637		4,637
Year 2	2000	4671.2		4,671
Year 3	2001	4513		4,513
Year 4	2002	4442.8		4,443
Year 5	2003	4329.7		4,330
Year 6	2004	4684.6		4,685
Year 7	2005	4188.1		4,188
Year 8	2006	4295.3		4,295
Year 9	2007	4563		4,563
Year 10	2008	4102.2		4,102
Year 11	0			0
Year 12	0			0
Year 13	0			0
Year 14	0			0
Year 15	0			0
5 Year Baseline - Water into Distribution System				
Year 1	2004	4684.6		4,685
Year 2	2005	4188.1		4,188
Year 3	2006	4295.3		4,295
Year 4	2007	4563		4,563
Year 5	2008	4102.2		4,102
2015 Compliance Year - Water into Distribution System				
2015		3228.04		3,228
* Meter Error Adjustment - See guidance in Methodology 1, Step 3 of Methodologies Document				
NOTES:				

SB X7-7 Table 5: Gallons Per Capita Per Day (GPCD)				
Baseline Year <i>Fm SB X7-7 Table 3</i>		Service Area Population <i>Fm SB X7-7 Table 3</i>	Annual Gross Water Use <i>Fm SB X7-7 Table 4</i>	Daily Per Capita Water Use (GPCD)
10 to 15 Year Baseline GPCD				
Year 1	1999	28,657	4,637	144
Year 2	2000	29,137	4,671	143
Year 3	2001	29,416	4,513	137
Year 4	2002	29,648	4,443	134
Year 5	2003	29,613	4,330	131
Year 6	2004	29,633	4,685	141
Year 7	2005	29,477	4,188	127
Year 8	2006	29,154	4,295	132
Year 9	2007	29,065	4,563	140
Year 10	2008	29,533	4,102	124
<i>Year 11</i>	0	0	0	
<i>Year 12</i>	0	0	0	
<i>Year 13</i>	0	0	0	
<i>Year 14</i>	0	0	0	
<i>Year 15</i>	0	0	0	
10-15 Year Average Baseline GPCD				135
5 Year Baseline GPCD				
Baseline Year <i>Fm SB X7-7 Table 3</i>		Service Area Population <i>Fm SB X7-7 Table 3</i>	Gross Water Use <i>Fm SB X7-7 Table 4</i>	Daily Per Capita Water Use
Year 1	2004	29,633	4,685	141
Year 2	2005	29,477	4,188	127
Year 3	2006	29,154	4,295	132
Year 4	2007	29,065	4,563	140
Year 5	2008	29,533	4,102	124
5 Year Average Baseline GPCD				133
2015 Compliance Year GPCD				
2015		32,375	3,228	89
NOTES:				

SB X7-7 Table 6: Gallons per Capita per Day <i>Summary From Table SB X7-7 Table 5</i>	
10-15 Year Baseline GPCD	135
5 Year Baseline GPCD	133
2015 Compliance Year GPCD	89
NOTES:	

SB X7-7 Table 7: 2020 Target Method		
<i>Select Only One</i>		
Target Method		Supporting Documentation
<input type="checkbox"/>	Method 1	SB X7-7 Table 7A
<input type="checkbox"/>	Method 2	SB X7-7 Tables 7B, 7C, and 7D <i>Contact DWR for these tables</i>
<input checked="" type="checkbox"/>	Method 3	SB X7-7 Table 7-E
<input type="checkbox"/>	Method 4	Method 4 Calculator
NOTES:		

SB X7-7 Table 7-E: Target Method 3				
Agency May Select More Than One as Applicable	Percentage of Service Area in This Hydrological Region	Hydrologic Region	"2020 Plan" Regional Targets	Method 3 Regional Targets (95%)
<input type="checkbox"/>		North Coast	137	130
<input type="checkbox"/>		North Lahontan	173	164
<input type="checkbox"/>		Sacramento River	176	167
<input type="checkbox"/>		San Francisco Bay	131	124
<input type="checkbox"/>		San Joaquin River	174	165
<input checked="" type="checkbox"/>	100%	Central Coast	123	117
<input type="checkbox"/>		Tulare Lake	188	179
<input type="checkbox"/>		South Lahontan	170	162
<input type="checkbox"/>		South Coast	149	142
<input type="checkbox"/>		Colorado River	211	200
Target <i>(If more than one region is selected, this value is calculated.)</i>				117
NOTES:				

SB X7-7 Table 7-F: Confirm Minimum Reduction for 2020 Target			
5 Year Baseline GPCD <i>From SB X7-7 Table 5</i>	Maximum 2020 Target*	Calculated 2020 Target <i>Fm Appropriate Target Table</i>	Confirmed 2020 Target
133	126	117	117
* Maximum 2020 Target is 95% of the 5 Year Baseline GPCD			
NOTES:			

SB X7-7 Table 8: 2015 Interim Target GPCD		
Confirmed 2020 Target <i>Fm SB X7-7 Table 7-F</i>	10-15 year Baseline GPCD <i>Fm SB X7-7 Table 5</i>	2015 Interim Target GPCD
117	135	126
NOTES:		

SB X7-7 Table 9: 2015 Compliance								
Actual 2015 GPCD	2015 Interim Target GPCD	Optional Adjustments <i>(in GPCD)</i>					2015 GPCD <i>(Adjusted if applicable)</i>	Did Supplier Achieve Targeted Reduction for 2015?
		Extraordinary Events	Weather Normalization	Economic Adjustment	TOTAL Adjustments	Adjusted 2015 GPCD		
89	126	NA	NA	NA	0	89.01338654	89.01338654	YES
NOTES:								

This page is intentionally blank.

Appendix I: Voluntary Reporting of Energy Intensity

The MCWD water distribution system has five pressure zones, with eight water storage tanks and six booster pump stations. The District produces all of its water supply from groundwater wells. Treatment consists of chlorination to meet distribution system requirements. Some water is provided directly to customers in the lowest pressure zone, and the rest is boosted into the upper zones for storage and customer use. Power consumption for 2015 is tabulated below. Total water production for the year was 3,228 acre-feet. The portion of that supply boosted into the upper pressure zones was not metered or estimated.

2015 Water System Power Use

Component	kWh
Wells	1,451,161
Booster Pump Stations	1,024,865
SCADA (Controls)	1,397
Desalination	0
Total	2,477,423

MCWD provides wastewater collection within its service area, but not treatment. Wastewater treatment is provided by the Monterey Regional Water Pollution Control Agency at the regional treatment plant. The MCWD wastewater collection system includes 20 pump stations. Power consumption for 2015 is tabulated below. Total wastewater conveyed for the year was 2,115 acre-feet.

2015 Wastewater System Power Use

Component	kWh
Lift Stations	278,600
SCADA	413
Total	279,013

DWR Standard Tables O-1A and O-2 are provided on the following pages.

Urban Water Supplier:

Marina Coast Water District

Water Delivery Product (If delivering more than one type of product use Table O-1C)

Retail Potable Deliveries

Table O-1A: Voluntary Energy Intensity - Water Supply Process Approach										
Enter Start Date for Reporting Period End Date	1/1/2015 12/31/2015		Urban Water Supplier Operational Control							
	Water Management Process						Non-Consequential Hydropower (if applicable)			
	Extract and Divert	Place into Storage	Conveyance	Treatment	Distribution	Total Utility	Hydropower	Net Utility		
Volume of Water Entering Process (AF)	3228	0	0	0	2905.2	2905.2	0	2905.2		
Energy Consumed (kWh)	1451161	0	0	0	1026262	2477423		2477423		
Energy Intensity (kWh/AF)	449.6	0.0	0.0	0.0	353.3	852.8	0.0	852.8		

Quantity of Self-Generated Renewable Energy

None kWh

Data Quality (Estimate, Metered Data, Combination of Estimates and Metered Data)

Combination of Estimates and Metered Data

Data Quality Narrative:

Power use is from PG&E Meters. Well Production from Well Meters. Distribution volume is estimated at 90% of well production.

Narrative:

All water originates as groundwater at District wells. The Extract and Divert power use includes chlorination for distribution.

Urban Water Supplier:

Marina Coast Water District

Table O-2: Voluntary Energy Intensity - Wastewater & Recycled Water				
Enter Start Date for Reporting Period 1/1/2015 End Date 12/31/2015	Urban Water Supplier Operational Control			
	Water Management Process			
	Collection / Conveyance	Treatment	Discharge / Distribution	Total
Volume of Wastewater Entering Process (AF)	2115	0	0	0
Wastewater Energy Consumed (kWh)	279013	0	0	279013
Wastewater Energy Intensity (kWh/AF)	131.9	0.0	0.0	0.0
Volume of Recycled Water Entering Process (AF)	0	0	0	0
Recycled Water Energy Consumed (kWh)	0	0	0	0
Recycled Water Energy Intensity (kWh/AF)	0.0	0.0	0.0	0.0

Quantity of Self-Generated Renewable Energy related to recycled water and wastewater operations

None kWh

Data Quality (Estimate, Metered Data, Combination of Estimates and Metered Data)

Combination of Estimates and Metered Data

Data Quality Narrative:

Power is sum of PG&E meters for lift stations and sewer SCADA. Flow is sum of two metered stations plus Marina Airport estimate.

Narrative:

Wastewater is collected from throughout the system and conveyed to the MRWPCA Regional Interceptor.

Appendix J: Water Loss Audit Tables

A system water audit was prepared using the AWWA Free Water Audit Software v5.0. Because the report audit requires financial data as well as water production and deliveries, this report was prepared for FY 2014-15 (July 1, 2014 – June 30, 2015). Financial data came from the District's Certified Annual Financial Report of FY 2014/15.

Water production during that period totaled 3,642 acre-feet, with 86 acre-feet of water loss (approximately 2%). The low loss rate is due to the District's tracking of unmetered water uses, such as water main flushing, hydrant testing and fire department training.

The Audit output tables are provided on the following pages.

AWWA Free Water Audit Software v5.0

American Water Works Association Copyright © 2014. All Rights Reserved.

This spreadsheet-based water audit tool is designed to help quantify and track water losses associated with water distribution systems and identify areas for improved efficiency and cost recovery. It provides a "top-down" summary water audit format, and is not meant to take the place of a full-scale, comprehensive water audit format.

Auditors are strongly encouraged to refer to the most current edition of AWWA M36 Manual for Water Audits for detailed guidance on the water auditing process and targetting loss reduction levels

The spreadsheet contains several separate worksheets. Sheets can be accessed using the tabs towards the bottom of the screen, or by clicking the buttons below.

Please begin by providing the following information

Name of Contact Person:

Email Address:

Telephone | Ext.:

Name of City / Utility:

City/Town/Municipality:

State / Province:

Country:

Year: Financial Year

Start Date: Enter MM/YYYY numeric format

End Date: Enter MM/YYYY numeric format

Audit Preparation Date:

Volume Reporting Units:

PWSID / Other ID:

The following guidance will help you complete the Audit

All audit data are entered on the [Reporting Worksheet](#)

- Value can be entered by user
- Value calculated based on input data
- These cells contain recommended default values

Use of Option (Radio) Buttons: Pcnt: Value:

Select the default percentage by choosing the option button on the left

To enter a value, choose this button and enter a value in the cell to the right

The following worksheets are available by clicking the buttons below or selecting the tabs along the bottom of the page

<p><u>Instructions</u></p> <p>The current sheet. Enter contact information and basic audit details (year, units etc)</p>	<p><u>Reporting Worksheet</u></p> <p>Enter the required data on this worksheet to calculate the water balance and data grading</p>	<p><u>Comments</u></p> <p>Enter comments to explain how values were calculated or to document data sources</p>	<p><u>Performance Indicators</u></p> <p>Review the performance indicators to evaluate the results of the audit</p>	<p><u>Water Balance</u></p> <p>The values entered in the Reporting Worksheet are used to populate the Water Balance</p>	<p><u>Dashboard</u></p> <p>A graphical summary of the water balance and Non-Revenue Water components</p>
<p><u>Grading Matrix</u></p> <p>Presents the possible grading options for each input component of the audit</p>	<p><u>Service Connection Diagram</u></p> <p>Diagrams depicting possible customer service connection line configurations</p>	<p><u>Definitions</u></p> <p>Use this sheet to understand the terms used in the audit process</p>	<p><u>Loss Control Planning</u></p> <p>Use this sheet to interpret the results of the audit validity score and performance indicators</p>	<p><u>Example Audits</u></p> <p>Reporting Worksheet and Performance Indicators examples are shown for two validated audits</p>	<p><u>Acknowledgements</u></p> <p>Acknowledgements for the AWWA Free Water Audit Software v5.0</p>

If you have questions or comments regarding the software please contact us via email at: wlc@awwa.org



AWWA Free Water Audit Software: Reporting Worksheet

WAS v5.0
American Water Works Association
Copyright © 2014. All Rights Reserved.

? Click to access definition
+ Click to add a comment

Water Audit Report for: Marina Coast Water District (CA2710017)
Reporting Year: **2015** 7/2014 - 6/2015

Please enter data in the white cells below. Where available, metered values should be used; if metered values are unavailable please estimate a value. Indicate your confidence in the accuracy of the input data by grading each component (n/a or 1-10) using the drop-down list to the left of the input cell. Hover the mouse over the cell to obtain a description of the grades

All volumes to be entered as: ACRE-FEET PER YEAR

To select the correct data grading for each input, determine the highest grade where the utility meets or exceeds all criteria for that grade and all grades below it.

----- Enter grading in column 'E' and 'J' ----->

Master Meter and Supply Error Adjustments

WATER SUPPLIED

Volume from own sources:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="8"/>	<input type="text" value="3,641.510"/>	acre-ft/yr
Water imported:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="n/a"/>	<input type="text" value="0.000"/>	acre-ft/yr
Water exported:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="n/a"/>	<input type="text" value="0.000"/>	acre-ft/yr

Pcnt:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="5"/>	<input type="text" value=""/>	acre-ft/yr
Value:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value=""/>	acre-ft/yr
Pcnt:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value=""/>	acre-ft/yr
Value:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value=""/>	acre-ft/yr

WATER SUPPLIED: **3,641.510** acre-ft/yr

Enter negative % or value for under-registration
Enter positive % or value for over-registration

AUTHORIZED CONSUMPTION

Billed metered:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="6"/>	<input type="text" value="3,334.800"/>	acre-ft/yr
Billed unmetered:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="6"/>	<input type="text" value="206.360"/>	acre-ft/yr
Unbilled metered:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="8"/>	<input type="text" value="10.427"/>	acre-ft/yr
Unbilled unmetered:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="6"/>	<input type="text" value="3.776"/>	acre-ft/yr

AUTHORIZED CONSUMPTION: **3,555.363** acre-ft/yr

Click here:
for help using option buttons below

Pcnt:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value="3.776"/>	acre-ft/yr
Value:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value=""/>	acre-ft/yr

Use buttons to select percentage of water supplied
OR
value

WATER LOSSES (Water Supplied - Authorized Consumption)

86.147 acre-ft/yr

Apparent Losses

Unauthorized consumption: acre-ft/yr
Default option selected for unauthorized consumption - a grading of 5 is applied but not displayed

Customer metering inaccuracies:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="7"/>	<input type="text" value="16.810"/>	acre-ft/yr
Systematic data handling errors:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value="8.337"/>	acre-ft/yr

Default option selected for Systematic data handling errors - a grading of 5 is applied but not displayed

Apparent Losses: **34.251** acre-ft/yr

Pcnt:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="0.25%"/>	<input type="text" value=""/>	acre-ft/yr
Value:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value=""/>	acre-ft/yr
Pcnt:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="0.50%"/>	<input type="text" value=""/>	acre-ft/yr
Value:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="0.25%"/>	<input type="text" value=""/>	acre-ft/yr

Real Losses (Current Annual Real Losses or CARL)

Real Losses = Water Losses - Apparent Losses: **51.896** acre-ft/yr

WATER LOSSES: **86.147** acre-ft/yr

NON-REVENUE WATER

NON-REVENUE WATER: **100.350** acre-ft/yr

= Water Losses + Unbilled Metered + Unbilled Unmetered

SYSTEM DATA

Length of mains:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="6"/>	<input type="text" value="147.0"/>	miles
Number of active AND inactive service connections:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="7"/>	<input type="text" value="8,534"/>	
Service connection density:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value=""/>	<input type="text" value="58"/>	conn./mile main

Are customer meters typically located at the curbside or property line?

Average length of customer service line:

Average length of customer service line has been set to zero and a data grading score of 10 has been applied

Average operating pressure: psi

COST DATA

Total annual cost of operating water system:	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="10"/>	<input type="text" value="\$8,700,333"/>	\$/Year
Customer retail unit cost (applied to Apparent Losses):	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="8"/>	<input type="text" value="\$6.15"/>	\$/100 cubic feet (ccf)
Variable production cost (applied to Real Losses):	<input type="button" value="+"/>	<input type="button" value="?"/>	<input type="text" value="5"/>	<input type="text" value="\$1,300.00"/>	\$/acre-ft <input type="checkbox"/> Use Customer Retail Unit Cost to value real losses

WATER AUDIT DATA VALIDITY SCORE:

***** YOUR SCORE IS: 72 out of 100 *****

A weighted scale for the components of consumption and water loss is included in the calculation of the Water Audit Data Validity Score

PRIORITY AREAS FOR ATTENTION:

Based on the information provided, audit accuracy can be improved by addressing the following components:

- 1: Volume from own sources
- 2: Billed metered
- 3: Variable production cost (applied to Real Losses)



AWWA Free Water Audit Software: System Attributes and Performance Indicators

WAS v5.0

American Water Works Association.
Copyright © 2014, All Rights Reserved.

Water Audit Report for: Marina Coast Water District (CA2710017)
 Reporting Year: 2015 7/2014 - 6/2015

*** YOUR WATER AUDIT DATA VALIDITY SCORE IS: 72 out of 100 ***

System Attributes:

	Apparent Losses:	34.251	acre-ft/yr
+	Real Losses:	51.896	acre-ft/yr
=	Water Losses:	86.147	acre-ft/yr

? Unavoidable Annual Real Losses (UARL): 139.48 acre-ft/yr

Annual cost of Apparent Losses: \$91,756

Annual cost of Real Losses: \$67,464 Valued at **Variable Production Cost**

Return to Reporting Worksheet to change this assumption

Performance Indicators:

Financial:	{	Non-revenue water as percent by volume of Water Supplied:	2.8%	
		Non-revenue water as percent by cost of operating system:	2.0%	Real Losses valued at Variable Production Cost

Operational Efficiency:	{	Apparent Losses per service connection per day:	3.58	gallons/connection/day
		Real Losses per service connection per day:	5.43	gallons/connection/day
		Real Losses per length of main per day*:	N/A	
		Real Losses per service connection per day per psi pressure:	0.09	gallons/connection/day/psi

From Above, Real Losses = Current Annual Real Losses (CARL): 51.90 acre-feet/year

? Infrastructure Leakage Index (ILI) [CARL/UARL]: 0.37

* This performance indicator applies for systems with a low service connection density of less than 32 service connections/mile of pipeline



AWWA Free Water Audit Software: User Comments

WAS v5.0

American Water Works Association.
Copyright © 2014. All Rights Reserved.

Use this worksheet to add comments or notes to explain how an input value was calculated, or to document the sources of the information used.

General Comment:	
Audit Item	Comment
Volume from own sources:	All wells are metered. Readings are taken monthly.
Vol. from own sources: Master meter error adjustment:	
Water imported:	No water imported.
Water imported: master meter error adjustment:	
Water exported:	No water exported during this period.
Water exported: master meter error adjustment:	
Billed metered:	Total water sales of 3,578 AF during FY 14-15 (CAFR Schedule 7). Value is 3578 minus estimate of flat rate account use.
Billed unmetered:	District has 737 unmetered residential accounts in the Ord Community out of 3414 total accounts in the Ord Community. Use assumes 0.33 AF/DU. All Central Marina accounts are metered.
Unbilled metered:	The District meters internal water use at the wastewater lift stations (wash down water) and at the corporation yard (office and truck filling station).

Audit Item	Comment
Unbilled unmetered:	The District records hydrant run times for line flushing, fire pressure testing and fire training. Run times are converted to water use estimates and recorded in the work order database. The total estimate for 2015 was entered in this field.
Unauthorized consumption:	Default value used.
Customer metering inaccuracies:	Meters were upgrades to AMR in 2004-2005. Accuracy assumed to still be +/- 0.5%
Systematic data handling errors:	Default value used.
Length of mains:	Data from CAFR Schedule 13
Number of active AND inactive service connections:	Value is active account total from 2015 CAFR, Schedule 6. Does not include inactive service connections.
Average length of customer service line:	NA
Average operating pressure:	Estimated using the average within the B-Zone (middle of the elevation range)
Total annual cost of operating water system:	Data from 4Q15 financials. Marina Water Ops + Marina Water CIP + Ord Water Ops + Ord Water CIP. \$2,237,560 + \$111,928 + \$4,888,56 + \$1,461,992 = \$8,700,333
Customer retail unit cost (applied to Apparent Losses):	Total water sales revenue / total water sales. \$9,581,388 / 3578 AF = \$2,677.86/AF = \$6.15/hcf
Variable production cost (applied to Real Losses):	Using the average commodity rates, estimated at \$2.99/hcf. Need to update with data from O&M.



AWWA Free Water Audit Software: Water Balance

WAS v5.0

American Water Works Association.

Water Audit Report for:	Marina Coast Water District (CA2710017)	
Reporting Year:	2015	7/2014 - 6/2015
Data Validity Score:	72	

		Water Exported <i>0.000</i>	Billed Water Exported			Revenue Water 0.000
Own Sources (Adjusted for known errors) 3,641.510	System Input 3,641.510	Water Supplied 3,641.510	Authorized Consumption 3,555.363	Billed Authorized Consumption 3,541.160	Billed Metered Consumption (water exported is removed) 3,334.800	Revenue Water 3,541.160
				Unbilled Authorized Consumption 14.203	Billed Unmetered Consumption 206.360	Non-Revenue Water (NRW) 100.350
Water Losses 86.147	Apparent Losses 34.251	Unbilled Metered Consumption 10.427				
	Real Losses 51.896	Unbilled Unmetered Consumption 3.776				
		Unauthorized Consumption 9.104				
Water Imported 0.000			Customer Metering Inaccuracies 16.810			
				Systematic Data Handling Errors 8.337		
				Leakage on Transmission and/or Distribution Mains Not broken down		
				Leakage and Overflows at Utility's Storage Tanks Not broken down		
				Leakage on Service Connections Not broken down		

Appendix K: Comments Received on the Draft Plan

One verbal comment was submitted at the Public Hearing for the UWMP.

1. Mr. Michael Owen, Marina resident, inquired if the proposed budget would result in increased water rates or increased property taxes.

Response: The UWMP does not include a proposed budget. Mr. Owen meant to comment on a later item on the meeting agenda.

Two comment letters were received:

1. E-mailed comment from Mr. Steve Matarazzo, UC MBEST
2. Letter from Mike Lerch, CSUMB

The letters are on the following pages. Responses follow each letter.

Andy Sterbenz

From: Steve Matarazzo <smataraz@ucsc.edu>
Sent: Thursday, June 02, 2016 2:45 PM
To: Andy Sterbenz
Cc: mwegley@mcwd.org
Subject: Review of Draft Urban Water Management Plan (UWMP)

Follow Up Flag: Follow up
Flag Status: Flagged

Andy: Please include the following footnote (as footnote 3) under Table 3.5, page 21, Water Demand by Jurisdiction: "The UC MBEST water demand estimates over time may occur sooner than anticipated based on a very active real estate market. Therefore, the 2020 water demand estimate of 94 acre feet/year may be a conservative figure. If the real estate market is thriving during the next 5 years, all of UCSC's current water allocation of 230 acre-feet per year could be used within that time frame."

Thanks. - Steve Matarazzo, UC MBEST Planning Director (Graham Bice has retired.)



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

HOWARD GUSTAFSON
President

THOMAS P. MOORE
Vice President

WILLIAM Y. LEE
JAN SHRINER

June 8, 2016

Mr. Steve Matarazzo
Planning Director
Monterey Bay Education, Science and Technology Center
3180 Imjin Road, Suite 104
Marina, CA 93933

Dear Steve:

Thank you for your comments on the Draft 2015 Urban Water Management Plan. We have incorporated your requested footnote into Table 3.5 on page 21, and also Table C-1 in Appendix C.

We will provide you a copy of the final plan under separate cover.

Sincerely,

Michael Wegley, PE
District Engineer



CALIFORNIA STATE UNIVERSITY
Monterey Bay
FACILITIES SERVICES AND OPERATIONS

100 CAMPUS CENTER, BUILDING 84D
SEASIDE, CA 93955-8001
831-582-3700
WWW.CSUMB.EDU

RECEIVED
JUN 03 2016

Marina Coast Water District
ATTN: Mike Wegley
11 Reservation Road
Marina, CA 93933

June 3rd, 2016

BY:

Re: Comments on 2015 Draft Urban Water Management Plan

Dear Mr. Wegley,

Thank you for the opportunity to comment on the 2015 Draft Urban Water Management Plan. The following are California State University Monterey Bay's (CSUMB) comments relative to this document:

Page 5: Suggest that the document list all ex-officio members of FOR A, including CSUMB.

Page 6: Suggest that the document specifically cite the Deeds and Documents transferring the water system from U.S. Army to FOR A and MCWD, noting that these documents specify limits of system ownership, rights of way and specify the rights retained by the USA, the rights granted to FOR A and MCWD and the rights transferred to the current property owners of record. Also note that this Deed requires that the recipient of the water system "ensure that all owners of property at the former Fort will continue to be provided an equitable supply of the water at equitable rates."

Page 18: The unavailability of water usage data at the District that predates the drought which could be used to validate water use estimation factors by occupancy type is unfortunate. Maintaining accurate usage history is important not only for projecting future requirements but for validating capacity charge calculations factors as described in MCWD Codes and Ordinances appendix C.

Page 19: CSUMB appreciates that the District recognizes the work done to develop usage factors pertinent to occupancies specific to higher education in the Ord Community. The University looks forward to incorporating these factors into the estimation of Capacity Charges for future buildings.

Page 21, Table 3.5: It would be informative and relative to show water demand prior to metering of the major un-metered jurisdictions listed on page 20, ie 2010 data, such that the impact of metering on conservation can be clearly seen. CSUMB records indicate its usage was 626 acre feet that year.

Page 21 Table 3.5 Water Demand by Jurisdiction: CSUMB's ability to remain within its allocation is a direct result of its conservation efforts relative to existing programs and new construction. By their very nature the programs hosted by the University will evolve over time resulting in either lesser or greater water demand than forecasted.


Page 25 and appendix E: It is not clear that the population modelling approach accurately incorporates the contribution of students to the count. As an example CSUMB's student population increased by 1,212 students to 4,790 between 2004 and 2010, yet the Ord community growth data only shows a change of 286 people. Undercounting the student contribution to the population would adversely affect the per capita water use and drive more restrictive and expensive conservation measures than would otherwise be required. The CSUMB student population stood at 6,769 as of 2015 and is expected to increase to 12,500 over time, a non-negligible increase in population.

Page 83 Conservation Pricing: The districts tiered rate structure for usage volume treats all customers as if they were single family residential. This approach unfairly pushes industrial and institutional customers into the highest tier, and these customers have no possibility of conserving their way into a lower tier given the nature of their operations. The District needs to study and develop a tier rate structure that takes into account the customer meter size, operations and past conservation efforts.

Page 84: The statement made at the end of the first paragraph that the District is contemplating relatively expensive marginal supplies is not sufficient to meet the proposition 218 requirement that rates be developed on a cost of service basis. These future rates are unknown and may never come about as they are dependent on development that may or may not come about. This statement is particularly specious when certain jurisdictions are projected to be well within their allocations and others are forecasted to be well over their allocations, yet all jurisdictions are in the same rate structure. This is exacerbated when the aforementioned issues with the tiered rate structure taking no account of the nature of the operation behind the meter. Meeting this test is a tremendous concern, both now and in the future.


MCWD Water Shortage Contingency Plans, page 17: The District needs to be mindful of the amount of revenue that is being collected for purposes of system maintenance and expansion and that under ongoing higher level water supply shortages, the expenditures on system expansion become moot and therefore the revenue requirement would also be expected to decrease.

Sincerely,

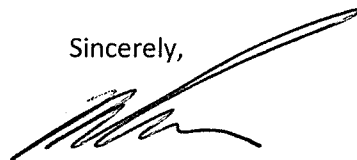A handwritten signature in black ink, appearing to read 'Mike Lerch', with a long, sweeping horizontal stroke extending to the right.

Mike Lerch

Associate Director Facility Services and Operations



MARINA COAST WATER DISTRICT

11 RESERVATION ROAD, MARINA, CA 93933-2099

Home Page: www.mcwd.org

TEL: (831) 384-6131 FAX: (831) 883-5995

DIRECTORS

HOWARD GUSTAFSON
President

THOMAS P. MOORE
Vice President

WILLIAM Y. LEE
JAN SHRINER

June 8, 2016

Mr. Mike Lerch
Associate Director, Facility Services and Operations
California State University, Monterey Bay
100 Campus Center, Bldg 84D
Seaside, CA 93955

Dear Mike:

Thank you for your comments on the Draft 2015 Urban Water Management Plan. The Plan is prepared in response to statutory requirements of the Urban Water Management Planning Act. Comments received are incorporated into the report, where appropriate, as noted below:

Comment on page 5: Due to the number of agencies involved, we opted not to list the ex officio members of FORA.

Comment on page 6: The Quitclaim deed for the water and wastewater infrastructure was added to the reference list in Appendix B.

Comment on page 18: The District recently updated the accounting database, and the reporting tool which would facilitate reviewing earlier usage records was still under development while the plan was being prepared. We anticipate restoring that functionality within the next few months.

Comment on page 19: No response required for the 2015 Plan.

Comment on page 21, Table 3.5: Our records show that CSUMB metered all residential units in 2009, so the savings you point out were reflected and discussed in the 2010 UWMP. We do appreciate the on-going conservation efforts by the university.

Comment on page 25 and Appendix E: The current population is aggregated at the service area level (Ord Community and Central Marina), and not split out by jurisdiction. A footnote will be added to Table C-6 explaining that. What is shown in Table C-6 is only the projected increase in resident student and faculty population. Please note that the numbers you cited were total enrollment, which includes those living off-campus. Even the new Promontory dormitory is considered off-campus and part of the City of Marina population.

Comments on page 83 and 84: No response required for the 2015 Plan. Comments on tiered rates would be applicable to the next rate study, which should occur in 2017-18.

Comment on Appendix F, Water Shortage Contingency Plan. The discussion of revenue impacts due to implementing the Water Shortage Contingency Plan are a mandatory component of the Water Shortage Contingency Plan. Please note that the District implemented Stage 3 water use restrictions in 2015, but has not increased rates as a result. System maintenance is on-going even during a drought or shortage period, so your comment that that it would be curtailed is incorrect. Similarly, system expansion is driven by new development and funded through capacity charges, which are not related to the temporary shortages the Water Shortage Contingency Plan is meant to address.

We will provide you a copy of the final plan under separate cover.

Sincerely,

A handwritten signature in cursive script, appearing to read "Michael Wegley".

Michael Wegley, PE
District Engineer